



# WATHEROO WATER RESERVE

## WATER SOURCE PROTECTION PLAN

Watheroo Town Water Supply



WATER RESOURCE PROTECTION SERIES

WATER AND RIVERS COMMISSION REPORT WRP 21

1999



**WATER AND RIVERS**  
COMMISSION

---

WATER AND RIVERS COMMISSION  
HYATT CENTRE  
3 PLAIN STREET  
EAST PERTH  
WESTERN AUSTRALIA 6004  
TELEPHONE (08) 9278 0300  
FACSIMILE (08) 9278 0301  
WEBSITE: <http://www.wrc.wa.gov.au>

*Cover Photograph: Watheroo Town Hall*



---

# WATHEROO WATER RESERVE WATER SOURCE PROTECTION PLAN

Watheroo Town Water Supply

Water and Rivers Commission  
Policy and Planning Division

WATER AND RIVERS COMMISSION  
WATER RESOURCE PROTECTION SERIES  
REPORT NO WRP 21  
1999



---

# Acknowledgments

Contribution	Personnel	Title	Organisation
Supervision	Ross Sheridan	Program Manager, Protection Planning	Water and Rivers Commission
Report Preparation	Sandra Franz	Environmental Scientist	Water and Rivers Commission
Report Preparation	Lidia Boniecka	Environmental Engineer	Water and Rivers Commission
Report [preparation and editing]	Sunil Varma	Hydrogeologist	Water and Rivers Commission
Drafting	Dianne Abbott	Drafting Officer	Water and Rivers Commission
Drafting	Nigel Atkinson	Drafting Contractor	McErry Digital Mapping Pty Ltd

For more information contact:

Program Manager, Protection Planning  
Water Quality Protection Branch  
Water and Rivers Commission  
3 Plain Street  
EAST PERTH WA 6004

Telephone: (08) 9278 0300

Facsimile: (08) 9278 0585

## Reference Details

The recommended reference for this publication is:  
Water and Rivers Commission 1998, *Watheroo Water Reserve Water Source Protection Plan: Watheroo Town Water Supply*, Water and Rivers Commission, Water Resource Protection Series No WRP 21.

ISBN 0-7309-7360-3

ISSN 1326-7442

*Text printed on recycled stock  
August, 1999*



---

# Foreword

## Water source protection plans

Water Source Protection Plans establish the level of protection required within Water Reserves. The plans identify sources of contamination that should be investigated and set out programs for management of the resource. Water Source Protection Plans are developed in consultation with affected landowners and industry groups and relevant Government agencies.

Proclaiming Water Reserves under the *Country Areas Water Supply Act (1947)* protects the quality of water sources in country Western Australia. The Act's by-laws enable the Water and Rivers Commission to control potentially polluting activities, to regulate land use, inspect premises and to take steps to prevent or clean up pollution.

The Water and Rivers Commission aims to work pro-actively with planning agencies to incorporate water protection in the land planning process. Decisions on land use zoning and subdivision applications have a significant impact on the protection of water sources. The Commission supports the amendment of Town Planning Schemes and Development Strategies that reflect land use compatible with Water Source Protection Plans.

This Water Source Protection Plan provides a basis for establishing compatible land uses within the Water Reserve at Watheroo and is a mechanism for practical implementation of the Commission's protection strategies. Local government decision-makers, State planning authorities and operational staff are encouraged to recognise this document as a basis for ensuring the long term protection of this groundwater resource for generations to come.

## Water quality protection framework

The Water and Rivers Commission is responsible for managing and protecting Western Australia's water resources. The Commission has developed policies for the protection of public drinking water source areas that

include three levels of priority classification of lands within PDWSAs.

**Priority 1 (P1)** source protection areas are defined to ensure that there is no degradation of the water source. P1 areas are declared over land where the provision of the highest quality public drinking water is the prime beneficial land use. P1 areas would typically include land under Crown ownership. P1 areas are managed in accordance with the principle of risk avoidance and so land development is generally not permitted.

**Priority 2 (P2)** source protection areas are defined to ensure that there is no increased risk of pollution to the water source. P2 areas are declared over land where low intensity development (such as rural) already exists. Protection of public water supply sources is a high priority in these areas. P2 areas are managed in accordance with the principle of risk minimisation and so some development is allowed under specific guidelines.

**Priority 3 (P3)** source protection areas are defined to minimise the risk of pollution to the water source. P3 areas are declared over land where water supply sources need to co-exist with other land uses such as residential, commercial and light industrial developments. Protection of P3 areas is achieved through management guidelines rather than restrictions on land use. If the water source does become contaminated, then water may need to be treated or an alternative water source found.

In addition to priority classifications, well-head protection zones and reservoir protection zones are defined to protect the water source from contamination in the immediate vicinity of production wells and reservoirs. Well-head protection zones are usually circular, with a radius of 500 metres in P1 areas and 300 metres in P2 and P3 areas. Reservoir protection zones usually consist of a 2 kilometre buffer area around the top water level of a reservoir and include the reservoir itself. These zones do not extend outside water reserves. Special restrictions apply within these zones.



---

# Contents

Summary	1	Appendix	13
1. Introduction	2	Land use compatibility in Public Drinking Water Source Areas	
2. Physiography	2		
3. Hydrogeology	2	Plates	
4. Scheme description	4	Plate 1. Bores 3/63 and 5/78.....	2
5. Existing and proposed land use	4	Plate 2. The Watheroo wellfield is located on the privately owned Wrara Station .....	4
6. Potential for contamination	4		
7. Proposed proclaimed area	5	Figures	
Recommendations	7	Figure 1. Watheroo locality map.....	3
Implementation strategy	8	Figure 2. Proposed Watheroo water reserve .....	6
References	10		
Glossary	11		



---

# Summary

The Watheroo town water supply is obtained from a Water Corporation wellfield, which obtains groundwater from the fractures in the Noondine Chert that outcrops in the area. A Water Reserve had not been proclaimed.

The proposed Watheroo Water Reserve covers the area of outcrop of the Noondine Chert in the proximity of the wellfield, and should be classified as a Priority-2 source protection area.

The water reserve should be managed to minimise the risk of pollution to the water source. Therefore, signs indicating the location of the reserve should be erected, and any development proposals within the reserve should be assessed for their impact on water quality.

This plan has undergone extensive consultation during the development process. Prior to the preparation of the draft plan, discussions were held with key stakeholders. The draft plan was released for comment to key stakeholders including the Water Corporation, Ministry for Planning, Department of Environmental Protection, Department of Land Administration, Department of Conservation and Land Management, Shire of Moora, affected landowners and the Conservation Council. Comments received were considered and have been addressed in the preparation of this plan. On endorsement of the plan the local members, the Shire and other key stakeholders will be briefed on the recommendations.



---

## 1. Introduction

This report provides a plan to protect the groundwater resource used to supply the town of Watheroo from possible contamination.

The rural town of Watheroo is located 183 km north of Perth on the Midlands Road (Figure 1). The existing water scheme supplying Watheroo consists of three production wells located 4.5 km west of the townsite.

A Water Reserve has not been proclaimed.

## 2. Physiography

The Watheroo wellfield is located in a gently undulating area with a general regional slope to the west. The area has numerous creeks that drain to the west and the vegetation cover is mostly of medium density.

The Watheroo region has a temperate climate with mild wet winters and hot dry summers. The average rainfall is about 450 mm per year.

Land use in the area is predominantly rural including broadacre cropping and grazing.

## 3. Hydrogeology

The Watheroo wellfield is situated on the western margin of the Yilgarn Craton.

The wellfield obtains groundwater from the Proterozoic Noondine Chert consisting of chert and quartzite, with minor siltstone, sandstone, claystone and dolomite.

Groundwater occurs in fractures and joints in the Noondine Chert. Fractures may also occur adjacent to doleritic dykes that intrude the Noondine Chert. Drilling in the Noondine Chert has intersected yields as high as 1000 m<sup>3</sup>/d, however, yields of 200 m<sup>3</sup>/d are more likely.

The regional groundwater flow is probably in a westerly direction. However, local flow systems may be complex and controlled by topography, orientation of fracture zones and impermeable structures such as fresh chert or dykes (Martin, 1990).

Groundwater recharge is by direct infiltration of rainfall, however, the recharge rate is likely to be low. The depth to groundwater extends from about 20 to 30 m below ground level (bgl).


The aquifer is shallow and unconfined, therefore, vulnerable to contamination.



**Plate 1. Bores 3/63 and 5/78.**





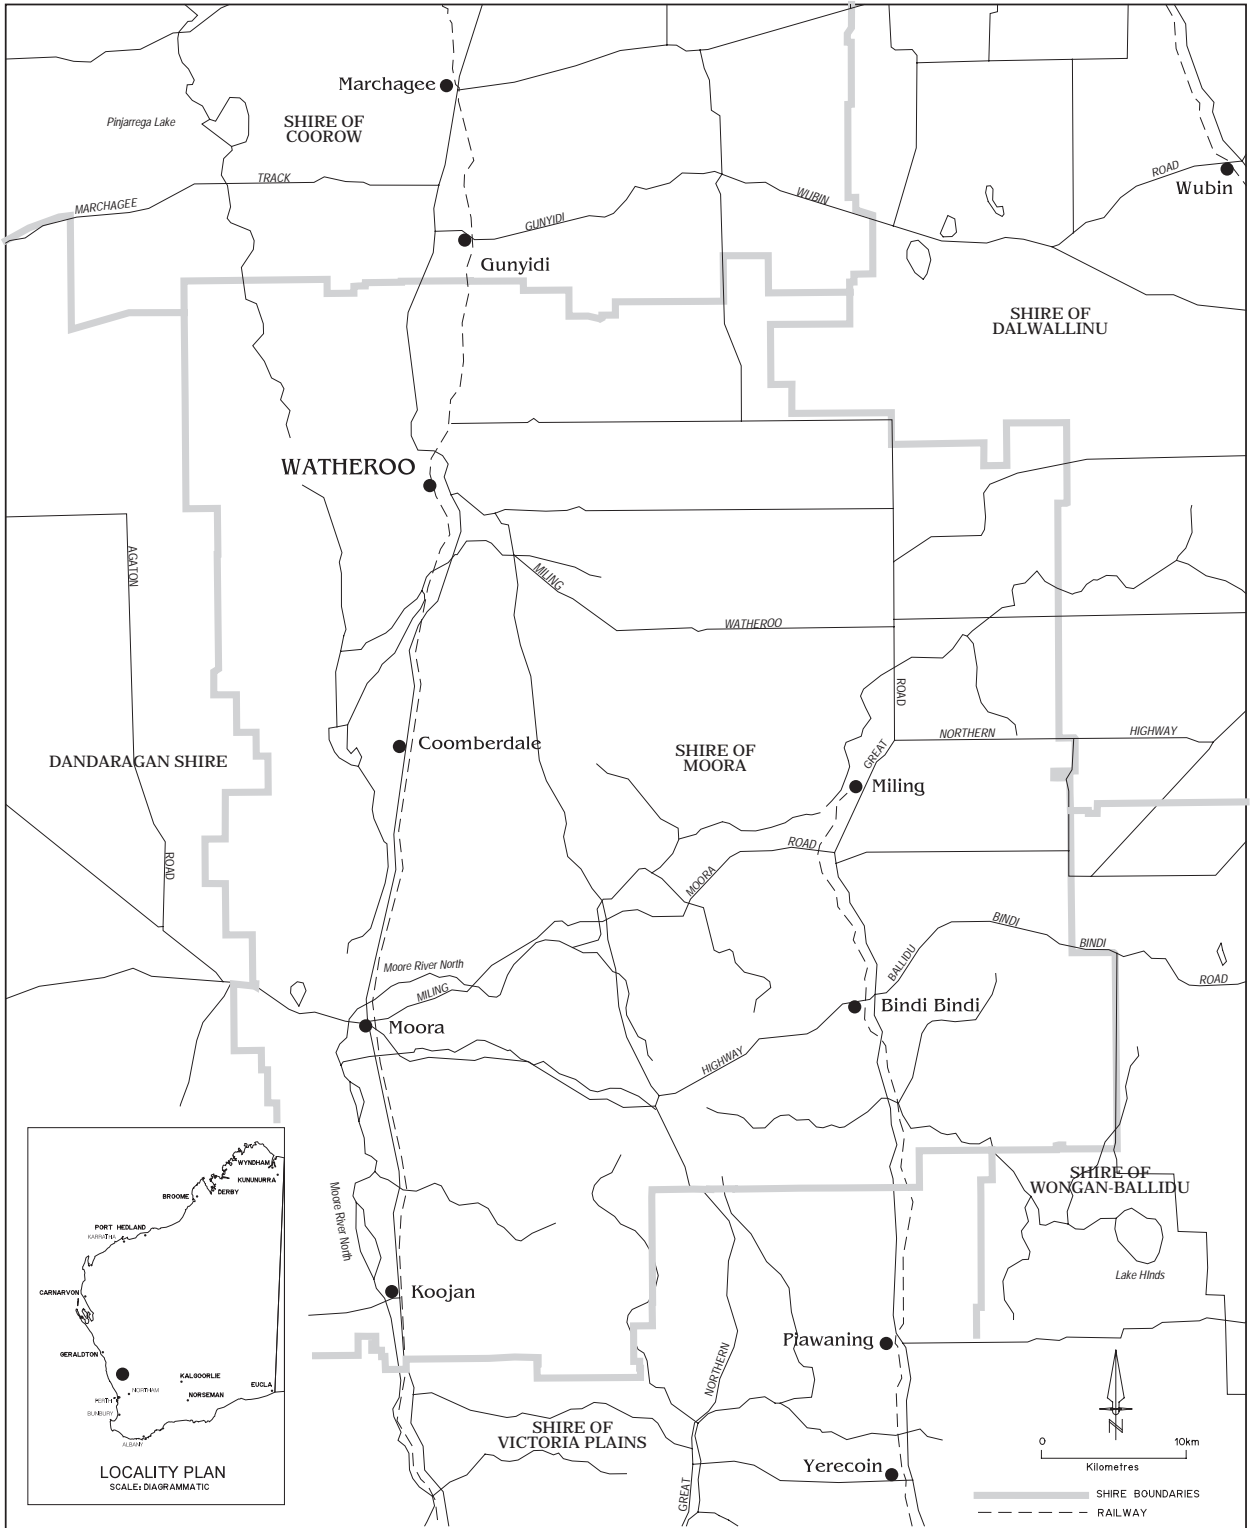

**Figure 1. Watheroo locality map.**



---

## 4. Scheme description

The Watheroo town water supply scheme consists of three production wells (3/63, 5/78 and 7/78) located 4.5 km west-northwest of the town on Wrara Station (Plate 1). Well 3/63 is screened from 32 to 38 m bgl, well 5/78 from 42 to 54 m and well 7/78 from 31 to 37 m bgl.

The average daily water production from the wellfield is 113 kL, while the daily peak demand is about 260 kL.

Salinity levels in the production wells have significantly increased during the span of operation with a higher rate of increase since 1983.

In 1992 salinity ranged between 975-1200 mg/L Total Dissolved Salts (TDS) in well 5/78, and 995-1300 mg/L TDS in well 3/63 and 7/78. The increase in salinity may be linked to abstraction exceeding the sustainable fresh yield of the wellfield causing inflow of saline groundwater from surrounding areas.

Except for turbidity and salinity, other major components of the analyses of the water in production wells conformed to the current Australian drinking water guidelines (NH&MRC and ARMCANZ, 1996).

## 5. Existing and proposed land use

The land in the vicinity of the Watheroo wellfield is used for broadacre cropping and grazing. Outcropping ridges of chert are covered with native vegetation (Plate 2).

The future land use within the proposed water reserve is likely to be a continuation of the existing rural land use.

## 6. Potential for contamination

The potential for contamination of the groundwater from land use within the proposed reserve is low. The risks associated with the extensive agricultural land use (Figure 2) are considered acceptable for the proposed priority 2 classification of the wellfield.



**Plate 2. The Watheroo wellfield is located on the privately owned Wrara Station.**



---

## 7. Proposed proclaimed area


The proposed Watheroo Water Reserve covers the area of outcrop of the Noondine Chert in the proximity of the Watheroo wellfield as shown in Figure 2. The western and eastern boundaries of the reserve coincide with the known extent of the local outcrop of the chert. The northern and southern boundaries have been based on the probable limits of prospective areas for future drilling to locate additional water supplies for the town determined from aerial photographs.

The proposed Water Reserve should be classified as a Priority 2 source protection area according to the following criteria:

- The wellfield is of critical importance to the community of Watheroo;
- The area is a recharge zone for the aquifer;
- This area may be used for development of future groundwater supply;
- The land is privately owned and used for low intensity rural land uses which are compatible with Priority 2;
- The area has soil conditions and hydrogeological characteristics that could lead to degradation of the groundwater quality if more intensive development was to take place.

A circular wellhead protection zone of 300 m radius centred on each well should secure the immediate wellfield.



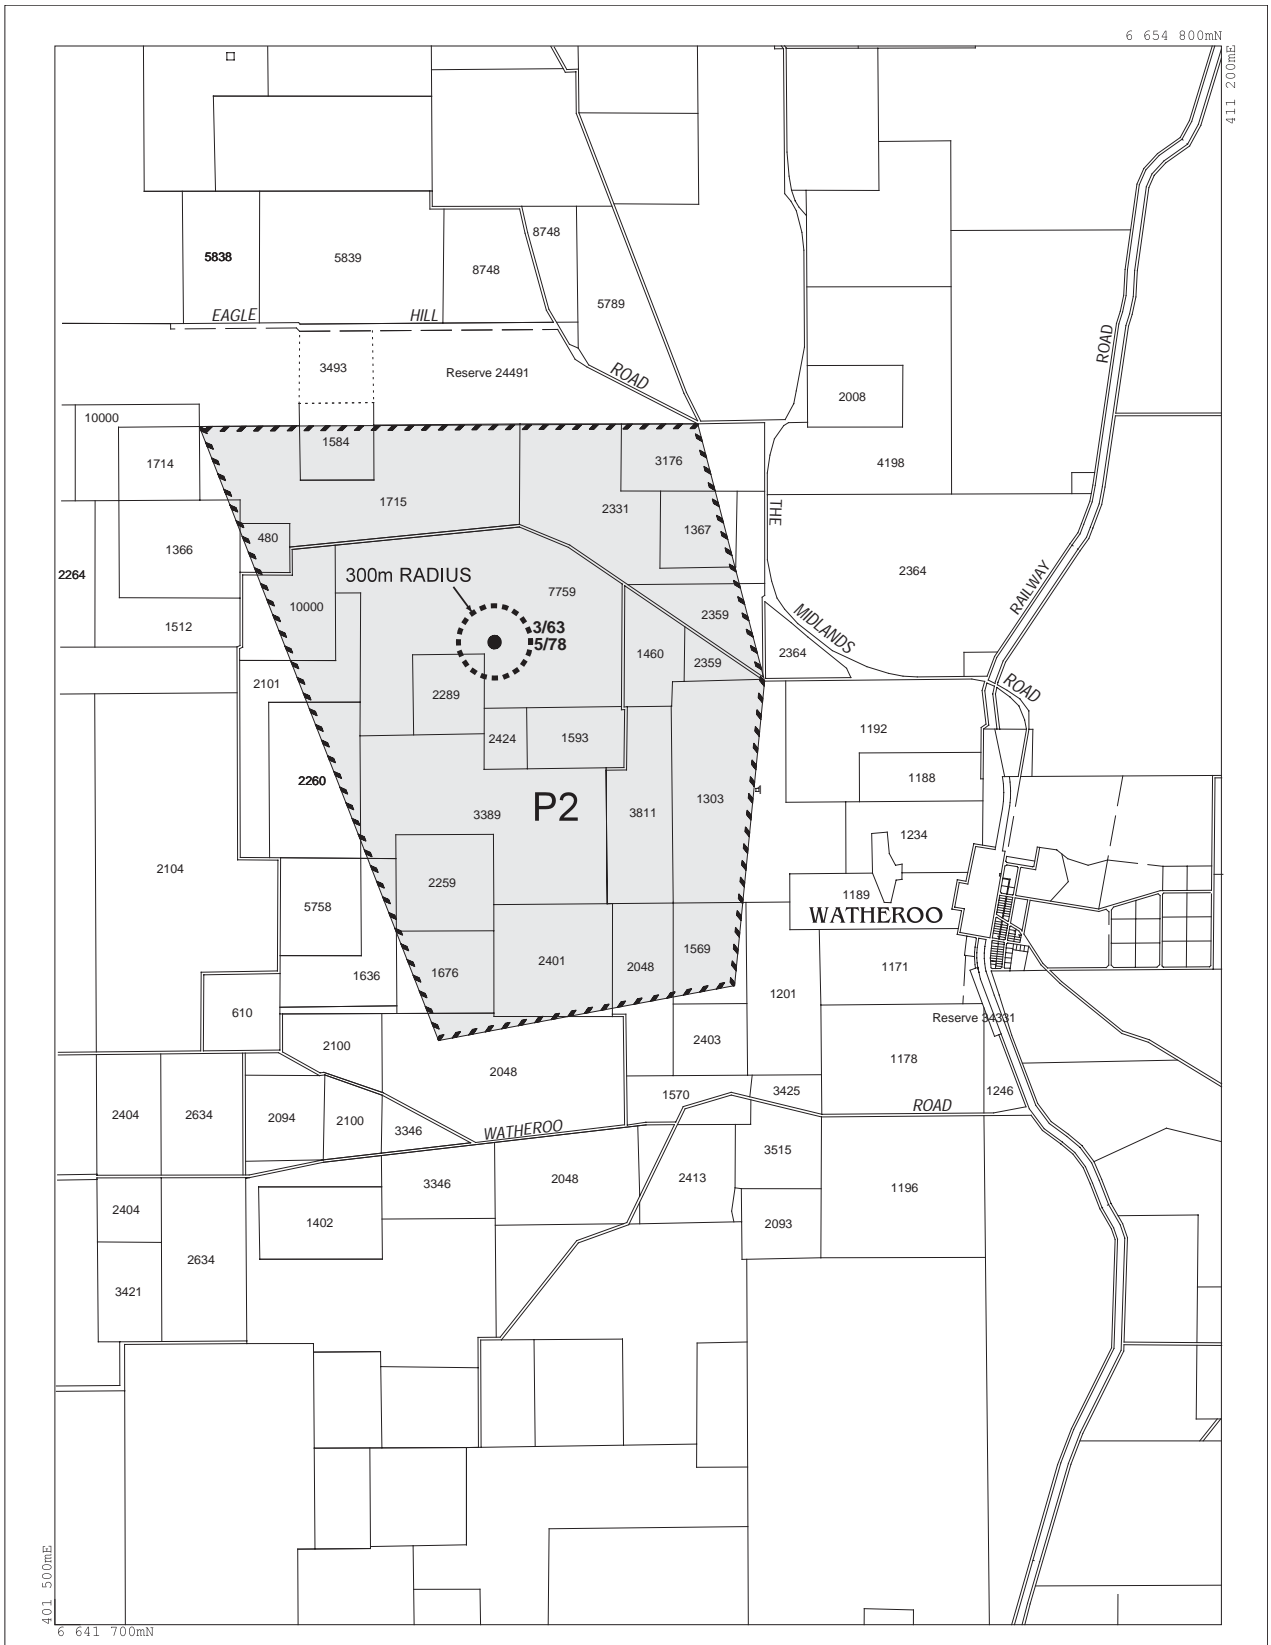

- LEGEND:**
- Production bore
  - Water Reserve boundary
  - 300m Wellhead protection zone
  - Cropping and grazing



INDEX TO ADJOINING  
1:100000  
MAPS

2038	2138	2238
2037	2137	2237
2036	2136	2236

**FIGURE 2.**  
**PROPOSED WATHEROO WATER RESERVE**

Drawn by N.J.A. Date 10/12/96

**Policy and Planning Division**  
Water Quality Protection Branch



---

# Recommendations

1. The proposed Watheroo Water Reserve should be gazetted under the *Country Areas Water Supply Act 1947*.
2. Planning strategies should incorporate the management principles outlined in the Water and Rivers Commission's *Land use Compatibility in Public Drinking Water Source Areas* (Appendix) and reflect the Priority 2 classification given to the proposed Water Reserve.
3. All development proposals in the proposed Water Reserve that are likely to impact on water quality should be referred to the Water and Rivers Commission.
4. When proclaimed, signs should be erected along the boundaries of the Water Reserve to define the reserve and promote public awareness of the need to protect water quality.
5. A process should be put in place to address spillage of pollutants within the proposed Water Reserve.
6. A surveillance program should be established to identify incompatible land uses or potential contaminant threats within the proposed Water Reserve.
7. Nutrient and pesticide levels in the Water Corporation production wells should be monitored to ensure drinking water quality criteria are not compromised.
8. Implementation of these recommendations should be reviewed one year after this plan is endorsed. A full review of this protection plan should be undertaken approximately every five years.



# Implementation strategy

No	Description	Implemented by	Timing
1.	Gazettal of Water Reserve.	Program Manager, Protection Planning (WRC).	2000
2.	Incorporation into land planning strategies.	Shire of Moora.	Ongoing
3.	Referral of development proposals: (i) WRC to provide the Shire of Moora with guidelines for referral of development proposals. (ii) Referral of development proposals.	(i) Program Manager, Protection Planning (WRC)  (ii) Shire of Moora, Ministry for Planning, Department of Minerals and Energy and Department of Environmental Protection.	(i) 2000  (ii) ongoing
4.	Erection of signs: (i) Development of guidelines for signage. (ii) Determine number and location of signs required.  (iii) Erect signs.	(i) Program Manager, Protection Planning (WRC). (ii) Regional Manager, Mid-West Gascoyne Region (WRC) in consultation with WC. (iii) Regional Manager, Mid-West Gascoyne Region (WRC).	(i) 2000 (ii) To be arranged.  (iii) To be arranged.

(continued)

5.	<p>Incidents covered by WESTPLAN – HAZMAT in the Watheroo Water Reserve should be addressed through the following measures:</p> <p>(i) The Moora Local Emergency Management Advisory Committee (through the Northam Emergency Management District) being familiar with the location and purpose of the Watheroo Water Reserve.</p> <p>(ii) The locality plan for the Watheroo Water Reserve being provided to the Fire and Rescue Services headquarters for the HAZMAT Emergency Advisory Team.</p> <p>(iii) The Water Corporation advising the HAZMAT Emergency Advisory Team during incidents in the Watheroo Water Reserve.</p> <p>(iv) Personnel dealing with WESTPLAN - HAZMAT incidents in the area given ready access to a locality map of the Water Reserve and training to understand the potential impacts of spills on the groundwater resource.</p>	<p>(i) Moora Local Emergency Management Advisory Committee (through Mid-West Gascoyne region)</p> <p>(ii) WRC (Mid-West Gascoyne region)</p> <p>(iii) Water Corporation</p> <p>(iv) Moora Local Emergency Management Advisory Committee</p>	<p>(i) 2000</p> <p>(ii) 2000</p> <p>(iii) Ongoing</p> <p>(iv) Ongoing</p>
6.	<p>Surveillance program:</p> <p>(i) Develop guidelines for the surveillance of Water Reserves.</p> <p>(ii) Implement the surveillance program.</p>	<p>(i) Program Manager, Protection Planning (WRC).</p> <p>(ii) Regional Manager, Mid-West Gascoyne Region (WRC).</p>	<p>(i) 2000</p> <p>(ii) On completion of surveillance guidelines.</p>
7.	<p>Monitoring program:</p> <p>(i) Incorporate water quality monitoring requirements as conditions on groundwater well licence.</p>	<p>(i) Manager, Water Allocation (WRC).</p>	<p>(i) To be arranged.</p>
8.	<p>Review of this plan and recommendations.</p>	<p>Water Quality Protection Branch (WRC).</p>	<p>(i) Initial review-2001.</p> <p>(ii) Full review-2005/06.</p>

---

# References

Holmes, D., (1995), *Groundwater Protection Plans for the Shires of Dandaragan, Gingin, Moora and Victoria Plains - Goldfields and Agricultural Region*, Report No. WG 203. Water Authority of Western Australia - Groundwater and Environment Branch, Draft, June 1995.

Martin, M. W., (1990), *Watheroo Town Water Supply Investigation*, Western Australia Geological Survey, Hydrogeology Report 1990/29.

National Health and Medical Research Council and Agricultural and Resource Management Council of Australia and New Zealand (NH&MRC and ARMCANZ), (1996), *Australian Drinking Water Guidelines*.

Shire of Moora, *Town Planning Scheme No. 4 (District Scheme)*.

Water Authority of Western Australia, (1988), *Groundwater Scheme Review Watheroo*, Report No. WG 14, September 1988.

Water Authority of Western Australia, (1990), *Watheroo Water Supply Scheme Groundwater Investigations*, Water Resources Directorate, Report No. WG 107, September 1990.





---

# Glossary

<b>Abstraction</b>	Pumping groundwater from an aquifer.
<b>Allocation</b>	The quantity of groundwater permitted to be abstracted by a well licence, usually specified in kilolitres/year (kL/a).
<b>Alluvium (alluvial)</b>	Detrital material which is transported by streams and rivers and deposited.
<b>Aquifer</b>	A geological formation or group of formations able to receive, store and transmit significant quantities of water.
<b>Bore</b>	A narrow, lined hole drilled to monitor or withdraw groundwater.
<b>Catchment</b>	The area of land which intercepts rainfall and contributes the collected water to surface water (streams, rivers, wetlands) or groundwater.
<b>Confined Aquifer</b>	An aquifer that is confined between shale and siltstone beds and therefore contains water under pressure.
<b>Diffuse Source Pollution</b>	Pollution originating from a widespread area e.g. urban stormwater runoff, agricultural runoff.
<b>Effluent</b>	The liquid, solid or gaseous wastes discharged by a process, treated or untreated.
<b>Groundwater</b>	Water which occupies the pores and crevices of rock or soil.
<b>Hydrogeology</b>	The study of groundwater, especially relating to the distribution of aquifers, groundwater flow and groundwater quality.
<b>Leaching / Leachate</b>	The process by which materials such as organic matter and mineral salts are washed out of a layer of soil or dumped material by being dissolved or suspended in percolating rainwater, the material washed out is known as leachate. Leachate can pollute groundwater and waterways.
<b>m AHD</b>	Australian Height Datum. Height in metres above Mean Sea Level +0.026 m at Fremantle.
<b>Nutrient Load</b>	The amount of nutrient reaching the waterway over a given time (usually per year) from its catchment area.
<b>Nutrients</b>	Minerals dissolved in water, particularly inorganic compounds of nitrogen (nitrate and ammonia) and phosphorus (phosphate) which provide nutrition (food) for plant growth. Total nutrient levels include the inorganic forms of an element plus any bound in organic molecules.



---

<b>Pesticides</b>	Collective name for a variety of insecticides, fungicides, herbicides, algicides, fumigants and rodenticides used to kill organisms.
<b>Point Source Pollution</b>	Specific localised source of pollution e.g. sewage or effluent discharge, industrial waste discharge.
<b>Pollution</b>	Water pollution occurs when waste products or other substances e.g. effluent, litter, refuse, sewage or contaminated runoff, change the physical, chemical, biological or thermal properties of the water, adversely affecting water quality, living species and beneficial uses.
<b>Public Water Source Area</b>	(PWSA) As for UWPCA, but allowing the taking of groundwater for public supplies.
<b>Recharge</b>	Water infiltrating to replenish an aquifer.
<b>Recharge Area</b>	An area through which water from a groundwater catchment percolates to replenish (recharge) an aquifer. An unconfined aquifer is recharged by rainfall throughout its distribution. Confined aquifers are recharged in specific areas where water leaks from overlying aquifers, or where the aquifer rises to meet the surface.
<b>Runoff</b>	Water that flows over the surface from a catchment area, including streams.
<b>Saltwater Intrusion</b>	The inland intrusion of saltwater into a layer of fresh groundwater.
<b>Scheme Supply</b>	Water diverted from a source (or sources) by a water authority or private company and supplied via a distribution network to customers for urban, industrial or irrigation use.
<b>Storage Reservoir</b>	A major reservoir of water created in a river valley by building a dam.
<b>Stormwater</b>	Rainwater which has run off the ground surface, roads, paved areas etc and is usually carried away by drains.
<b>Treatment</b>	Application of techniques such as settlement, filtration and chlorination to render water suitable for specific purposes including drinking and discharge to the environment.
<b>Unconfined Aquifer</b>	An aquifer containing water, the upper surface of which is lower than the top of the aquifer. The upper surface of the groundwater within the aquifer is called the watertable.
<b>Underground Water Pollution Control Area</b>	UWPCA) An area defined under the Metropolitan Water Supply Sewerage and Drainage Act, in which restrictions are put on activities that may pollute the groundwater.
<b>Wastewater</b>	Water that has been used for some purpose and would normally be treated and discarded. Wastewater usually contains significant quantities of pollutant.
<b>Water Quality</b>	The physical, chemical and biological measures of water.
<b>Watertable</b>	The upper saturated level of the unconfined groundwater.
<b>Wellfield</b>	A group of bores to monitor or withdraw groundwater.



---

# Appendix

Land use compatibility in Public Drinking Water Source Areas



## LAND USE COMPATIBILITY IN PUBLIC DRINKING WATER SOURCE AREAS

### Purpose

To provide information on land use and activities that may impact on the quality of the State's water resources.

These notes provide a basis for developing formal guidelines in consultation with key stakeholders.

### Scope

These notes apply to proposed and existing land use within Public Drinking Water Source Areas (PDWSAs).

PDWSAs include Underground Water Pollution Control Areas, Water Reserves and public water supply catchment areas declared under the *Metropolitan Water Supply, Sewerage and Drainage Act 1909*, and the *Country Areas Water Supply Act 1947*.

### Preamble

The following notes reflect the Commission's current position. They are recommendations only, and may be varied at the discretion of the Commission.

### Overview of Protection Framework

The Water and Rivers Commission is responsible for managing and protecting Western Australia's water resources. The Commission has policies for the protection of public drinking water source areas that include three levels of priority classification of lands within PDWSAs.

**Priority 1 (P1)** source protection areas are defined to ensure that there is **no degradation** of the water source. P1 areas are declared over land where the provision of the highest quality public drinking water is the prime beneficial land use. P1 areas would typically include land under Crown ownership. P1 areas are managed in accordance with the principle of **risk avoidance** and so land development is generally not permitted.

**Priority 2 (P2)** source protection areas are defined to ensure that there is **no increased risk of pollution** to the water source. P2 areas are declared over land where low intensity development (such as rural) already exists. Protection of public water supply sources is a high priority in these areas. P2 areas are managed in

accordance with the principle of **risk minimisation** and so some development is allowed under specific guidelines.

**Priority 3 (P3)** source protection areas are defined to **minimise the risk of pollution** to the water source. P3 areas are declared over land where water supply sources need to co-exist with other land uses such as residential, commercial and light industrial developments.

Protection of P3 areas is achieved through **management guidelines** rather than restrictions on land use. If the water source does become contaminated, then water may need to be treated or an alternative water source found.

In addition to priority classifications, **well-head protection zones** and **reservoir protection zones** are defined to protect the water source from contamination in the immediate vicinity of production wells and reservoirs. Well-head protection zones are usually circular, with a radius of 500 metres in P1 areas and 300 metres in P2 and P3 areas. Reservoir protection zones usually consist of a 2 kilometre buffer area around the top water level of a reservoir and include the reservoir itself. These zones do not extend outside water reserves. Special restrictions apply within these zones.

### **Tables showing Land Use Compatibility with the Commission's PDWSA protection strategy**

These tables should be used as a guideline only. More detailed information on the Commission's requirements in the form of activity guidelines or notes is available for some land uses. These can be found on the 'Protecting Water' web page on the Commission's internet site ([www.wrc.wa.gov.au](http://www.wrc.wa.gov.au)). Alternately information relating to land use and development within PDWSAs including those not listed in the tables, can be obtained from the Commission's Water Quality Protection Branch.

The Commission recognises that many activities were lawfully established before the introduction of these tables. The Commission will negotiate with the operators of such activities to ensure that appropriate management practices are in place to minimise the impact on water resources.

These tables do not replace the need for assessment by the Commission. Please consult the Commission for advice on any land use proposals in Public Drinking Water Source Areas that may impact on water resources.

### **Definitions used in the following tables**

<i>Compatible</i>	The land use is compatible with the management objectives of the priority classification.
<i>Incompatible</i>	The land use is incompatible with the management objectives of the priority classification.
<i>Restricted</i>	The land use may be compatible with the management objectives of the priority classification, with appropriate site management practices. All restricted developments / activities should be referred to the Commission for assessment on a case specific basis.
<i>Extensive</i>	Where limited additional inputs are required to the land to support the desired land use. eg supplementary animal feed only during seasonal dry periods.
<i>Intensive</i>	Where regular additional inputs are required to support the desired land use. eg irrigation, fertilisers and non forage animal feed dominates.



## More information

We welcome your comment on these notes. They will be updated from time to time as comments are received or activity standards change. The Commission is progressively developing Water Quality Protection Notes and Guidelines covering land uses described in the attached tables. Advice on available guidance documents may be obtained by contacting the Commission.

If you wish to comment on the notes or require more information, please contact the Commission's Water Quality Protection Branch at the Hyatt Centre in East Perth.

Phone: (08) 9278 0300 (business hours) or Fax:(08) 9278 0585

## Tables showing Land use compatibility with PDWSA protection objectives

### AGRICULTURE - ANIMALS

Land use	Priority 1	Priority 2	Priority 3
Animal saleyards and stockyards <sup>14</sup>	Incompatible	Incompatible <sup>7</sup>	Restricted <sup>7</sup>
Apiaries on Crown land	Restricted	Restricted	Restricted
Aquaculture eg. crustaceans, fish, algae farms	Incompatible	Restricted	Restricted
Dairy sheds	Incompatible	Incompatible <sup>11,15</sup>	Restricted <sup>15</sup>
Feedlots	Incompatible	Incompatible	Restricted
Livestock grazing - pastoral leases	Restricted	Compatible	Compatible
Livestock grazing - broad acre (extensive)	Incompatible	Restricted <sup>11</sup>	Compatible
Livestock grazing (intensive)	Incompatible	Incompatible	Restricted <sup>11</sup>
Piggeries	Incompatible	Incompatible	Incompatible
Poultry farming (housed)	Incompatible	Restricted	Restricted
Stables	Incompatible	Restricted	Compatible

### AGRICULTURE - PLANTS

Land use	Priority 1	Priority 2	Priority 3
Broad acre cropping i.e. non-irrigated	Incompatible	Restricted <sup>1</sup>	Compatible
Floriculture (extensive)	Incompatible	Restricted	Compatible
Floriculture (intensive)	Incompatible	Incompatible	Restricted
Horticulture- hydroponic	Incompatible	Restricted	Restricted
Horticulture - market gardens	Incompatible	Incompatible	Restricted
Orchards	Incompatible	Restricted	Compatible
Nurseries (potted plants)	Incompatible	Restricted	Compatible
Silviculture (tree farming)	Restricted	Restricted	Compatible
Turf farms	Incompatible	Incompatible	Restricted
Viticulture (wine & table grapes)	Incompatible	Restricted	Compatible



## **DEVELOPMENT - COMMERCIAL**

<b>Land use</b>	<b>Priority 1</b>	<b>Priority 2</b>	<b>Priority 3</b>
Aircraft servicing	Incompatible	Incompatible	Restricted <sup>6</sup>
Airports or landing grounds	Incompatible	Incompatible	Restricted <sup>6</sup>
Amusement centres	Incompatible	Incompatible	Compatible <sup>6</sup>
Automotive businesses	Incompatible	Incompatible	Restricted <sup>6</sup>
Boat servicing	Incompatible	Incompatible	Restricted <sup>6</sup>
Catteries	Incompatible	Compatible	Compatible
Caravan and trailer hire	Incompatible	Incompatible	Restricted <sup>6</sup>
Consulting rooms	Incompatible	Incompatible <sup>7</sup>	Compatible <sup>6</sup>
Concrete batching and cement products	Incompatible	Incompatible	Restricted
Cottage Industries	Restricted	Restricted	Compatible
Dog kennels	Incompatible	Restricted	Restricted
Drive in / take-away food shops	Incompatible	Incompatible	Compatible <sup>6</sup>
Drive -in theatres	Incompatible	Incompatible	Compatible <sup>6</sup>
Dry cleaning premises	Incompatible	Incompatible	Restricted <sup>6</sup>
Farm supply centres	Incompatible	Incompatible <sup>7</sup>	Restricted
Fuel depots	Incompatible	Incompatible	Restricted
Garden centres	Incompatible	Incompatible	Compatible
Laboratories (analytical , photographic)	Incompatible	Incompatible	Restricted <sup>6</sup>
Markets	Incompatible	Incompatible	Compatible <sup>6</sup>
Mechanical servicing	Incompatible	Incompatible	Restricted <sup>6</sup>
Metal production / finishing	Incompatible	Incompatible	Incompatible
Milk transfer depots	Incompatible	Incompatible	Restricted
Pesticide operator depots	Incompatible	Incompatible	Incompatible
Restaurants and taverns	Incompatible	Incompatible	Compatible <sup>6</sup>
Service stations	Incompatible	Incompatible	Restricted <sup>6</sup>
Shops and shopping centres	Incompatible	Incompatible <sup>7</sup>	Compatible <sup>6</sup>
Transport depots	Incompatible	Incompatible	Restricted
Vehicle parking (commercial)	Incompatible	Incompatible	Compatible
Vehicle wrecking and machinery	Incompatible	Incompatible	Restricted
Veterinary clinics / hospitals	Incompatible	Incompatible <sup>7</sup>	Restricted <sup>6</sup>

## **DEVELOPMENT - INDUSTRIAL**

<b>Land use</b>	<b>Priority 1</b>	<b>Priority 2</b>	<b>Priority 3</b>
Heavy Industry	Incompatible	Incompatible	Incompatible
Light or general Industry	Incompatible	Incompatible	Restricted <sup>6</sup>
Power Stations	Incompatible	Incompatible	Incompatible



**DEVELOPMENT - URBAN**

Land use	Priority 1	Priority 2	Priority 3
Aged and dependent persons group dwellings	Incompatible	Incompatible	Compatible <sup>6</sup>
Cemeteries	Incompatible	Incompatible	Restricted
Civic buildings	Incompatible	Restricted <sup>7</sup>	Compatible <sup>6</sup>
Clubs -sporting or recreation	Incompatible	Restricted	Compatible <sup>6</sup>
Community halls	Incompatible	Restricted <sup>7</sup>	Compatible
Family day care centres	Incompatible	Incompatible <sup>7</sup>	Compatible <sup>6</sup>
Funeral parlours	Incompatible	Incompatible	Compatible <sup>6</sup>
Health centres	Incompatible	Incompatible	Compatible <sup>6</sup>
Hospitals	Incompatible	Incompatible	Restricted <sup>6</sup>
Medical centres	Incompatible	Incompatible	Compatible <sup>6</sup>
Toilet blocks and change rooms	Incompatible <sup>7</sup>	Restricted	Compatible

**EDUCATION / RESEARCH**

Land use	Priority 1	Priority 2	Priority 3
Community education centres	Restricted <sup>7</sup>	Restricted <sup>7</sup>	Compatible <sup>6</sup>
Primary / Secondary Schools	Incompatible	Incompatible	Compatible <sup>6</sup>
Scientific Research	Restricted	Restricted	Compatible
Tertiary Education Facilities	Incompatible	Incompatible	Restricted <sup>6</sup>

**MINING AND MINERAL PROCESSING**

Land use	Priority 1	Priority 2	Priority 3
Extractive industries (sand mining, quarries)	Restricted <sup>2</sup>	Restricted <sup>2</sup>	Restricted <sup>2</sup>
Mineral exploration	Restricted <sup>4</sup>	Restricted <sup>4</sup>	Restricted <sup>4</sup>
Mining	Restricted <sup>4</sup>	Restricted <sup>4</sup>	Restricted <sup>4</sup>
Mineral processing	Incompatible	Incompatible	Restricted <sup>4</sup>
Tailings dams	Incompatible	Incompatible	Restricted <sup>4</sup>

**PROCESSING OF ANIMALS / ANIMAL PRODUCTS**

Land use	Priority 1	Priority 2	Priority 3
Animal product rendering works	Incompatible	Incompatible	Incompatible
Abattoirs	Incompatible	Incompatible	Incompatible
Dairy product factories	Incompatible	Incompatible	Restricted <sup>6</sup>
Food Processing	Incompatible	Incompatible	Restricted <sup>6</sup>
Tanneries	Incompatible	Incompatible	Incompatible
Wool-scourers	Incompatible	Incompatible	Incompatible

**PROCESSING OF PLANTS / PLANT PRODUCTS**

Land use	Priority 1	Priority 2	Priority 3
Breweries	Incompatible	Incompatible	Restricted <sup>6</sup>
Composting / soil blending (commercial)	Incompatible	Incompatible	Restricted
Vegetable / food processing	Incompatible	Incompatible	Restricted <sup>6</sup>
Wineries	Incompatible	Incompatible	Restricted





## **SUBDIVISION**

<b>Land use</b>	<b>Priority 1</b>	<b>Priority 2</b>	<b>Priority 3</b>
Rural subdivision to a minimum lot size of 4 ha	Incompatible	Compatible	Compatible
Rural subdivision to a lot size less than 4 ha	Incompatible	Incompatible	Incompatible
Special rural subdivision to a minimum lot size of 2 ha	Incompatible	Restricted <sup>8,9</sup>	Restricted <sup>8</sup>
Special rural subdivision to a lot size between 1 and 2 ha	Incompatible	Incompatible	Restricted <sup>8,9</sup>
Special rural subdivision to a lot size less than 1 ha	Incompatible	Incompatible	Incompatible
Urban subdivision	Incompatible	Incompatible	Compatible <sup>6</sup>
Industrial subdivision	Incompatible	Incompatible	Restricted <sup>6</sup>

**Note: Subdivision of lots to any size within Priority 1 areas is incompatible**

## **SPORT AND RECREATION**

<b>Land use</b>	<b>Priority 1</b>	<b>Priority 2</b>	<b>Priority 3</b>
Equestrian centres	Incompatible	Incompatible	Compatible
Golf courses	Incompatible	Incompatible	Restricted <sup>1</sup>
Motor sports ie permanent racing facilities	Incompatible	Incompatible	Restricted
Public swimming pools	Incompatible	Incompatible	Restricted
Recreational parks -irrigated	Incompatible	Incompatible	Restricted <sup>1</sup>
Rifle ranges	Incompatible	Restricted	Compatible

## **STORAGE/ PROCESSING OF TOXIC AND HAZARDOUS SUBSTANCES (THS)**

<b>Land use</b>	<b>Priority 1</b>	<b>Priority 2</b>	<b>Priority 3</b>
Above ground storage of THS	Restricted	Restricted	Restricted
Underground storage tanks for THS	Incompatible	Incompatible	Restricted

## **TOURISM ACCOMMODATION.**

<b>Land use</b>	<b>Priority 1</b>	<b>Priority 2</b>	<b>Priority 3</b>
Bed and breakfast accommodation	Incompatible	Restricted <sup>16</sup>	Compatible
Caravan parks	Incompatible	Incompatible	Restricted <sup>6</sup>
Farm stay accommodation	Incompatible	Restricted <sup>16</sup>	Compatible
Motels, hotels, lodging houses, hostels	Incompatible	Incompatible	Compatible <sup>6</sup>

## **WASTE TREATMENT AND MANAGEMENT**

<b>Land use</b>	<b>Priority 1</b>	<b>Priority 2</b>	<b>Priority 3</b>
Injection of liquid wastes into ground water	Incompatible	Incompatible	Incompatible
Landfills -Class I, II or III	Incompatible	Incompatible	Restricted
Landfills -Class IV and V	Incompatible	Incompatible	Incompatible
Recycling depots	Incompatible	Incompatible	Restricted



Land use	Priority 1	Priority 2	Priority 3
Refuse transfer stations	Incompatible	Incompatible	Restricted
Sewers (gravity)	Incompatible	Incompatible	Compatible
Sewers (pressure mains)	Incompatible	Restricted	Compatible
Sewage pump stations	Incompatible	Restricted	Restricted
Used tyre storage / disposal facilities	Incompatible	Incompatible	Incompatible
Wastewater treatment plants	Incompatible	Incompatible	Restricted
Water treatment plants	Restricted	Restricted	Restricted

### **OTHER DEVELOPMENTS**

Land use	Priority 1	Priority 2	Priority 3
Caretaker's housing	Incompatible <sup>7</sup>	Restricted	Compatible
Communications receivers / transmitters	Restricted	Restricted	Restricted
Construction projects (not shown elsewhere)	Restricted	Restricted	Restricted
Forestry	Restricted <sup>1</sup>	Compatible	Compatible
Major transport routes	Incompatible	Restricted <sup>10</sup>	Compatible
National and Regional Parks <sup>13</sup>	Compatible	Compatible	Compatible
Nature reserves	Compatible	Compatible	Compatible

#### **Table reference notes:**

1. Restrictions include fertiliser and pesticide application.
2. Restrictions include the storage of fuels and chemicals, the depth of mining in relation to the mining table with strict guidelines for rehabilitation.
3. Restrictions include the storage and use of fuel and other chemicals.
4. Subject to conditions placed on the mining lease and / or environmental approval.
5. Special rural development must have appropriate provisions under the Town Planning Scheme, to prevent introduction of land uses and practices that pose an unacceptable risk to water resources.
6. Must be connected to deep sewerage, except where exemptions apply under the current Government Sewerage Policy.
7. Only permitted if this use is incidental to the overall land use in the area and consistent with planning strategies.
8. Lots should only be created where land capability allows on-site soakage disposal of treated wastewater. Restrictions apply to siting of wastewater disposal systems in areas with poor land capability and / or a shallow depth to groundwater, animals are held or fertiliser is applied. Alternative wastewater treatment systems, where approved by the Health Department, may be appropriate if well maintained.
9. An average rather than minimum lot size may be acceptable if the proponent can demonstrate that the water quality objectives of the source protection area are met, and caveats are placed on titles of larger blocks stating that further subdivision cannot occur.
10. Restrictions include road design, construction and the types of goods that may be carried.
11. May be permitted if animal stocking levels (number of animals per hectare) are consistent with source protection objectives.
12. May be permitted if the type, volume and storage mechanisms for chemicals are compatible with water quality protection objectives.
13. Visitor and management infrastructure and facilities must be appropriately sited and maintained.
14. This does not include on-farm / pastoral lease stock-yards used for animal husbandry.
15. Waste management practices must be compatible with source protection objectives.
16. Restrictions apply on density of accommodation in Priority 2 areas.

