



WATER AUTHORITY
of Western Australia

Planning Future Sources for Perth's Water Supply (1989 Revision)

November 1988 Draft

ISBN 0 nnnn nnnn n

Report No. WP 68
1989



Water Authority
of Western Australia

WATER RESOURCES DIRECTORATE
Water Resources Planning Branch

Planning Future Sources for Perth's Water Supply (1989 Revision)

G. Mauger

Published by the

Water Authority of Western Australia
John Tonkin Water Centre
629 Newcastle Street
Leederville WA 6007

Telephone: (09) 420 2420

Report No. WP 68

1989

NOTE TO REVIEWERS OF DRAFT REPORT

The text has been marked to indicate where there are differences between this revision and the original version of the report. A # shows where something has been deleted. Anything added has been underlined. This approach has not been strictly followed in REFERENCES, where titles were normally underlined.

The tables and figures showing the Source Development Timetables (Tables 6-8, Figs 10-12) have been completely revised. Fig 9 showing Perth rainfall is a new figure.

The descriptions of individual projects in Table A3 (Appendix A) have been extensively revised and direct comparison with the originals will be necessary to detect the changes. Similarly, several other maps and figures have been modified without marking the changes. Map A1 in Appendix A needs some minor changes but it has not been updated in this draft.

Appendices B and D have not been altered.

New text has not yet been professionally edited, so please forebear with awkward turns of phrase. I am sorry if the meaning cannot be fathomed.

Your comments on any aspect of the report are invited, and do not have to be confined to the new material. To offer comments, you may write on separate paper or annotate the draft report and return to:

Managing Director
Water Authority of Western Australia
629 Newcastle Street
LEEDERVILLE WA 6007

(Attention: Mr Geoff Mauger)

or you may telephone Geoff Mauger on 420 2731 and give your comments verbally.

To be considered in preparing the final draft of this 1989 Revision, your comments should be received by 30/11/1988. Later comments could have some influence on future revisions.

FOREWORD

The population of Perth is currently growing at a rate of about 2% per year and the indications are that Perth will continue to grow. This means that there will be a growing need for water, resulting in greater pressures being put on our water and land resources.

Prior to the early 1970s, competition for available water resources in the metropolitan area was relatively low. This is no longer the case and competing demands for the available resources have reached a level where conflict is arising between users.

In addition to the competing demands for use of the water, the conflict between land use and developing water resources is now very real. Land use practices can seriously affect the quantity and quality of both surface and groundwater resources.

Resolution of these complex issues, recognizing that the different community perceptions of water needs, requires careful planning well in advance of utilisation. The Western Australian Water Resources Council and the Water Authority are therefore seeking to broaden the base of regional water planning. As a part of this trend the Water Resources Council has recently commenced a study to evaluate the demands for water resource allocations for all purposes in the Perth to Bunbury region. This Perth/Bunbury study, in due course, will provide a comprehensive base for planning the future utilisation and management of water in this fast growing region.

In the meantime however, there is a need to continue with planning appropriate means for dealing with expected increases in demand for water supply within the Perth metropolitan area.

The Water Authority is seeking to address this need by a combination of means, rather than solely by new source development.

For example, work is actively proceeding to establish an effective and integrated strategy to encourage efficient water use and reduce the rate of growth in demand.

However, just as the Water Authority would see strategies based solely on new water resource developments as unrealistic in Perth's situation, so also would it be unrealistic to expect that demand management strategies will eliminate the need to develop new sources. The Water Authority's Source Development Plan, as presented in this report, shows how predicted increases in demands on Perth's public water supply system could be met by development of new sources.

Estimates are made of when new sources will be required, but essentially a new source is needed whenever demand exceeds the capacity of the installed system. Where other strategies can be effectively and economically introduced, they will achieve

welcome deferrals of source development. However, unless the community is prepared to accept radical changes in their lifestyles, new sources must eventually be added to the system.

Ad hoc or reactionary decisions on developing the limited available water resources could strongly affect the cost and utility of future public water supply and could have adverse effects on other water values. The Water Authority believes that there is a need for wider awareness of water problems and informed discussions on the issues facing the community in future water planning. This report has been produced to assist with such discussion.

K. C. Webster
DIRECTOR OF WATER RESOURCES

CONTENTS		Page
FOREWORD		iii
1.	INTRODUCTION	1
2.	THE PLANNING PROCESS	2
	Objectives	2
	Planning procedures	2
	Strategic planning	3
	Project planning	5
	Environmental assessment	6
3.	THE DEMAND FOR WATER	7
	Water users	7
	Demand history	7
	Predicting future demands for water	10
	<u>#Water Conservation</u>	12
	Water restrictions	13
4.	WATER RESOURCES	14
	Sources of water	14
	River (surface) resources	18
	Shallow groundwater resources	21
	Artesian groundwater resources	23
	Desalination	26
	Re-use of wastewater	27
	Development of private resources	27
5.	WATER SUPPLY SCHEMES	28
	River resources	28
	Groundwater resources	30
	The water supply system	31
6.	CHANGING YIELD OF RESOURCES ALREADY DEVELOPED	31
	<u>Greenhouse Effect</u>	31
	<u>Management of native forest</u>	33
	<u>Management of pine plantations</u>	34
	<u>Redevelopment of existing schemes</u>	34
	<u>Increasing pipeline capacity</u>	35
7.	THE SOURCE DEVELOPMENT PLAN	35
	Existing and proposed schemes	35
	Selecting schemes for the Source Development Plan	36
	The Source Development Timetable	38
	Alternative timetables	40
8.	CURRENT PLANNING FOR NEAR FUTURE SOURCES	40
ACKNOWLEDGEMENTS		50
REFERENCES		51
GLOSSARY		54
LIST OF ABBREVIATIONS		57

APPENDICES		Page
A	Sources assessed for inclusion in the Source Development Plan	59
B	Impacts of land use on water resources and impacts of water resource development on land use	105
C	Assumptions used in long-term projection of water demand	118
D	Water Quality Objectives	122
E	Constraints on timing of schemes in the Source Development Timetable	125
 MAPS		
Map 1	Existing MWS Sources, distribution and areas served	8
Map 2	Location map	17
Map 3	Water resources near Perth (excluding artesian water)	19
Map 4	Water supply scheme locations	41
 FIGURES		
Fig. 1	The planning and decision-making process	4
Fig. 2	Annual water use from Perth's public water supply	9
Fig. 3	Annual domestic consumption per person, Perth Metropolitan Area	11
Fig. 4	Projected annual demand for public water supply for the Perth Metropolitan Area	12
Fig. 5	Occurrence and movement of shallow groundwater	25
Fig. 6	Occurrence and movement of artesian groundwater	25
Fig. 7	Schematic description of types of development of river sources	29
Fig. 8	Schematic description of groundwater scheme development	30
Fig. 9	Perth Rainfall Showing Assumed Reducing Mean to 2040	32
Fig.10	'Maximum' Source Development Timetable	45
Fig.11	'Most likely' Source Development Timetable	47
Fig.12	'Minimum' Source Development Timetable	49
 TABLES		
Table 1	Classes of general water restrictions for the MWS	14
Table 2	Approximate costs of water from various sources	16
Table 3	Characteristics of schemes for development of river sources	29
Table 4	Existing and possible future river schemes for the MWS	36
Table 5	Existing and possible future groundwater schemes for the MWS	38
Table 6	'Maximum' Source Development Timetable	44
Table 7	'Most likely' Source Development Timetable	46
Table 8	'Minimum' Source Development Timetable	48

1. INTRODUCTION

Continued availability of good quality water supplies is essential for the future of Perth. A constant supply of drinking water is vital for human life. The use of water for other purposes, such as toilet flushing, bathing and washing, firefighting, and in primary production and manufacturing processes, are essential to maintain the economic and social structure of Perth. To maintain our lifestyle and attractive urban environment water is also required for such uses as irrigating sporting and recreation areas, and maintaining gardens and private swimming pools.

As demands for water rise, the financial and environmental costs of providing a city water supply increase. In the future, the community will need to address the broad issues of whether water use can continue to increase as at present, and the price that users are prepared to pay for different uses of water. In the meantime, planning for new sources of water must proceed to enable the Water Authority to continue to provide a satisfactory public water supply.

Due to engineering advances in desalination, there is no technical limit to the quantity of water available to a city like Perth which has access to the ocean. However, production of drinking water from sea water is at present a very expensive water resource option.

Water resources which can provide water supplies at less cost than desalination of seawater are limited. The cheapest sources close to the city are subject to most pressure for use by competing demands such as development for public and private water supplies and irrigation schemes, and recreation. At the same time there is increasing recognition of the importance of water resources for maintaining the quality of the natural environment.

The Water Authority has the responsibility for managing the water resources of Western Australia in the best interests of the community and for providing satisfactory public water supplies. To ensure that sufficient sources of water are available for Perth's public water supply in the future, the Water Authority has prepared a Source Development Plan (SDP). The SDP is a long-term plan to meet future water demands by developing sources which are most cost-effective within known environmental and social constraints. The sequence of development of these sources (Source Development Timetable) is designed to give the lowest cost long-term programme, allowing for some technical constraints on the timing of certain sources.

The Source Development Plan is the basis for current planning of future water sources for Perth's public supply. However, all aspects should still be regarded as flexible. The proposals or timing can be modified, if required, to satisfy other environmental or social priorities for use of the water

resources if these are indicated by public or environmental review of the plan, or if warranted by the continuing technical studies conducted by the Water Authority.

The purpose of this report is to present the current Source Development Plan to the public. The report discusses the planning process, demands which must be satisfied by the Metropolitan Water Supply Scheme (MWS), the available water resources, the alternatives for developing public supplies, the basis for selecting the preferred water supply schemes and development timetables in the SDP.

Comments are invited which will enable the Water Authority to assess the community's view of the SDP, so that immediate decisions and long-term plans for developing Perth's future water supply will reflect, as far as possible, the community's expectations and values.

2. THE PLANNING PROCESS

OBJECTIVES

A primary objective of the Water Authority is to provide water services at minimum long-term cost and to an acceptable community standard.

Another primary objective which relates to comprehensive water management is to assess, plan and manage the use and conservation of the State's water resources for the continuing benefit of the community (having regard to all uses of water).

Planning for Perth's future water supply must serve each of these objectives. However, the process of planning to satisfy public demands for water supply within the wider context of comprehensive water resources management is becoming increasingly complex. The most economic sources available for future expansion of Perth's water services are individually small when compared to the rate of growth in demand. Planning must provide for developing a steady succession of such sources whilst simultaneously satisfying widening community interest in environmental management and allocation of water resources.

PLANNING PROCEDURES

Planning procedures for Perth's water supply are not fixed but are progressively reviewed and adapted with the aim of improving their effectiveness within a changing planning environment.

It is a tiered process, progressing down from the broad-based and long-term guiding frameworks to specific implementation planning.

The flow diagram in Figure 1 is an example for the decisions leading to the construction of new major metropolitan sources. It highlights the formal involvement of the Environmental Protection Authority (EPA) in such decisions, but it should be noted that there is a strong interaction between the Water Authority and all government agencies which have responsibilities for planning or managing land use in areas where the Water Authority has developed proposals. This interaction is carried on in all phases of planning, with the objective of maintaining awareness of constraints which may apply to each others planning proposals due to the activities or proposals of the Water Authority and other agencies. The agencies most commonly involved are the State Planning Commission, the Department of Conservation and Land Management, and the Department of Conservation and Environment.

STRATEGIC PLANNING

Strategic planning involves research and development of long-term framework plans or policies for the allocation, conservation and management of water resources on a regional or State-wide basis. Long-term strategies are developed for meeting specific regional water needs.

This planning is non-statutory and presents a guiding framework to:

- . project demands and issues in a long-term regional context;
- . provide an orderly basis for timing the work of planning specific projects, and developing such plans in a regional context;
- . identify specific planning priorities;
- . contribute to specific decisions on water resource allocation;
- . use in specific planning for water resource conservation and pollution control;
- . assist other planning authorities which need to give consideration to water resource matters.

A comprehensive approach to water resource planning has evolved during the past 12 years, as a result of planning studies initiated and carried out by the former Metropolitan Water Board and Public Works Department, notably the South West Regional Planning Study (Sadler and Field, 1976), the Source Development Plans for the Metropolitan system (Caldwell, 1981; MWA, 1975-83; Water Authority, 1986c), development of regional salinity strategies (Sadler and Williams, 1981), the Perth

PLANNING LEVEL
 DECISION MAKING PROCESS
 FOR NEW MAJOR METROPOLITAN SOURCES

STRATEGIC
 PLANNING

WATER RESOURCES
 POLICY
 &
 FRAMEWORK STUDIES

Background studies
 and
 policy guidelines

LONG TERM REGIONAL
 STRATEGIES

Source
 Development
 Plan
 (SDP)

ASSESSMENT OF
 ALTERNATIVE
 NEAR TERM
 ACTIONS

Multi-objective
 assessment of
 alternatives
 for next major source (P)

revise proposals if necessary

'Next Major Source'
 ERMP
 Stage 1

Environmental
 assessment
 by EPA
 leading to
 EPA recommendation (P)

Water Authority
 recommendation

Approval in
 principle by
 Government for
 selected source

(P)
 REVIEW
 SDP

IMPLEMENTATION
 PLANNING
 FOR DESIGN &
 MANAGEMENT
 OF
 SELECTED ACTION

Detailed design
 and management
 planning
 for selected source (P)

revise proposals if necessary

'Next Major Source'
 ERMP
 Stage 2

Environmental
 assessment
 by EPA
 leading to
 EPA recommendation (P)

Water Authority
 recommendation

Approval
 by
 Government

Implement
 water supply
 development and
 management

(P) Public participation
 included at these points

Fig 1. The planning and decision-making processes.

Urban Water Balance Study (Cargeeg et al, #1987), the Domestic Water Use Study (MWA, 1985) and various research projects concerning the management of surface catchments, recharge of groundwater resources, re-use of treated sewerage effluent and desalination of brackish waters.

More recent initiatives introduced by the Western Australian Water Resources Council with the support of the Water Authority (which have their origins in the earlier studies), include the Perth/Bunbury Regional Planning Study and the #Water Conservation Plan 1987/89 (Water Authority, 1987).

The Perth/Bunbury Regional Planning Study is investigating water demands, issues, allocation options and development/management options on a multi-purpose basis for the region. As this study progresses, it will provide information and broad value assessments to help guide lower levels of planning in the region and to guide other planning agencies. The regional information base for water planning is currently somewhat fragmentary and is strongest in relation to public water supply and public irrigation. Some early initiatives in this study therefore have been directed towards recreational, environmental and private horticultural use.

The #Water Conservation Plan outlines programmes for encouraging more efficient use of water as a means of reducing pressures on the environment and capital costs. #

The development of the Metropolitan Source Development Plan (SDP), has been the most significant specific-purpose strategic planning initiative in the region. It was first produced by the Metropolitan Water Board in 1975 and is continuing to be updated and employed in the planning processes of the Water Authority. The SDP can be viewed as a considered bid for water resource allocation on behalf of present and future members of the community requiring a public water supply. This bid provides a realistic basis for projecting long-term water planning priorities and issues and presents the most favourable supply options for further, more detailed, assessment and implementation planning.

PROJECT PLANNING

Project planning involves the preparation of specific purpose plans to deal with short-term demands or issues.

The demand projections of the SDP indicate the years at which new source developments will need to be commissioned and the plan indicates the most economically favourable source. Project planning commences as the anticipated commissioning date approaches, typically a minimum of 6 to 10 years ahead.

All other potential sources that could realistically meet the same requirements as the most economically favourable source are identified. A broad-based (multi-objective) assessment of these alternatives for the next major source is undertaken to determine the most beneficial source. This evaluation involves environmental and social as well as economic and engineering considerations, and may involve active public participation.

The selected project then proceeds to detailed design, including preparation of implementation and management plans.

ENVIRONMENTAL ASSESSMENT

The environmental assessment process is an integral part of project planning which:

- . provides environmental input to the multi-objective evaluation and detailed design phases;
- . involves documentation of the project planning process to facilitate EPA and public review of the project;
- . provides a procedure for seeking formal environmental approval.

Before any scheme for development of a source for public water supply can be constructed, the proposal must be submitted to the EPA for review of its environmental impacts and environmental management plans. At the commencement of project planning, the Water Authority advises the EPA of its proposals by submitting a Notice of Intent. The EPA may then approve the environmental aspects of the proposal if they are obviously minor, or may request a higher level of assessment through a Public Environmental Report (PER) or an Environmental Review and Management Program (ERMP).

For larger projects requiring an ERMP, a two-stage approach is favoured. Stage 1 documents the multi-objective evaluation process and seeks environmental approval in principle for the selected source. Stage 2 documents the final project design, detailed environmental investigations and proposed management measures and seeks environmental approval to allow the project to proceed to implementation. The EPA seeks public comments on the ERMPs and provides advice to Government, based on assessment of each report and of the public submissions.

3. THE DEMAND FOR WATER

WATER USERS

The principal demand for water from the MWS comes from users within the Perth metropolitan area. The MWS has expanded to meet the water needs of Perth's increasing population and the needs of nearby towns which have come within a distance that makes connection desirable. Map 1 shows the areas currently served by the MWS and generally how water is distributed from source works to the area of demand. The water is mainly used for domestic supplies and industrial and commercial applications.

The MWS has also been used to improve the security of supply to the Goldfields and Agricultural Water Supply Scheme (G&AWS). The water for the G&AWS can only be drawn from the Helena Reservoir, but the demand is now slightly in excess of the yield that can be relied upon (safe yield) from the Helena Reservoir operating by itself. Pipelines have been installed to transfer water to Helena Reservoir from other MWS sources to maintain security of supply.


DEMAND HISTORY

Water use from the MWS increased through the 1960s and early 1970s (Figure 2) and the rate of increase was considerably in excess of the growth rate of the population served, i.e. water used per person was increasing.

Rainfall in 1975 and 1976 was well below average and it became evident that restrictions on water use would be required if trends in the demand continued and there were more dry years. A public education campaign was mounted in the summer of 1976/77 and water use for that year was 10% less than in the previous year. The drought continued and restrictions on the use of garden sprinklers were needed for nearly two years. The construction of additional groundwater schemes and the Wungong Dam allowed restrictions to be lifted in May 1979. There have been no general restrictions on water use since that time, although in 1987/88 restrictions were averted only through the success of publicity campaign.

#An unexpected effect following the lifting of restrictions in 1979 was that water use in the following years did not immediately return to the pre-restriction levels. It is likely that further restrictions would have been necessary if it had done so.

A Domestic Water Use Study (MWA, 1985), conducted over 12 months in 1981/82, found that there was about a 50% increase in the number of private wells in the metropolitan area during the restriction period from 1977 to 1979. As most private wells are used for garden irrigation, the effect of a well on demand for water from the MWS is similar to water restrictions in that

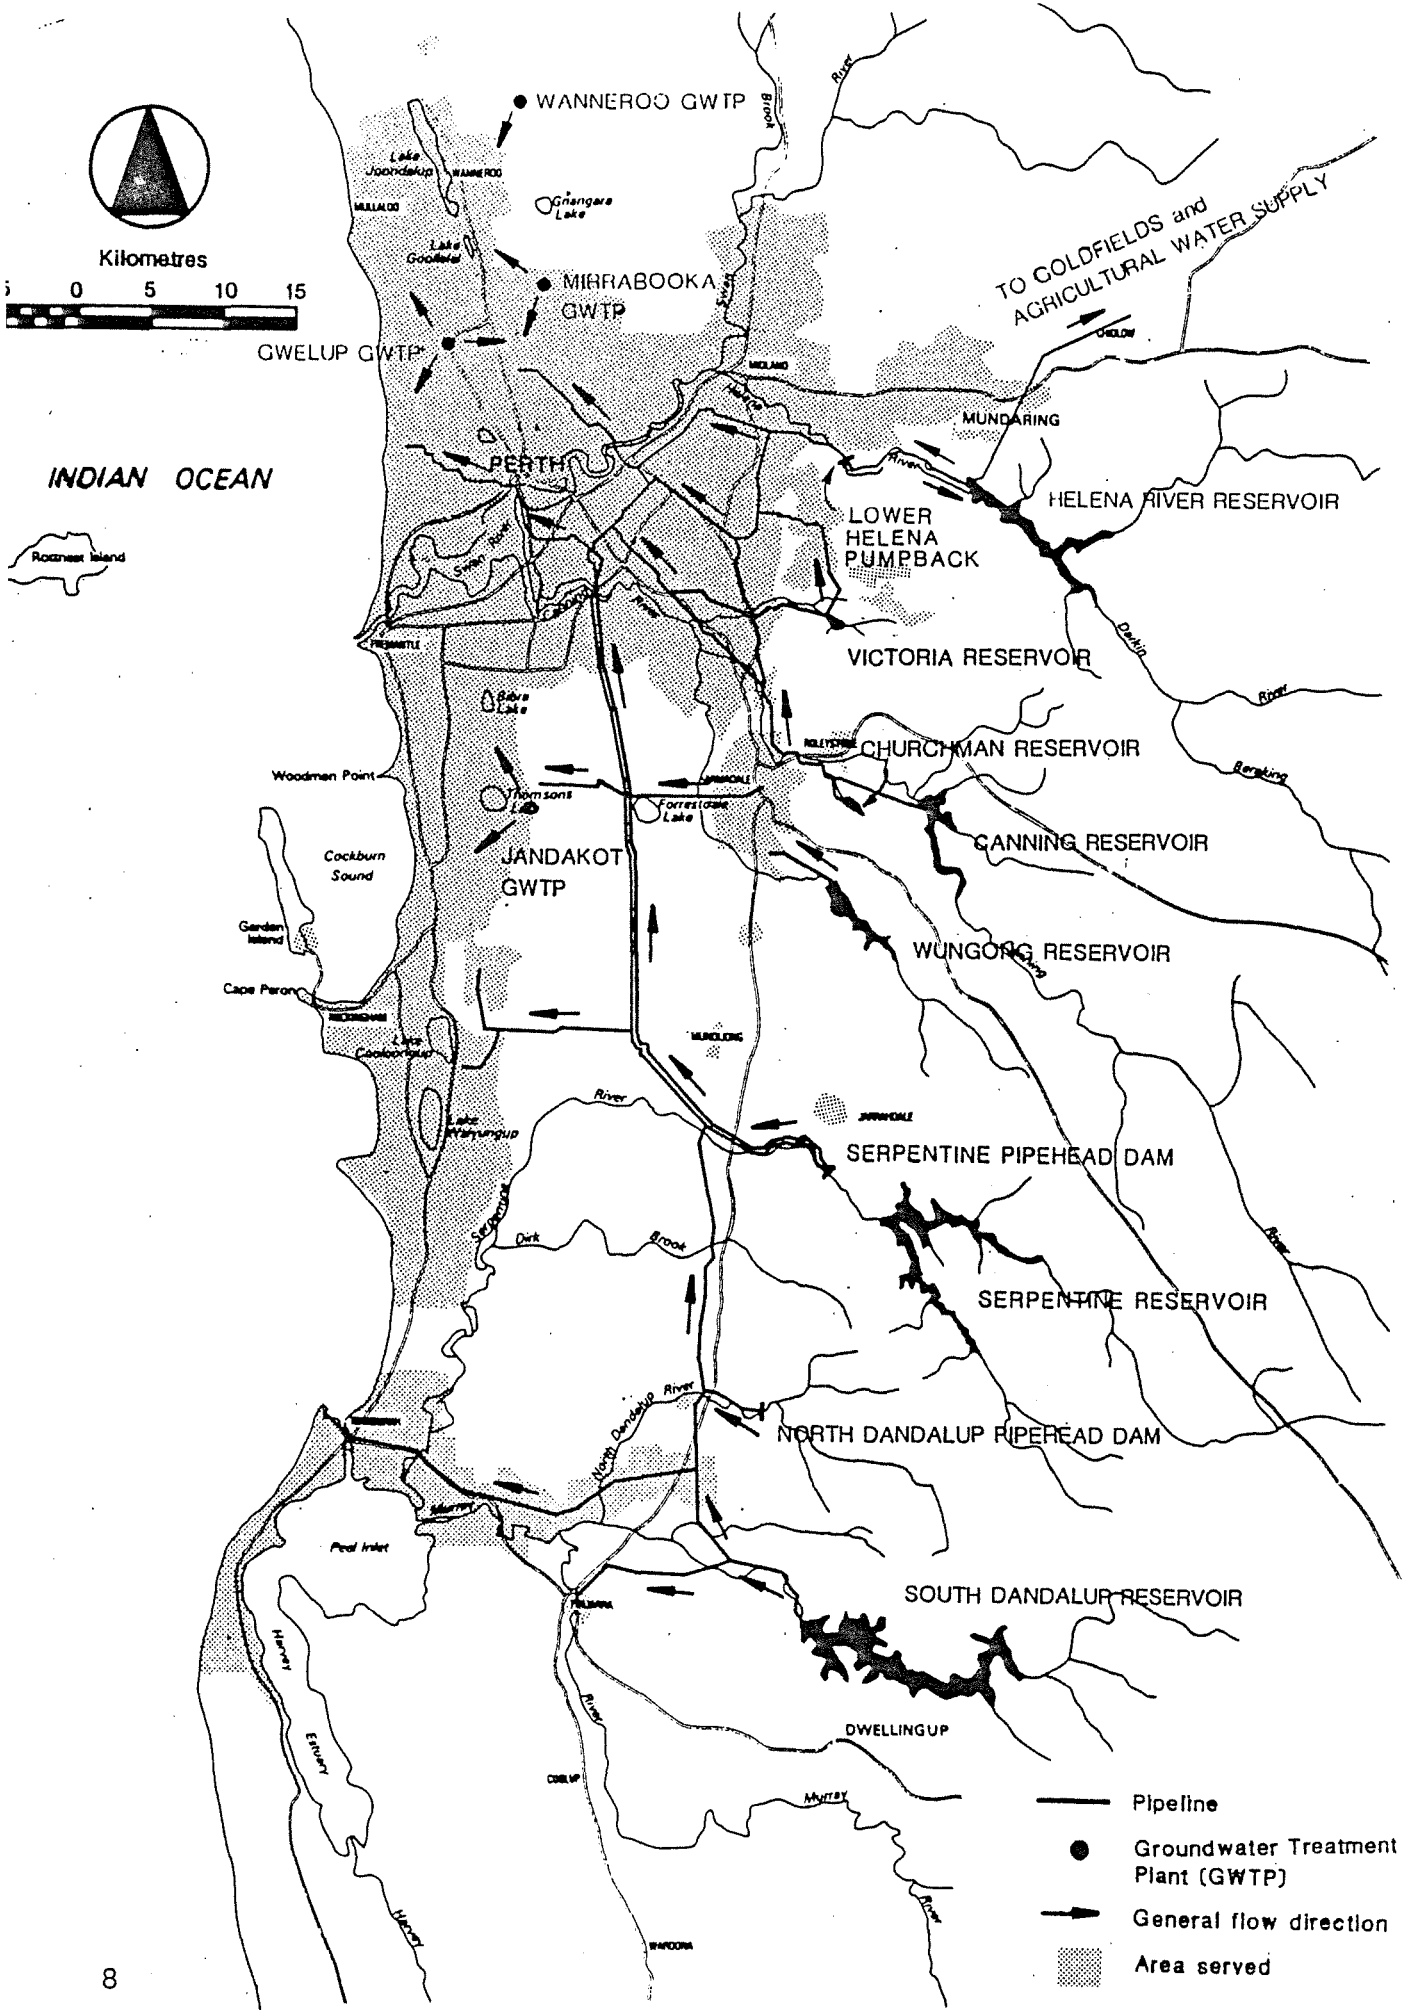

- Pipeline
- Groundwater Treatment Plant (GWTP)
- General flow direction
- ▨ Area served

Map 1 Existing MWS Sources, Distribution and Areas Served

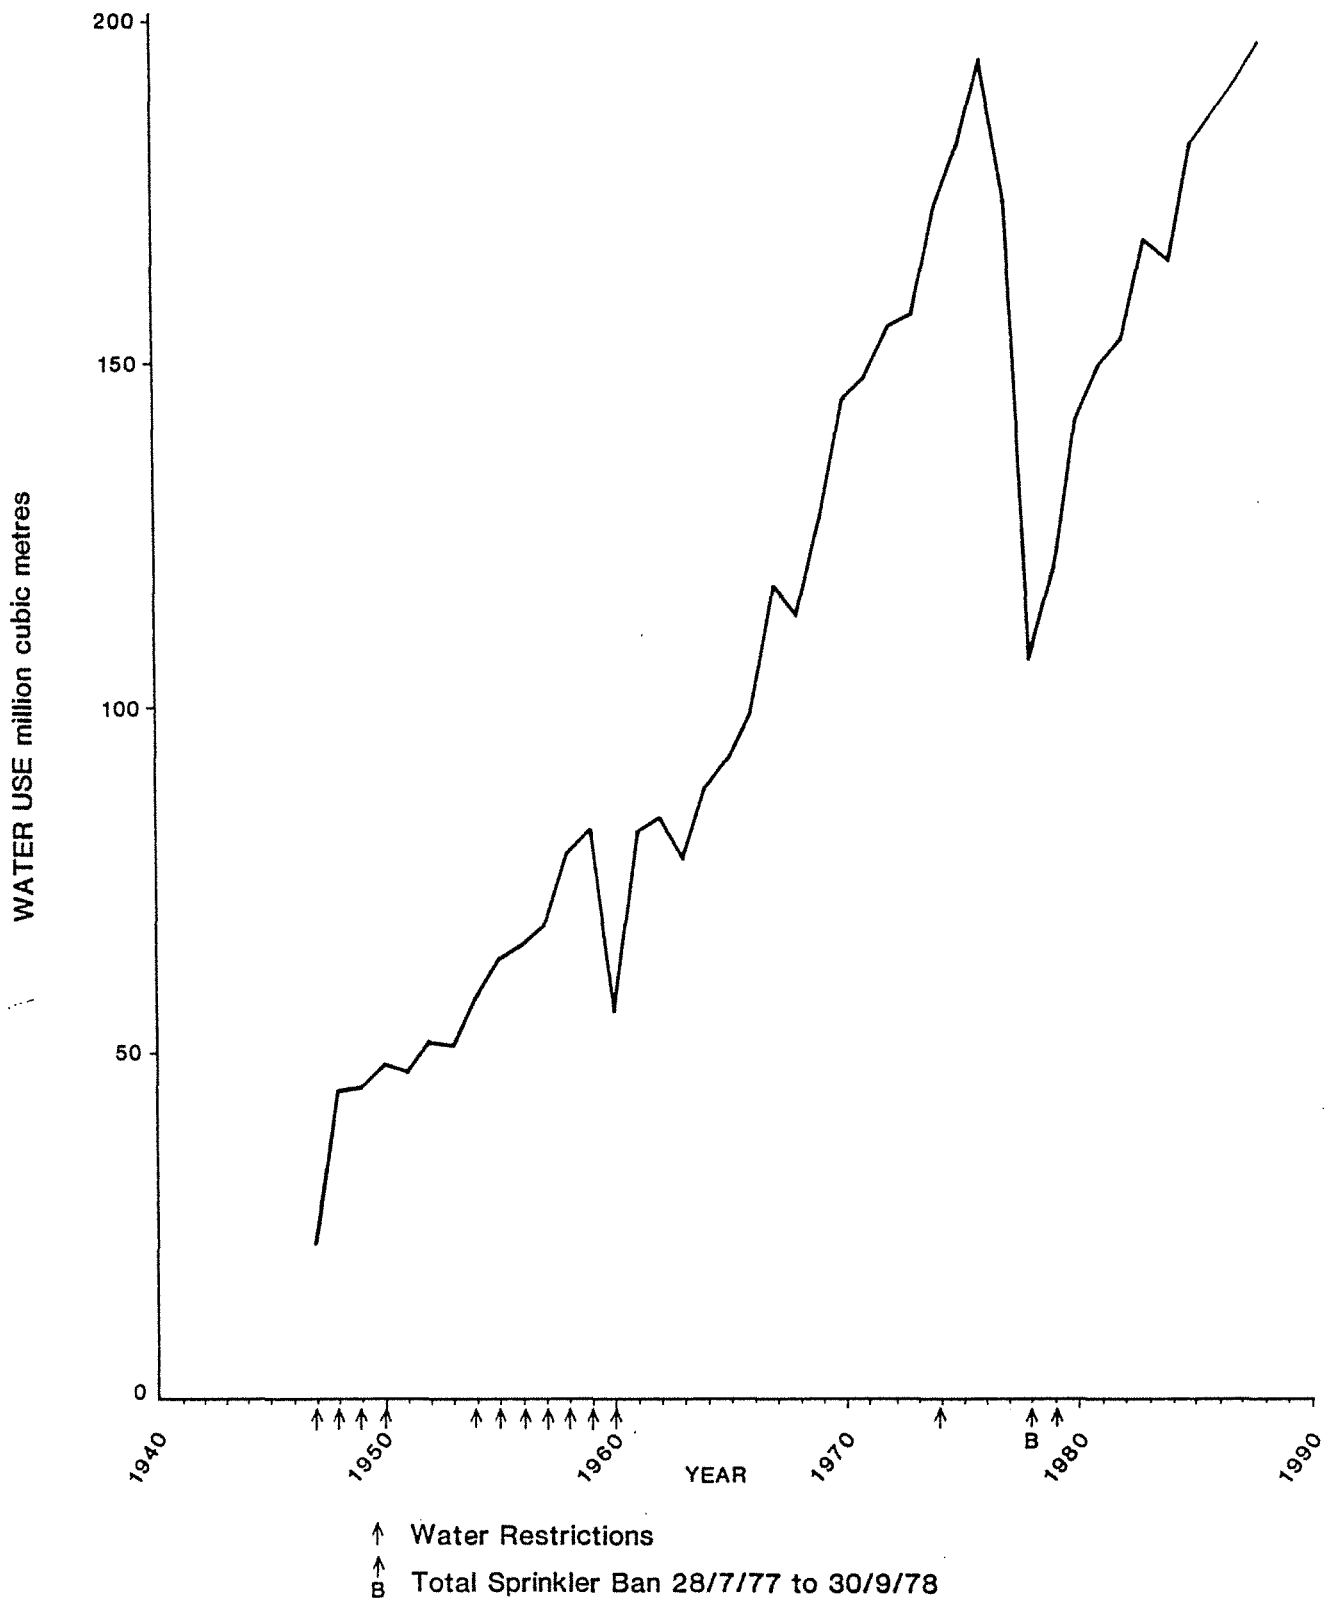


Figure 2 Annual Water Use from Perth's Public Water Supply

it reduces use of MWS water by single residences. The difference is that the effect of a well is permanent.

The total amount of water drawn from private wells in the metropolitan area can only be approximately estimated because most wells are not metered and records of the number of wells installed are incomplete. However, on the basis of estimated well water usage, it would appear that overall water use per person (from the MWS and private wells) returned to pre-restriction levels #two years after restrictions were lifted (Figure 3) but with a reduced demand per person on the MWS.



There are other factors which are likely to have reduced demand since 1979 from what it would otherwise have been:

- a continuation by individuals of water conservation habits acquired during the restriction period. e.g. maintenance of native gardens;
- introduction in 1978 of 'pay-for-use' for services to residences, which included setting the basic water allowance at 150 kilolitres per service, instead of basing it on the rateable value of the land (a reduction in free allowance for most services);
- increases in the charge per cubic metre for excess water use by residences (the Domestic Water Use Study estimated that a 10% rise in the cost per cubic metre would result in a 3% reduction in use of water outside the house);
- introduction in 1982 of a new tariff policy for industrial and commercial users, including gradual achievement of 100% metering and a 'pay-for-use' scheme.

PREDICTING FUTURE DEMANDS FOR WATER

The Water Authority needs to estimate future demands on the MWS so that sufficient supply capacity will always be available. Scheduling of construction works for new sources is based on a short-term projection of demand which is basically an extrapolation for the next five years of recent trends in water use. Determining priorities for development of potential water sources and identifying the next source to be developed require a longer view into the future.

The current curves of projected water use for the next 25 years are shown in Figure 4. These projections are based on many assumptions (Appendix C). However, the principal factor is the population projection produced by the Treasury (W.A. Treasury, #1986) and the State Planning Commission (SPC, 1987). The influence of these assumptions on the demand projection is shown by using extreme assumption values which lead to higher demands (a 'maximum' projection) and to lower demands (a 'minimum' projection).

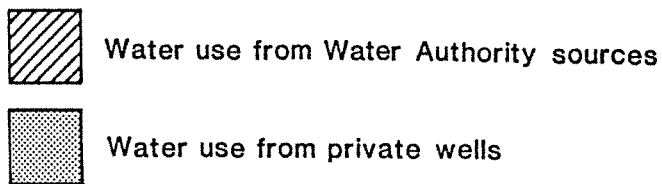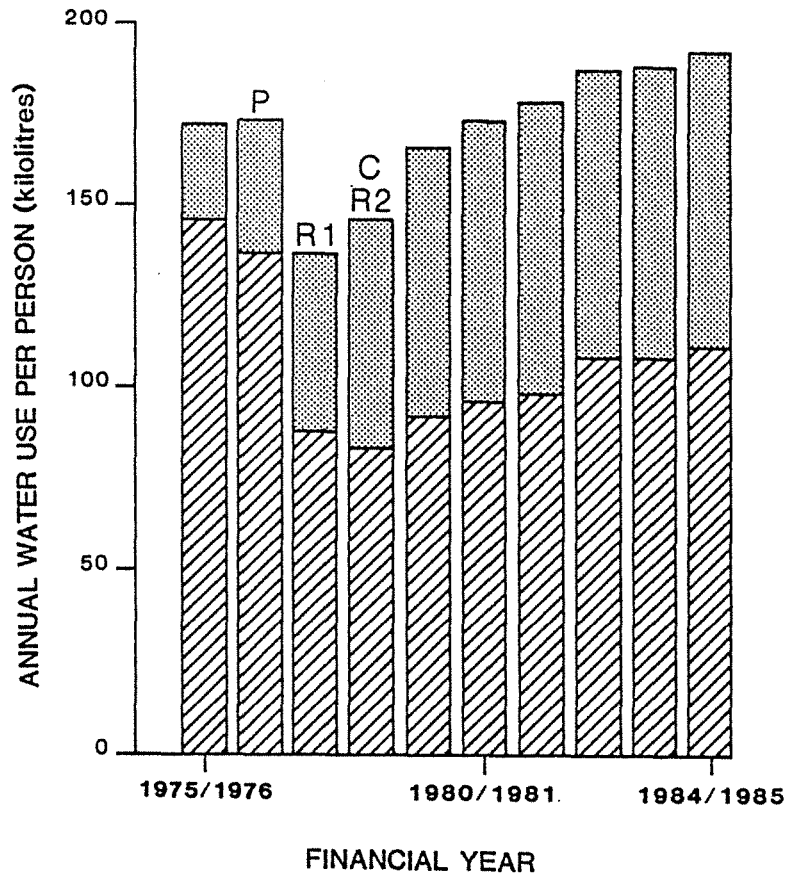

- P = Promotion campaign urging water conservation
- R1 = Total sprinkler ban 28/7/77 to 30/9/78
- R2 = Sprinklers only 6am to 7am and 6pm to 9pm
Alternate days 1/10/78 to 20/12/78
Sprinklers only 6pm to 7pm from 21/12/78 to 21/5/79
- C = Pay for use introduced on 1/7/78

Figure 3 Annual Domestic Consumption per Person, Perth Metropolitan Area

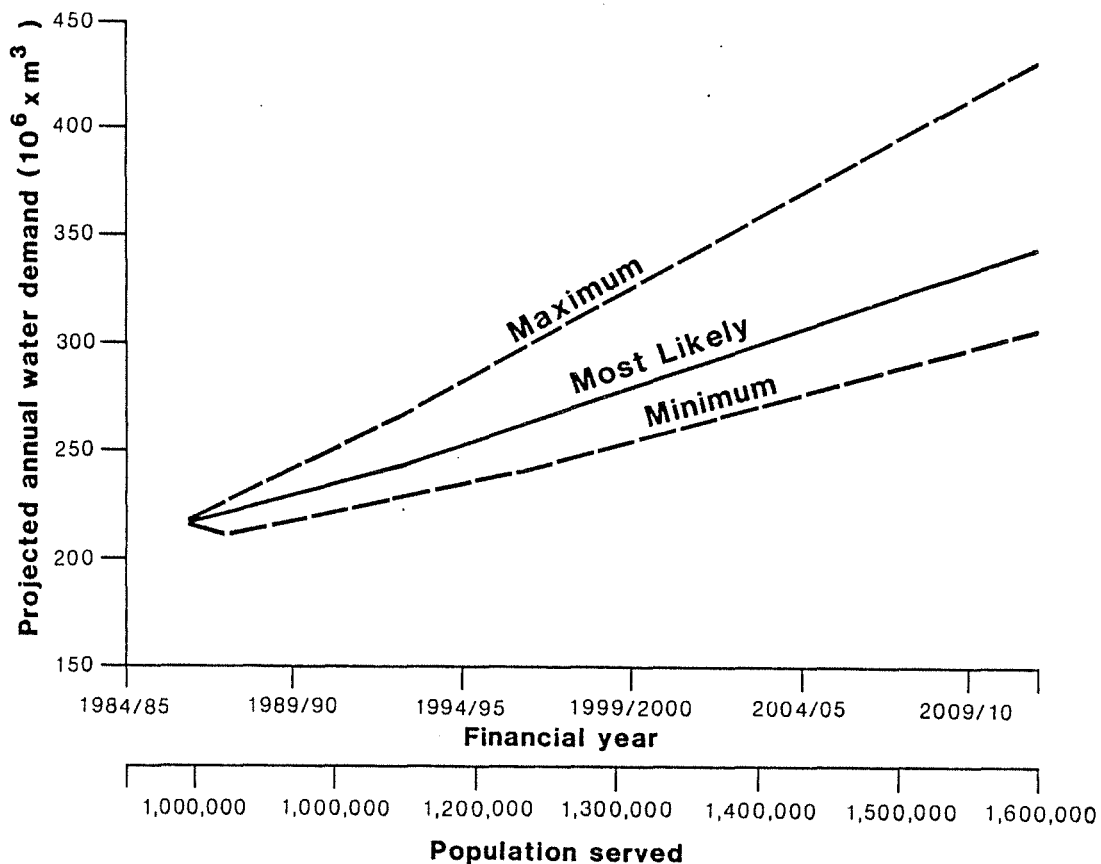


Figure 4 Projected Annual Demand for Public Water Supply for the Perth Metropolitan Area

#WATER CONSERVATION

The Water Authority is formulating a #water conservation strategy as part of its programme for managing water resources efficiently. #Water Conservation is a programme which is adopted to achieve effective management of the use of water resources in order to meet the general objectives of economic effectiveness, environmental conservation and community and consumer satisfaction (AWRC and WAWRC, 1986#).

Generally #water conservation involves working towards these objectives by implementing strategies in the following areas:

- Education: e.g. information can be broadcast to teach people how to water their lawns efficiently.
- Design: Dual-flush toilets are an example of a design change which can result in significant savings of water.
- Regulation: Restrictions are one example of 'regulation', and another example is that certain plumbing fixtures or appliances that are attached to the public water supply must conform to design standards specified by the Water Authority.

Pricing: People tend to be more careful in using water when they know that the more they use, the more they pay.

The Western Australian Water Resources Council has published a book which presents practical ideas to help planners, landscape architects, architects, engineers and cost managers to incorporate water conservation in their designs for urban areas in Western Australia (W.A.W.R.C., 1986).

#Water Conservation reduces overall water use, #but costs can also #be reduced by shifting some water use away from the time of peak demand. For example, pipes and pumps must be large enough to satisfy peak demands. They need not to be so large if enough demand can be moved to other periods of the day. Strategies to achieve such management of demand are considered within the activities of water conservation.

#The Water Authority has established a policy on Urban Water Conservation and has prepared a Water Conservation Plan (Water Authority, 1987) to guide the implementation of the policy in the immediate future. The initial actions are mainly aimed at increasing public awareness and improving public education on the principles of water conservation. For the Perth Metropolitan area a target has been set that consumption per person will be held to 190 kilolitres per year by 1991/92, where the total consumption includes all uses. This target approximates the usage of 1986/87 and to be met will require that current trends of increasing consumption per person will need to be halted. The 'most likely' demand projection assumes that the target will be achieved.

WATER RESTRICTIONS

General water restrictions are a form of #water conservation which are already effective in keeping down the cost of the water supply system. #If restrictions were allowed only as an emergency action in an extreme drought, the maximum demand which could be sustained by the existing system would be about #12% less and new sources would need to be built sooner and more frequently.

The current restriction policy allows for some level of general restriction in 10% of years, with the most severe form of restriction occurring in 5% of years. Table 1 shows the three levels of restrictions currently available, and the percentage saving in demand expected in a year in which they are applied.

Table 1 Classes of General Water Restrictions for the MWS

Restriction class	Assumed method of application	Maximum probability of this class or worse	Reduction in annual demand
Class 1	Sprinklers banned 7 am to 8 pm	10%	14%
Class 2	Sprinklers banned except 2 hours/day	7%	29%
Class 3	Total sprinkler ban	5%	46%

During extended periods of low rainfall, restrictions may be needed for two or more consecutive years. In most cases, however, it is expected that restrictions would only be needed for one or two years.

4. WATER RESOURCES

SOURCES OF WATER

The types of water resources currently used by the MWS, and of most interest for development of further supplies in the near future, are river (surface) resources, shallow (unconfined) groundwater and artesian (confined) groundwater.

There are other resources which could be used for water supply. These include surface (stormwater) drainage, wastewater re-use and desalination of seawater or brackish water sources. At present only desalination could provide another practical source of drinking water, although surface drainage and wastewater re-use are increasingly useful for industry, irrigation and maintaining the environment.

Perth faces particular water supply problems because, unlike many Australian cities, there is no single large fresh water source which could supply water needs for many years to come. As the demand for water increases, it will be necessary to continue to develop the relatively small sources which are available.

Cost is a major factor in determining which potential water sources are considered for development for the MWS. Table 2 gives an indication of the cost of producing water from various types of sources with costs of existing sources and the cost of


distributing the water shown also for comparison. Water supplies are currently drawn from groundwater resources within the Perth Metropolitan Area and rivers to the east in the Darling Range. Increasing water requirements will generate pressure to develop water sources further afield. When considering potential resources at greater distance from the centre of demand, the cost of transporting the water to Perth becomes more and more critical in determining the feasibility of a proposal. A distance of 750 kilometres has been estimated as the maximum from which a good source of water (not requiring desalination or other treatment beyond chlorination) could be transported at a cost less than the cost of desalination of seawater. The geographical significance of this distance is shown in Map 2. #The maximum distance to brackish sources which require desalination, or sources which require other treatment, is considerably less). Consequently, sources estimated to cost considerably more than seawater desalination, such as water from the Pilbara or the Kimberley, or icebergs from Antarctica, have not been considered further as potential water sources for Perth. A study being conducted by the WAWRC, called 'Water for the 21st Century' (WAWRC, 1988), is giving consideration to other benefits to Western Australia that may arise if remote sources are used, as well as the costs, but the conclusions have yet to be published.

Some resources which are within 750 kilometres from Perth have not been investigated in detail as sources for Perth's water supply because the water will be needed in their local regions in the foreseeable future, or because they would be more expensive than nearer resources which can meet demands for the next 25 years.

Table 2 Approximate Costs of Water from Various Sources

(Including costs of conveyance to the metropolitan area but excluding distribution costs which amount to #39 cents/kl on average)

	COST (Dec. #'87 Prices) cents/kilolitre
1. Currently developed sources (averages)	
i) Hills sources (pipeheads and dams)	11
ii) Treated groundwater	<u>#22</u>
iii) Artesian groundwater (untreated)	<u>#9</u>
2. Future treated groundwater sources	<u>#17 - 44</u>
#	
3. Future major metropolitan hills sources north of Pinjarra	19 - <u>#40</u>
4. Rivers south of Pinjarra	<u>#46 - 74</u>
5. Desalination of	
i) Brackish surface water (including pre-treatment)	<u>#118</u>
ii) Sea water	<u>#197</u>
6. Water from the Kimberleys	<u>#535</u>
7. Icebergs from Antarctica	very expensive with present technology
8. Solar distillation	not yet proven on a commercial scale

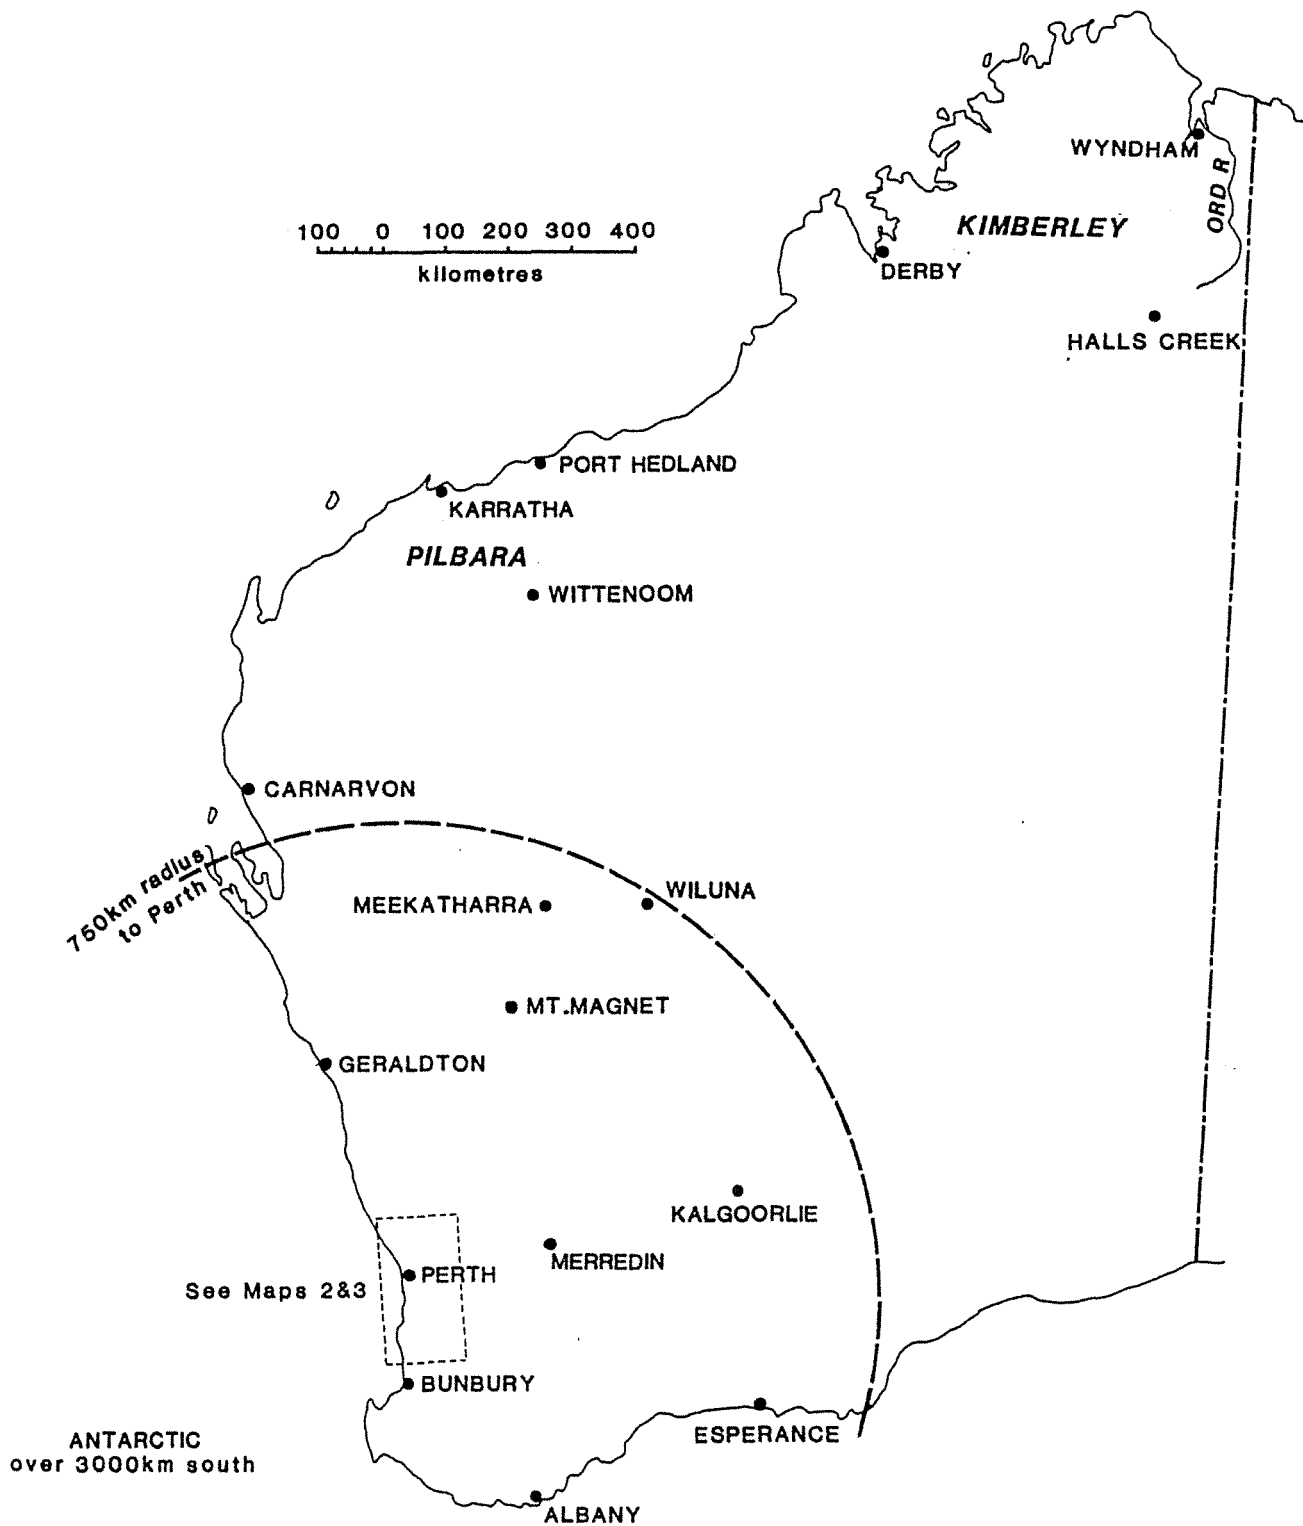

Map 2 Location Map

Showing the geographical significance of the 750km radius from Perth (the estimated maximum distance from which a good source of water could be transported at a cost less than desalination of sea water)

The following sections discuss resources which currently supply water to the MWS and those which are being given more detailed consideration as future sources. The location of the resources is shown in Map 3 and information on schemes to develop them is given in Map 4, Chapter 7 and Appendix A.



RIVER (SURFACE) RESOURCES

River sources currently supply about 70% of Perth's water. At present, the only treatment required before supplying the water to consumers is disinfection by chlorination.

The catchments of rivers currently supplying the MWS are all east of the Darling Scarp between Mundaring in the north and Dwellingup in the south. The catchments are almost totally covered by native forest, with small areas of pine plantations, orchards and pastoral land. The main commercial activities in the forest are timber production and bauxite mining, although there are many smaller industries which make use of the forest resources. The forest is also renowned for its conservation and recreation values. The rivers are currently generally fresh, but permanent clearing of forest in the drier parts of the catchment would certainly increase salinity.

Several smaller catchments along the western edge of the developed catchments have potential as river resources because they are in relatively high rainfall areas and can be harnessed quite cheaply by pipehead or pumpback schemes, i.e. without a large reservoir on the stream. (Water supply schemes are described in Chapter 5). Some of these catchments contain orchards which make a significant contribution to the State's agricultural production. The areas are also becoming attractive for special rural (smallholding) subdivision and development due to their proximity to Perth. However, these catchments are still mostly forested, with enclaves of privately-owned rural land. Salinity is not a problem here because if any salt is flushed from the soil after clearing, it is diluted by the increased streamflow caused by clearing. Generally, river water from catchments containing significant areas of agricultural or residential land is not of sufficiently good quality to allow direct supply to consumers after disinfection alone. Schemes for developing such rivers must provide for extra treatment, storage or selective use by taking water only when the quality is satisfactory.

To the south of Dwellingup lies the Murray River catchment. The eastern portion of this catchment has been cleared for agriculture and the river flows are now brackish. The western portion of the catchment is still forested and streamflows from tributaries in this area are fresh or only slightly brackish. Although identified as a potential future water resource, through declaration of a Water Reserve over the area, the western area has gained a reputation for wilderness recreation, especially along the main river valley. Areas suitable for conservation reserves have also been located nearby, and the recently declared Lane-Poole Reserve encompasses the area of

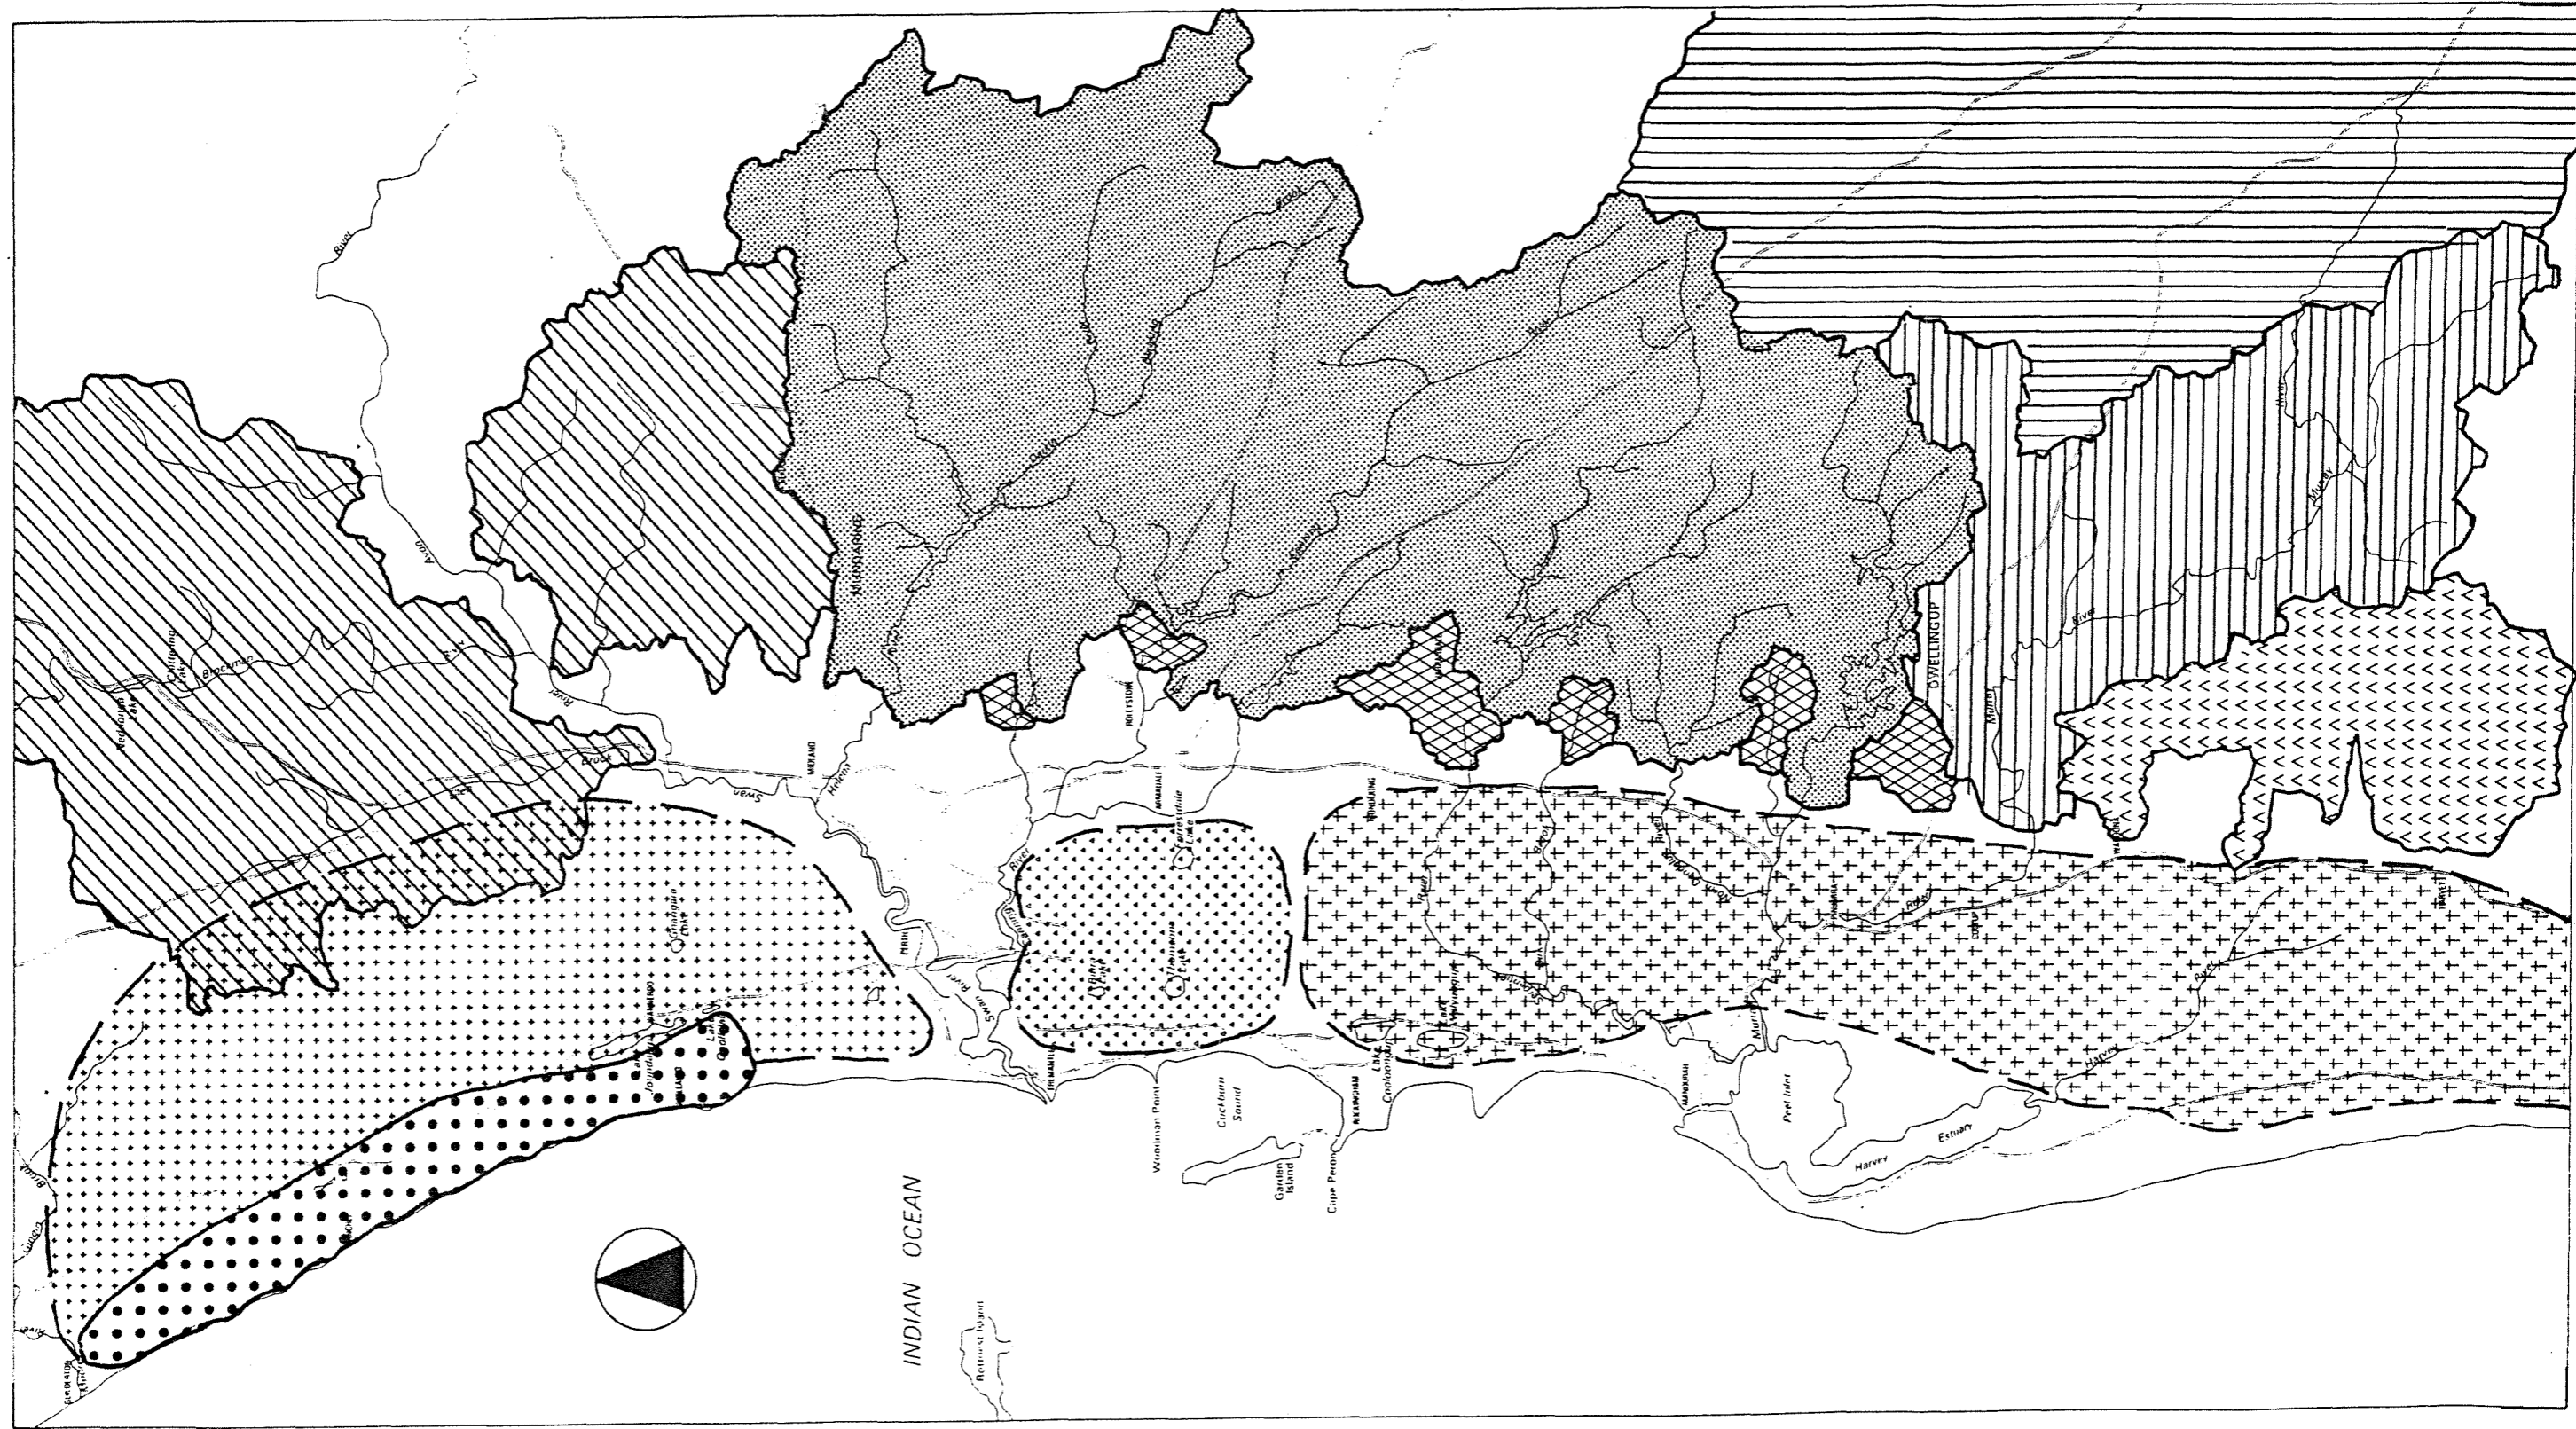

- LEGEND**
- Swan Avon Tributaries: [diagonal hatching]
 - Existing M.W.S. catchments: [grid pattern]
 - High rainfall scarp catchments: [diamond/cross-hatch pattern]
 - Murray catchment west (fresh): [horizontal hatching]
 - Murray catchment east (brackish): [vertical hatching]
 - S.W. towns and irrigator supply catchments: [small 'A' pattern]
 - Gangara Mound shallow groundwater: [small square pattern]
 - Jandakot Mound shallow groundwater: [small circle pattern]
 - Other areas of shallow groundwater: [small cross pattern]
 - Coastal strip Outfall of Cranpara Mound Shallow groundwater: [small dot pattern]

Map 3 Water Resources near Perth (excluding Artesian Water)

conservation and recreation priority. There is no provision made for water supply development in the vesting of the Lane-Poole Reserve.

South-west of the Murray catchment are more forested catchments which have been dammed to provide supplies of irrigation water to farmers in the Harvey-Waroona Irrigation district, and for local supplies to towns. Of these catchments, the Harvey River has been identified as having the potential for greater utilisation for Perth's water supply #if the Harvey River Dam was increased in size, without detriment to existing uses of the resource.

To the north of Mundaring are catchments of tributaries of the Swan and Avon Rivers. These catchments are predominantly privately-owned rural land which has been substantially cleared, leaving remnants of native forest. An exception is the Julimar State Forest and adjoining Bindoon Army Training Ground. These forest areas occupy a large proportion of the Brockman and Julimar River catchments. All the catchments are affected by increases in stream salinity due to the agricultural clearing. The Brockman and Wooroloo Rivers are brackish and would require desalination to provide potable water supplies. The other rivers have salinities near the upper limit of 'fresh'; the water could be used for water supply after normal treatment if mixed with fresher water. The water from these catchments also requires more treatment for water supply than simply disinfection due to the high level of human activity.

Land use in river catchments has a strong influence on the quantity and quality of the water, and the availability of sites for the development of the resource for public water supply. Reduction of water quality, for example by pollution or increasing salinity levels, and constraints on development sites for dams and other works lead to increased costs of water from the source and consequently higher costs of water to the metropolitan consumer. In its role of conserving and managing the State's water resources, the Water Authority must be aware of plans or land use changes in catchments, to protect both the quality of the existing water supply and of the water resources which have potential as future sources. The potential impacts of land use on river resources are summarized in Tables B2 and B4 in Appendix B.

SHALLOW GROUNDWATER RESOURCES

Shallow (unconfined) groundwater is found if a hole is dug to below the water-table in the sand which forms the surface layer over large areas of the coastal plain north and south of the Swan River. The sand can be 20 to 100 metres thick in places. Lakes (e.g. Gnangara Lake, Bibra Lake) occur on the coastal plain where the water-table lies above the natural depressions in the ground surface. Figure 5 illustrates shallow groundwater occurrence and movements.

The source of the groundwater is rainfall which drains through the sand to the water-table. The availability of groundwater is ultimately limited by the amount of rain received. Much of the rain does not reach the water-table because it evaporates from the wet ground, vegetation and ponded water, or is drawn from the soil by plant roots and returned to the atmosphere by transpiration.

There is a slow movement of the groundwater towards the coast and the Swan River because the water-table rises higher above sea level in areas of higher ground and tends to drain to lower areas. Because of the higher water levels under the higher ground, the water-table would have the appearance of a large mound if it could be seen in cross-section over a large area.

In deciding how much shallow groundwater can be drawn from wells for public or private use, consideration must be given to the environmental uses of the groundwater. Pumping reduces the level of the water-table, more so nearer the well and less so further away. Wetlands and lakes which are formed at the water-table may become shallower or dry up if the water-table lowers. If the wetland or lake had significant conservation value which could be damaged if the water was shallower, then pumping in its vicinity may have to be limited or avoided. It has been of particular concern to the EPA when assessing ERMP's for new groundwater schemes, that the environmental values of specific lakes and wetlands are not jeopardised by the projects, and criteria have been set specifying the minimum water levels which must be maintained in some lakes (EPA, 1987).

Shallow groundwater is frequently coloured by peaty deposits, contains iron, is turbid and has an odour. Consequently, schemes to develop these sources for public water supply routinely involve treatment of the water in a treatment plant. Groundwater schemes are described in general in Chapter 5.

There are two significant groundwater mounds near Perth, as shown on Map 3. To the north of the Swan River, the Gnangara Mound rises to about 70 metres above sea level. To the south, the Jandakot Mound rises to about 25 metres above sea level.

Groundwater schemes on both the Gnangara and Jandakot Mounds are supplying about 25% of the water in the MWS, and proposed schemes listed in Chapter 7 could greatly increase the quantity of groundwater presently used for public supply.

Large areas of State Forest on the Gnangara Mound are being progressively cleared of native vegetation to grow pine plantations. An equal area is owned by the Australian Government for defence purposes and is generally covered by native vegetation. Around Wanneroo, and nearer to Perth, market gardening is an important activity, and development of special rural zones and suburban areas is increasing.

The area marked as 'Coastal strip outfall of Gngangara Mound' on Map 3 is gaining greater significance as a water resource since the quantity which can be drawn from the Gngangara Mound further inland is becoming more limited by environmental constraints and by more competition for the resource. Due to limestone character of the aquifer along this part of the coast, fairly large volumes of water can be drawn without affecting inland wetlands or local environmental values (with some notable exceptions as in Yanchep National Park). Town planning indicates that most of the strip is intended to become urban land. Great care must be taken during design of urban development to prevent pollution of the groundwater.

On the Jandakot Mound the land is predominantly privately owned rural land with about a quarter still uncleared. Substantial areas are subject to winter flooding, and drains have been installed in the southern and eastern fringes of the mound. As with the Gngangara Mound, there are some areas of market gardening and special rural land use. Jandakot Airport is located at the northern end of the mound. Proposals to urbanise land east of Thomsons Lake have the potential to increase the water useable for public supply, provided it is recognised during engineering design of the subdivisions that the area will be used as a water supply source, and risks of pollution of groundwater are minimised.

Similar shallow groundwater resources exist north of the Moore River and south of the Serpentine River but these do not have such well developed mounds. Agriculture is an important land use in both regions, and extensive drainage works have been constructed to improve the viability of farming. The Water Authority is progressively investigating these regions to assess their potential as sources for future public water supply.

As with river resources, land use in areas where there is a shallow groundwater resource can significantly affect the water quality and its availability for development for public water supply. Table B6 in Appendix B gives a guide to the potential impacts of land uses on shallow groundwater resources. Groundwater Areas (and similarly Groundwater Reserves, Underground Pollution Control Areas and Public Water Supply Areas) have been declared for specific areas in response to problems arising from competition for the resources and the effects of land uses with potential for pollution. These areas give the Water Authority a basis for effective management and conservation of the shallow groundwater resources. The means for administering these areas include representation of local interests through advisory committees, as well as the application of by-laws and regulations.

ARTESIAN GROUNDWATER RESOURCES

Artesian water is water trapped in sandy material called an aquifer between layers of almost watertight (impermeable) material such as clay, usually at considerable depth below the

ground surface. The water is usually under pressure and when a well is drilled into the aquifer, the water in the well rises and may even flow to the surface.

In most areas around Perth there are two principal artesian aquifers located one beneath the other with an impermeable layer of shale between them. The upper aquifer is generally separated from the surface sands by a clay layer. The occurrence and movements of artesian groundwater are shown in Figure 6.

The total volume of water stored in artesian aquifers below Perth is enormous, but the rate of replenishment from the recharge areas is quite low, with the water taking several hundred years to move from where it fell as rain to an artesian well in Perth.

In the interests of conservation and good management of the resource, the rate at which water is taken from the aquifers should not exceed the rate at which it can be recharged. This means that there will be a limit on the development of the resource. Long term monitoring of pressures in the artesian aquifers will enable assessment of these limits. All artesian wells must be licensed by the Water Authority so that, if necessary, the total quantity being drawn can be controlled.

A recent review of the monitoring data from the deep artesian aquifer suggests that the limit of development for this aquifer may be much less than was previously estimated. The revised limit is 15 million cubic metres per year on average, compared to a current useage of 12 million cubic metres per year and a useage of 37 million cubic metres per year if all previously planned schemes were developed. The reduced limit has been used in this revision of the SDP.

Land use in the immediate vicinity of an artesian well has no impact on the resource, but land use on recharge areas could be significant if it causes persistent pollutants to enter the aquifer. However, if reasonable care is taken of the shallow groundwater in the recharge areas, special precautions should not be necessary.

Generally, the water from the shallower artesian aquifer has a relatively high iron content and needs treatment to make the water quality satisfactory for public water supply. Consequently, wells in this aquifer are usually developed in conjunction with shallow groundwater schemes which also require a treatment plant (see Chapter 5).

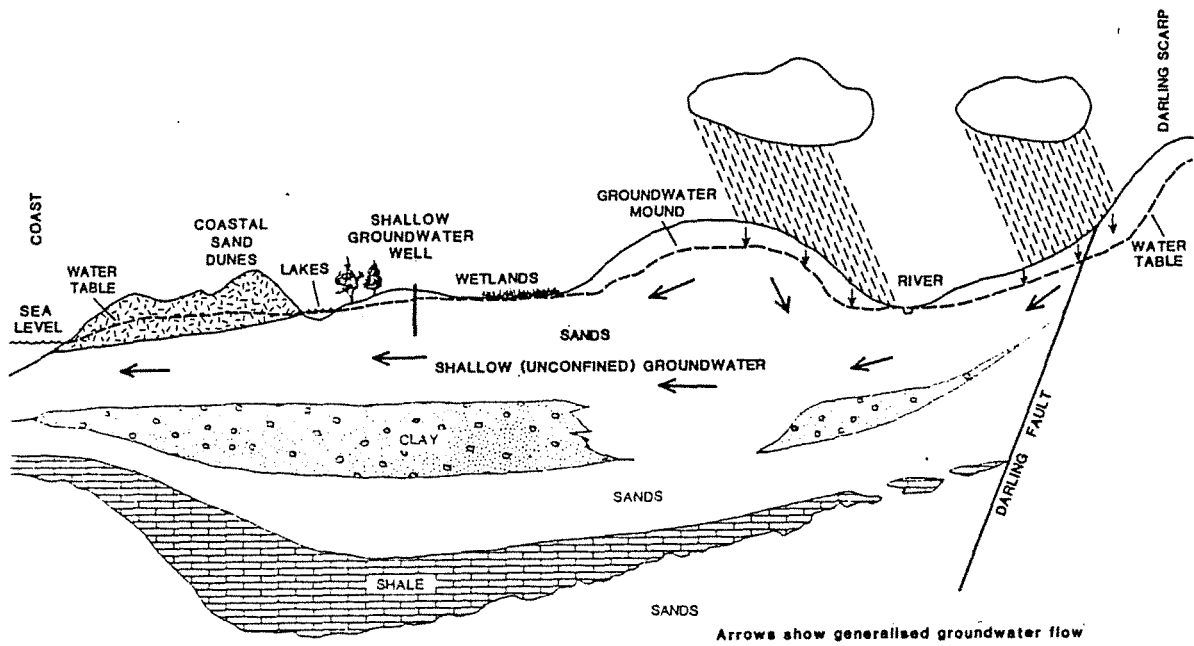


Figure 5 Occurrence and Movement of Shallow Groundwater

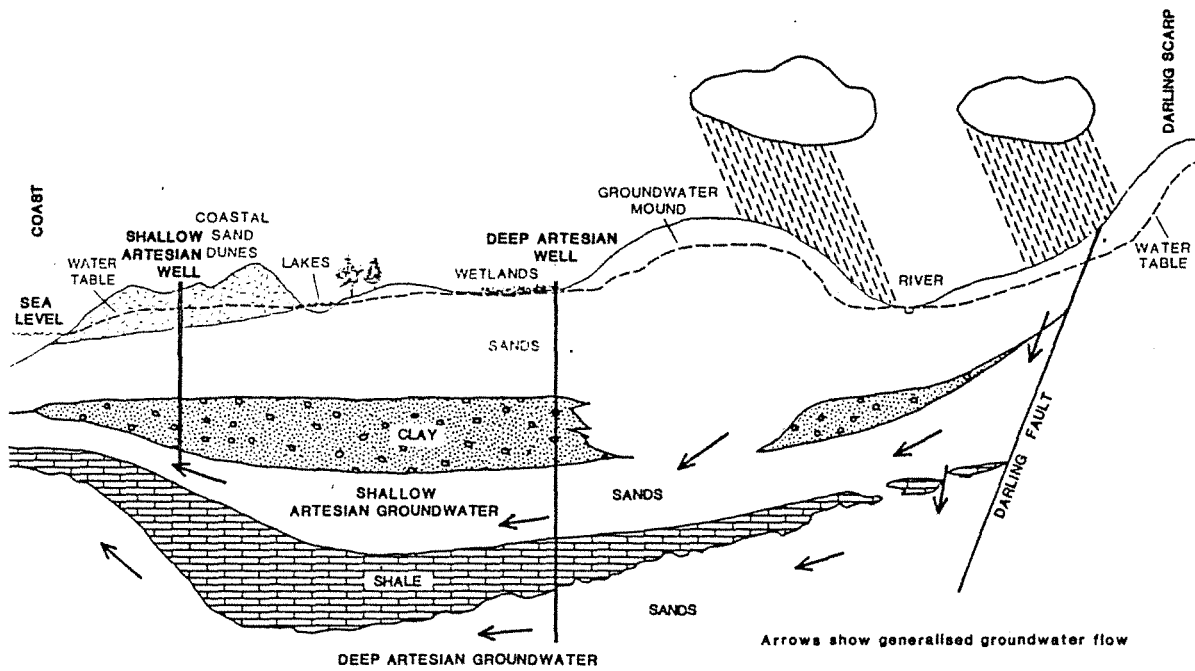


Figure 6 Occurrence and Movement of Artesian Groundwater

Water from the deeper aquifer usually does not need treatment but is quite warm (about 40° C) and may have a salinity too high to be suitable for drinking. Both these problems can be overcome by feeding the water into a service reservoir where it mixes with cooler, lower salinity water from other sources.
#

DESALINATION

Desalination is the treatment process of removing salts from brackish or saline water. It is a common technique for producing potable water when sources of fresh water are insufficient or non-existent. Some of the resources described so far are brackish and would require desalination if they are to be developed for water supply. When the cost of developing fresh water sources at further distances from Perth becomes great enough, desalination of nearby brackish sources will become economically preferable. More brackish sources, particularly groundwater, are likely to be identified near Perth by future investigations, but the total resource will still be fundamentally limited by the quantity of rainfall available annually to replenish the sources, and additional sources will have to be sought from further afield. Eventually, if Perth's population continues to grow, desalination of seawater will be the economically preferred source of additional water.

Because brackish water often needs pretreatment before it is actually desalinated, the plant size is generally similar to a conventional treatment plant of similar capacity, such as a groundwater treatment plant. A particular environmental problem of such plants is disposal of the waste-water in which all the salt has been concentrated by the process.

The size of a seawater desalination plant depends on the size of the demand it is to serve, with the largest plants being comparable in size with a major power station. Economies possible with large plants make them attractive for large demands, as opposed to using many small plants, but environmental impacts at the site of a large plant could be more severe than for smaller plants. However, if there is a power station planned for a suitable location, there would be very little additional environmental impact in incorporating a desalination process.

The greatest disadvantage of desalination is the cost, which includes the requirement for an abundant source of energy. Costs per cubic metre for seawater desalination would be approximately five times the current charges for water, and power requirements would be approximately 10 kilowatt hours (units) per cubic metre. Costs of desalination of brackish water are generally about half those of seawater desalination and energy requirements are less, depending on how saline the water source is.

RE-USE OF WASTEWATER

There is no immediate prospect that treated sewerage effluent could be economically purified sufficiently to allow its re-use in the public water supply system.

Treated wastewater is used in many Western Australian country towns for irrigating sports fields, providing facilities for the community and effectively contributing to the public supply by reducing the demand for irrigation water. Re-use of wastewater is subject to Health Department regulations and care must be taken that the 'second class' supply cannot be inadvertently used for drinking water.

In the metropolitan area, however, sports fields are usually irrigated with groundwater. Until positive plans are made for re-use of wastewater in a way which reduces existing or projected demand on the MWS, no allowance will be made for it in demand projections.

Another possible use for wastewater is groundwater recharge. This requires considerable technical investigation and environmental review and is more expensive at present than alternative sources. An experimental pilot recharge facility has been operating for a number of years to assess the practicality of such recharge, but as yet there is no scheme which has advanced sufficiently to be included in the inventory of water resources for the future.

DEVELOPMENT OF PRIVATE RESOURCES

People who could draw water from the public supply but choose to obtain part of their supply from other sources effectively reduce the demand on the MWS.

Private wells, which are usually installed for irrigation purposes, can be economically attractive and in many cases make use of water not readily accessible to, or of a quality suitable for, public supplies. However, private wells cannot be recommended as a complete substitute for a service from the public water supply because of the health risk associated with drinking untreated water. Efficient private use of groundwater resources can contribute to overall efficiency of water supply, but if many private wells compete for the same resource (for example the shallow groundwater in urban areas) issues of over-exploitation, pressures on wetland areas, or fair allocation of the resource may arise. These issues must be addressed by a management policy.

Currently, about 28% of residential lots in Perth have a private well. Increases in the number of such wells will be limited in the future by the availability of the water resource (Cargeeg et al, 1987). When well water is not available it can be expected that part of the demand will be transferred to the public supply system. Demand projections for this SDP

have considered variations in percentage of well ownership and the absolute limit to the number of wells. In the 'most likely' demand projection, the maximum number of wells would be reached in 2004 if useage per well continues as at present.

Rainwater tanks are often suggested as a means of reducing demand on public supplies. In Perth, however, a house roof can rarely supply a household's complete water requirements, and the cost of the tank makes the water many times more expensive than the public supply. There may also be significant health risks if tanks are used as a source of drinking water without sterilization.

5. WATER SUPPLY SCHEMES

The quantity of water which can be drawn from a water resource depends on the size of the resource, the nature of environmental or social constraints on use of the water, and the mechanics of the works used to withdraw the water. The quality of the water available will also influence the method of developing the resource so that quality criteria (Appendix D) for water delivered to consumers are achieved. If the constraints are known, engineering studies can determine the most efficient way to develop the available resource.

RIVER RESOURCES

MWS schemes for development of river resources for water supply can be generally classified as 'main dams', 'upper dams', 'pipeheads' and 'pumpbacks'.

- . Main dams create a major reservoir in a valley. Water is delivered, after disinfection by chlorination, directly to consumers or to service reservoirs in the city.
- . An upper dam creates a major reservoir on a river upstream of a main dam. Water is released from an upper dam to flow down the river into the main dam in order to maintain desirable water levels in the reservoir of the main dam.
- . A pipehead is a small dam only large enough to allow the water flowing in the river to be diverted into a pipe. The diverted water is supplied to consumers in the same way as water from a main dam.
- . A pumpback uses the same type of small dam on a river to divert the streamflow, but instead of delivering the water for immediate use, the water is pumped through a pipeline into one of the major reservoirs.

These scheme types are shown diagrammatically in Figure 7, and information on size and other characteristics is presented in

Table 3 Characteristics of Schemes for Development of River Sources

	MAIN DAM	UPPER DAM	PIPEHEAD	PUMPBACK
TOLERANCE OF CATCHMENT AREA TO POLLUTING ACTIVITIES	Low	High	Low	High
DAM TYPE	Storage	Storage	Pipehead	Pipehead
DAM HEIGHT	15 - 70 m	30 - 70 m	3 - 10 m	3 - 10 m
RESERVOIR: AREA VOLUME	10 - 200 ha 1 - 200 mill.cu.m	300 - 2000 ha 50 - 200 mill.cu.m	1 - 10 ha 20 - 100 thou.cu.m	1 - 10 ha 20 - 100 thou.cu.m
PIPELINES/TUNNELS AWAY FROM DAMSITE	To consumer	None	To consumer	To storage reservoir
WITHDRAWALS	Supply all year round.	Release water to replenish lower reservoir.	Supply June - November.	Pump to reservoir June - November unless reservoir too full.
DOWNSTREAM FLOWS	Downstream flow only from riparian release or occasional winter overflow.	Flow downstream controlled by release policy, plus occasional winter overflows.	Downstream receives flows in excess of pipe capacity in June - Nov., and total stream flow in other months.	Downstream as for pipehead.

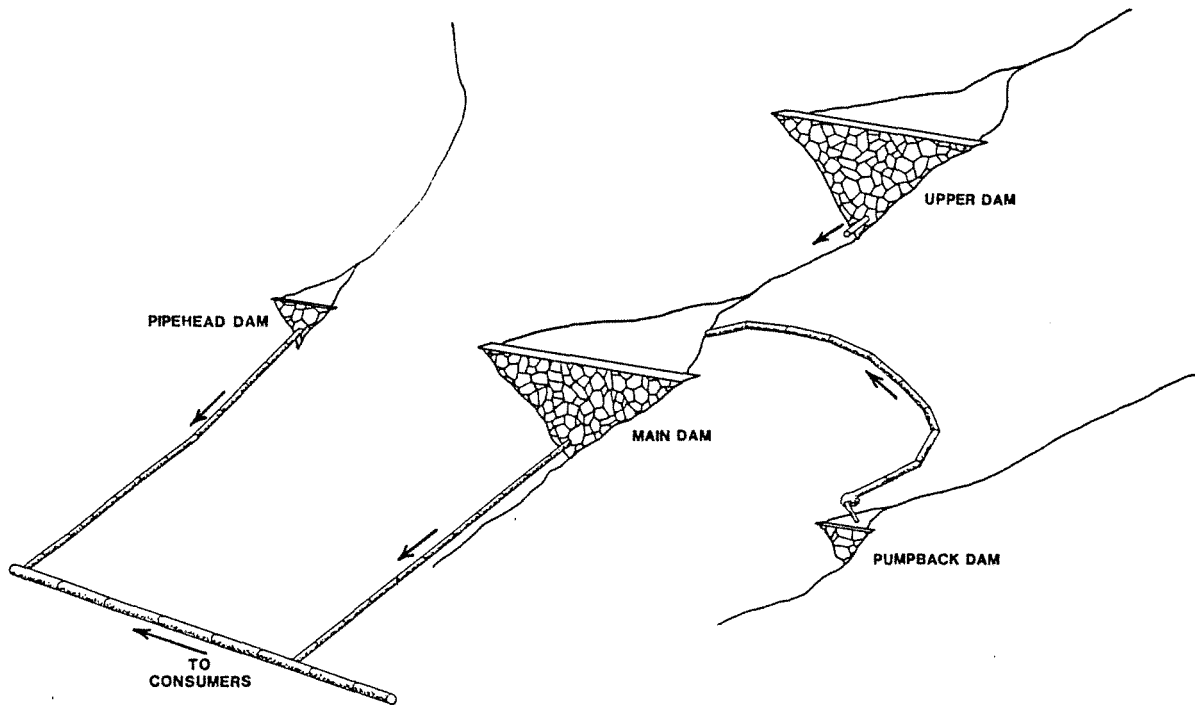


Figure 7 Schematic Description of Types of Development of River Sources

Table 3. Appendix B broadly indicates the effects of river resource development in forest land (Table B3) and in rural and urban land (Table B5).

GROUNDWATER RESOURCES

Shallow groundwater and shallow artesian resources require full treatment of their water to be suitable for public water supply. A 'wellfield' consists of wells which are spaced over the resource and linked by pipelines called 'collector mains'. Pumps on each well send the water through the collector mains to a groundwater treatment plant before it is delivered to service reservoirs.

Deep artesian wells, which only require disinfection, cooling and dilution of their water, may also be installed near service reservoirs without being directly associated with a groundwater treatment plant.

The main components and typical dimensions of groundwater schemes are shown in Figure 8.

The impacts of shallow groundwater schemes on land use are summarized in Table B7 in Appendix B. Artesian wells have very little impact on land uses in their vicinity because they occupy a very small area of land and are not affected by, nor do they affect, nearby surface uses of the land. However, an operating well creates a local area of low pressure in the artesian aquifer. Any other artesian well within this area of low pressure will experience reduced pumping efficiency.

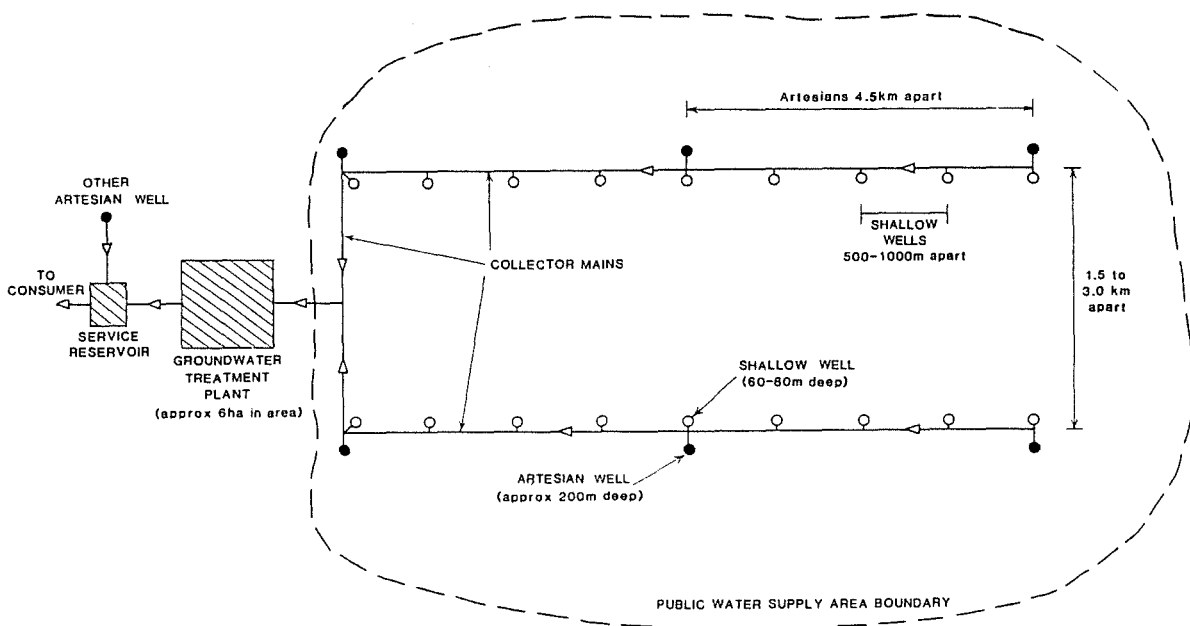


Figure 8 Schematic Description of Groundwater Scheme Development

THE WATER SUPPLY SYSTEM

The individual schemes currently supplying the MWS operate together as a system. Computer analysis is used to determine the maximum demand that the system can sustain. This is called the 'system yield'. Adding a new source to the system will increase the system yield. The increase is called the 'system yield benefit' of the proposed scheme. The yield may be greater than the water produced from the new source if its inclusion results in greater overall efficiency of the system.

6. #CHANGING YIELD OF RESOURCES ALREADY DEVELOPED

GREENHOUSE EFFECT

At the Greenhouse '87 Conference in Melbourne, November 1987, (Pearman, 1988), the scientific opinion was expressed that the Greenhouse Effect may result in reduced rainfall in the South-West of Australia. Due to the uncertainty of the degree or timing of the rainfall reduction, an assumption has been made for the current SDP which recognises this opinion but which can be modified to be more or less severe in future reviews of the SDP as predictions of the consequences of the Greenhouse Effect become more confident. The assumption has two parts:

- (i) that when estimating the system yield for the present time, only stream flow records after 1947 will be used, on the basis that the consistently higher rainfall years of the 1930s and early 1940s are not likely to recur in the foreseeable future. This reduces the yield of river resources by about 13%, but has no affect on groundwater sources whose management is based only on recent data.
- (ii) that when estimating yields of sources at times in the future, it will be assumed that mean rainfall is steadily reducing to a particular value in the year 2040. For the 'most likely' development timetable, the mean rainfall in 2040 is assumed to be 10% less than in 1986, while for the 'minimum' and 'maximum' timetables, the reduction of 2040 is assumed to be 5% and 15% respectively. These assumptions are illustrated in Figure 9.

A percentage reduction in rainfall generally causes a reduction in yield of river sources of twice that percentage. Consequently, the percentage reduction in yield of river sources by 2040 in each of the 'minimum', 'most likely' and 'maximum' timetables is assumed to be 10%, 20% and 30% respectively.

The impact of reduced rainfall on groundwater resources has only been assessed for its affect on public supply schemes for the Metropolitan Area, and only on the basis that shallow wells

PERTH RAINFALL

Showing assumed reducing mean to 2040

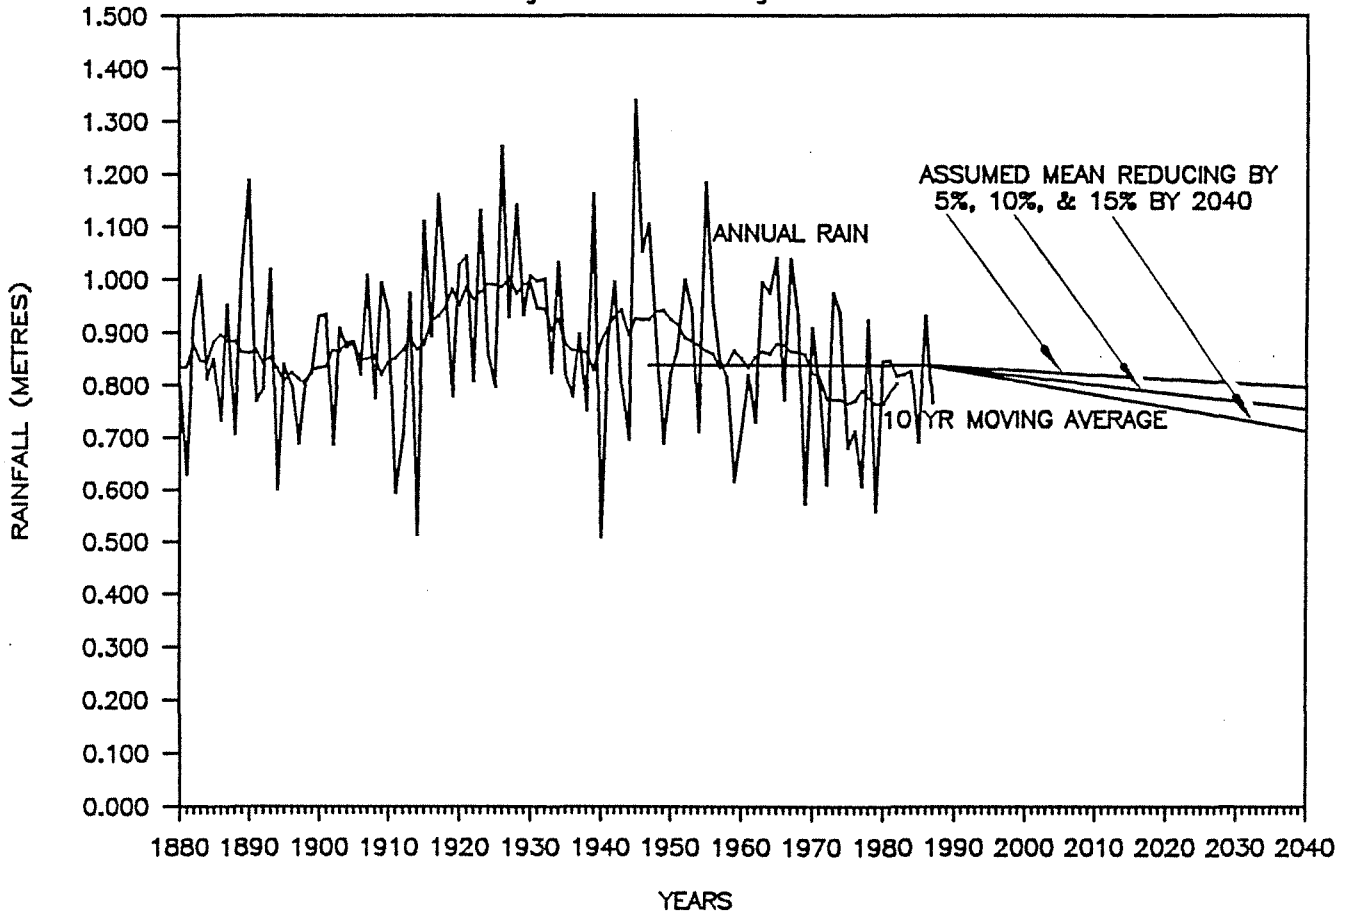


Figure 9 Perth Rainfall Showing Assumed Reducing Mean to 2040

nearest to wetlands may have to be closed when reducing rainfall makes it impossible to maintain water levels in lakes. Groundwater production could be reduced by up to 20% if all such wells, existing and planned, were not used. As the percentage of rainfall which would cause all these wells to be closed is not known, a reduction of 20% in groundwater has been assumed as the target for 2040 in the 'maximum' and 'most likely' timetables. A target of only 10% reduction in the 'minimum' timetable was assumed due to the small rain reduction.

MANAGEMENT OF NATIVE FOREST

The streamflow from forested catchments in the Darling Range is only a small fraction of the volume of water which falls on the catchments as rain. Streamflow is, on average, 9% of rainfall on catchments for the existing MWS, although in the higher rainfall areas the streamflow is up to 20% of rainfall. The remainder of the rainfall is passed directly back into the atmosphere by evaporation from wet surfaces or transpiration through vegetation.

A slight (1%) reduction in forest density by thinning would reduce the amount of water transpired through the vegetation, and cause an increase in streamflow. A 1% reduction in transpiration, added to the 9% of rainfall which becomes streamflow, would increase streamflow by about 10%. Such an increase would provide a very significant increase in yield of existing water supply sources, and construction of new sources could be deferred. #More detailed analysis by the Water Authority and CALM (Water Authority, 1987b) indicates that the system yield could be increased by 37 million cubic metres per year, only by thinning suitable forest in the high rainfall zone of existing catchments.

#Assessment of the benefits of forest thinning needs to consider the following:

- The natural density of the forest is the maximum which can be sustained by the available rainfall. If the forest density is artificially reduced, vegetation growth rapidly responds to re-establish the maximum density. Government agencies must make a commitment to a long-term programme of #forest management activities #associated with thinning, such as controlling regrowth, as well as actually thinning periodically, if increased yield is to be achieved and maintained.
- Some economic benefits are expected to accrue from improving the #quantity of timber produced, but these are not sufficient to cover costs. Economic justification of the proposal depends on the long-term benefits in reducing the cost of future water supplies.
- Environmental impacts of the thinning operation require investigation and assessment. There are impacts associated with the operation itself, for example the possible spread of jarrah dieback disease to new sites, or #there could also be impacts from the consequences of

thinning, #for example 'Did the forest before thinning, have a special role in the forest ecology which would not continue after thinning, for instance as the home of a rare species.'

- The first effect of reduced transpiration is to allow groundwater to build up, which subsequently leads to increased streamflow. Rising groundwater levels in lower rainfall areas increase the chance of developing the salinity problems usually associated with agricultural clearing.

The Water Authority is involved in studies which are exploring the potential of forest thinning for increasing the yield from the existing catchments. #The next step planned is an operational scale experiment to thin within a 1700 ha section of the South Dandalup Catchment in the high rainfall zone (Water Authority, 1987b). As positive proposals for increasing yield this way depend on the outcome of these studies, forest thinning is not included at present in long-term planning for future sources and it is unlikely that it will be possible to do so within the next ten years.

MANAGEMENT OF PINE PLANTATIONS

Pine plantations on the coastal plain have a significant affect on the availability of shallow groundwater, mainly be reducing the proportion of rainwater which reaches the water-table. This happens because a lot of rain is held on the trees' foliage, from which it evaporates, or is drawn from the soil by the tree roots before it reaches the water-table.

The pine plantations can be considered as a use of the groundwater resource for the purpose of producing timber. However, when there are other potential demands on the groundwater, it is possible that the plantation should be thinned more than would be the case if the objective was only to maximise timber production.

Studies to assess the increase in the groundwater yield due to thinning of pines on the Gnangara Mound are being progressed by the Water Authority in conjunction with the Department of Conservation and Land Management. The results can only be incorporated in estimates of yield from the resource when appropriate forest management procedures are operational. At this stage it appears that pines and water production can co-exist as long as the pines are kept at a low density by thinning.

REDEVELOPMENT OF EXISTING SCHEMES

Sometimes a water resource is developed with a relatively low percentage of use of the available water because the demand at the time does not warrant a larger scheme. In such cases, redevelopment of the resource is possible at a later date. A pipehead could be replaced with a dam, a dam could be raised,

or an upper dam or a pumpback could be added (see Chapter 5). Unless the original scheme is at the end of its life, the increased yield will be that part of the total yield of the new scheme which is greater than the yield of the original scheme. Provided the cost per cubic metre of this increase in yield does not exceed the cost of seawater desalination, there will come a time when such schemes are economically viable. Several of the current proposals in the SDP could be considered as 're-development' schemes, e.g. North Dandalup Dam (replaces pipehead), # raising Mundaring Weir, and the scheme for re-developing the Victoria/Bickley catchments. (Details of these proposals are given in Appendix A.)

INCREASING PIPELINE CAPACITY

The yield of a source is sometimes limited if the pipes taking water from the source have a relatively low capacity. In such cases, provision of an additional pipe will result in an increase in system yield. Pipes are sometimes added because they are needed to enable peak rates of demand to be satisfied and they are planned for installation when demands exceed existing capacity. Increasing the capacity of the outlet main from Wungong Dam is in this category (Wungong outlet main amplification).

If the only benefit to be gained by a new pipe is a yield increase, then consideration must be given to the cost of the pipe in comparison to the cost of increasing yield by, say, developing another new source, when deciding if and when the additional pipe is required. An example of this case is the duplication of part of the pipeline from North Dandalup River (North Dandalup Main Amplification). (Details of these proposals are given in Appendix A.)

7. THE SOURCE DEVELOPMENT PLAN

EXISTING AND PROPOSED SCHEMES

The names and types of existing MWS schemes, and of all proposed schemes which are currently the Water Authority's preferred alternatives for future development of each resource, are listed in Tables 4 (river resources) and 5 (groundwater resources). Schemes which are simply additional pipelines to increase the capacity for moving water in the system are also listed in Table 4.

The tables include a map reference which allows the schemes to be located by their Scheme Number on Map 4. Map 4 also shows the resource boundaries: catchment areas for river sources, and declared Groundwater Areas, Water Reserves or Public Water Supply Areas for groundwater schemes.

Details of the proposed schemes, and also of other alternatives

Table 4 Existing and Possible Future River Schemes for the MWS

	MAP REF	SCHEME No.	MAIN DAMS	MAP REF	SCHEME No.	UPPER DAMS	MAP REF	SCHEME No.	PIPEHEADS
EXISTING	F1	R1	Canning				Eh	R8	Nth Dandalup
	F1	R2	Churchmans				Fi	R9	Serpentine
	Gn	R3	Helena						
	Fi	R4	Serpentine						
	Ff	R5	Sth Dandalup						
	Fm	R6	Victoria						
	Fk	R7	Wungong						
POSSIBLE FUTURE	Ea	R12	Harvey	#	#	#	Eg	R18	Conjurunup
	Gn	R13	Helena Res. Raised				Ep	R19	Ellen
	Eh	R14	Nth Dandalup						
	Fm	R15	Victoria						
	Fp	R16	Wooroloo						

The map reference enables location of schemes by their scheme number on Map 4.

Note: Possible future sources listed here are currently the Water Authority's preferred alternative for development of each source. Other proposals are listed in Table A1 in Appendix A.

considered for developing each resource, can be found in Appendix A. The Appendix includes a map showing land use within the resource boundaries.

SELECTING SCHEMES FOR THE SOURCE DEVELOPMENT PLAN

The SDP is based on engineering feasibility studies and on projections of demand for public water supply in the Perth metropolitan area. When developing the plan, the Water Authority identifies constraints so that a realistic allowance

Table 4 (continued)

MAP REF	SCHEME No.	PUMPBACKS	MAP REF	SCHEME No.	ADDITIONAL PIPELINES
G1	R10	Kangaroo Gully			
Fn	R11	Lower Helena			
F1	R20	Araluen	Fn	R33	Mundaring Integration
Fm	R21	Bickley	Eh	R34	North Dandalup Mains Amplification
Fq	R22	Brockman	Ek	R35	Wungong Outlet Amplification
Ei	R23	Dirk			
Fj	R24	Gooralong			
Fo	R25	Jane			
#	#	#			
Ei	R27	Lower Serpentine Stage II			
Eg	R28	Lower South Dandalup			
Ef	R29	Marrinup (Site 1)			
Gd	R30	Murray Tributaries			
#	#	#			
Fo	R32	Susannah			

is made for other claims for use of the water resources, and environmental effects of the source development projects are limited. The preferred alternative for developing each resource will be the most economically efficient proposal, within the known environmental and social constraints. This preference could change in the future if public review or further studies show that environmental or social impacts which are currently assumed to be acceptable, are in fact not acceptable, or that costs of environmental management make the proposal less cost-effective than an alternative development of that resource.

Table 5 Existing and Possible Future Groundwater Schemes for the MWS

	MAP REF	SCHEME No.	GROUNDWATER SCHEMES	No. OF WELLS	
				Shallow G'water	Artesian (Treated)
EXISTING	Co	G1	Gwelup	12	5
	Dl	G2	Jandakot	15	2
	Do	G3	Mirrabooka	34	5
	Dq	G4	Wanneroo	24	8
POSSIBLE FUTURE	Bt	G10	Barragoon Stage I	12	2
	Bt	G11	Barragoon Stage II	11	2
	#	#	#	#	#
	Dh	G13	Dandalup	20	25
	Ep	G14	East Mirrabooka Stage III	4	-
	Dl	G15	Jandakot Stage II	15	2
	Dk	G16	Jandakot South Stage I	7	5
	Dk	G17	Jandakot South Stage II	7	1
	Di	G18	Karnup	20	15
	Ep	G19	Lexia	15	-
	Cq	G20	Pinjar Stage I	#9	#5
	Cq	G21	Pinjar Stage II	#9	#3
	Cq	G22	Pinjar Stage III	#10	#2
	Cs	G23	Yeal Stage I	12	2
	Cs	G24	Yeal Stage II	12	2

The map reference enables location of schemes by their scheme number on Map 4.

Note: Possible future sources listed here are currently the Water Authority's preferred alternative for development of each source. Other proposals are listed in Table A2 in Appendix A.

THE SOURCE DEVELOPMENT TIMETABLE

A Source Development Timetable is prepared by scheduling the construction of these preferred schemes to meet projected increases in the demand for water supply. Schemes are generally sequenced in order of increasing cost per cubic metre of water supplied. For each scheme, this cost can be found in Appendix A. This ensures that the cost of producing water from the system is the minimum that can be achieved at all times. In some cases, however, there are constraints arising from the

Table 5 (continued)

MAP REF	SCHEME No.	OTHER ARTESIAN WELLS (Untreated)	No. OF WELLS
Cn	G5	Bold Park	2
Cm	G6	Melville	1
Do	G7	Mirrabooka	1
Dn	G8	Mt Eliza	6
Do	G9	Yokine	4
#	#	#	#
#	#	#	#
#	#	#	#
#	#	#	#
Cp	G29	Wanneroo	1
#	#	#	#
#	#	#	#

geographical distribution of the system or from operational requirements, which result in alterations to the sequence. These constraints on sources in the Source Development Timetable are described in Appendix E.

Three Source Development Timetables have been produced to meet maximum, most likely and minimum demand projections, as explained in Chapter 3. The timetables indicate when sources need to be operational if the assumptions of the demand projections are realised, but commitment to construction dates will be deferred until absolutely necessary.

The 'Maximum', 'Most Likely' and 'Minimum' Source Development Timetables are listed in Tables 6, 7 and 8, and shown graphically in Figures 10, 11 and 12.

- . The 'Maximum' timetable shows the earliest dates at which future projects will be required as a basis for planning (assuming that there will be no more constraints on development than have been assumed in selecting and scheduling the sources).
- . The 'Most Likely' timetable represents the expected construction programme.
- . 'Minimum' represents a possible lowest limit on the construction schedule necessary to meet future demands. It is useful to indicate how significant reductions in demand arising from demand management could defer the need to develop new sources, and the associated cost savings.

ALTERNATIVE TIMETABLES

The Source Development Timetable represents the most cost-efficient programme for meeting water supply needs within known environmental and social constraints on developing sources.

If new environmental constraints arise, for example, a community decision that loss of forest due to construction of reservoirs is unacceptable, or that further reduction of streamflow to the Peel Inlet is unacceptable, resources may be excluded or limited in the way they can be developed.

Re-scheduling the sources results in increased development costs. This represents the cost to the community of imposing the added constraint. The community will need to address these issues of social, environmental and recreational values of water resources.



8. #CURRENT PLANNING FOR NEAR FUTURE SOURCES

NEW SOURCES IN 1988

Wanneroo Deep Artesian Well and part of the Pinjar Stage 1 Groundwater Scheme have been commissioned in time to be available for summer 1988/89.

REMAINDER OF PINJAR GROUNDWATER SCHEME

In its report and recommendations to the Government on the Gngangara Mound Groundwater Resources ERMP (EPA 1987), the EPA recommended that Stage 1 of the Pinjar Scheme was environmentally acceptable. Also, while accepting in principle that Stages 2 and 3 of the Pinjar Scheme were environmentally acceptable, it recommended that the Water Authority review

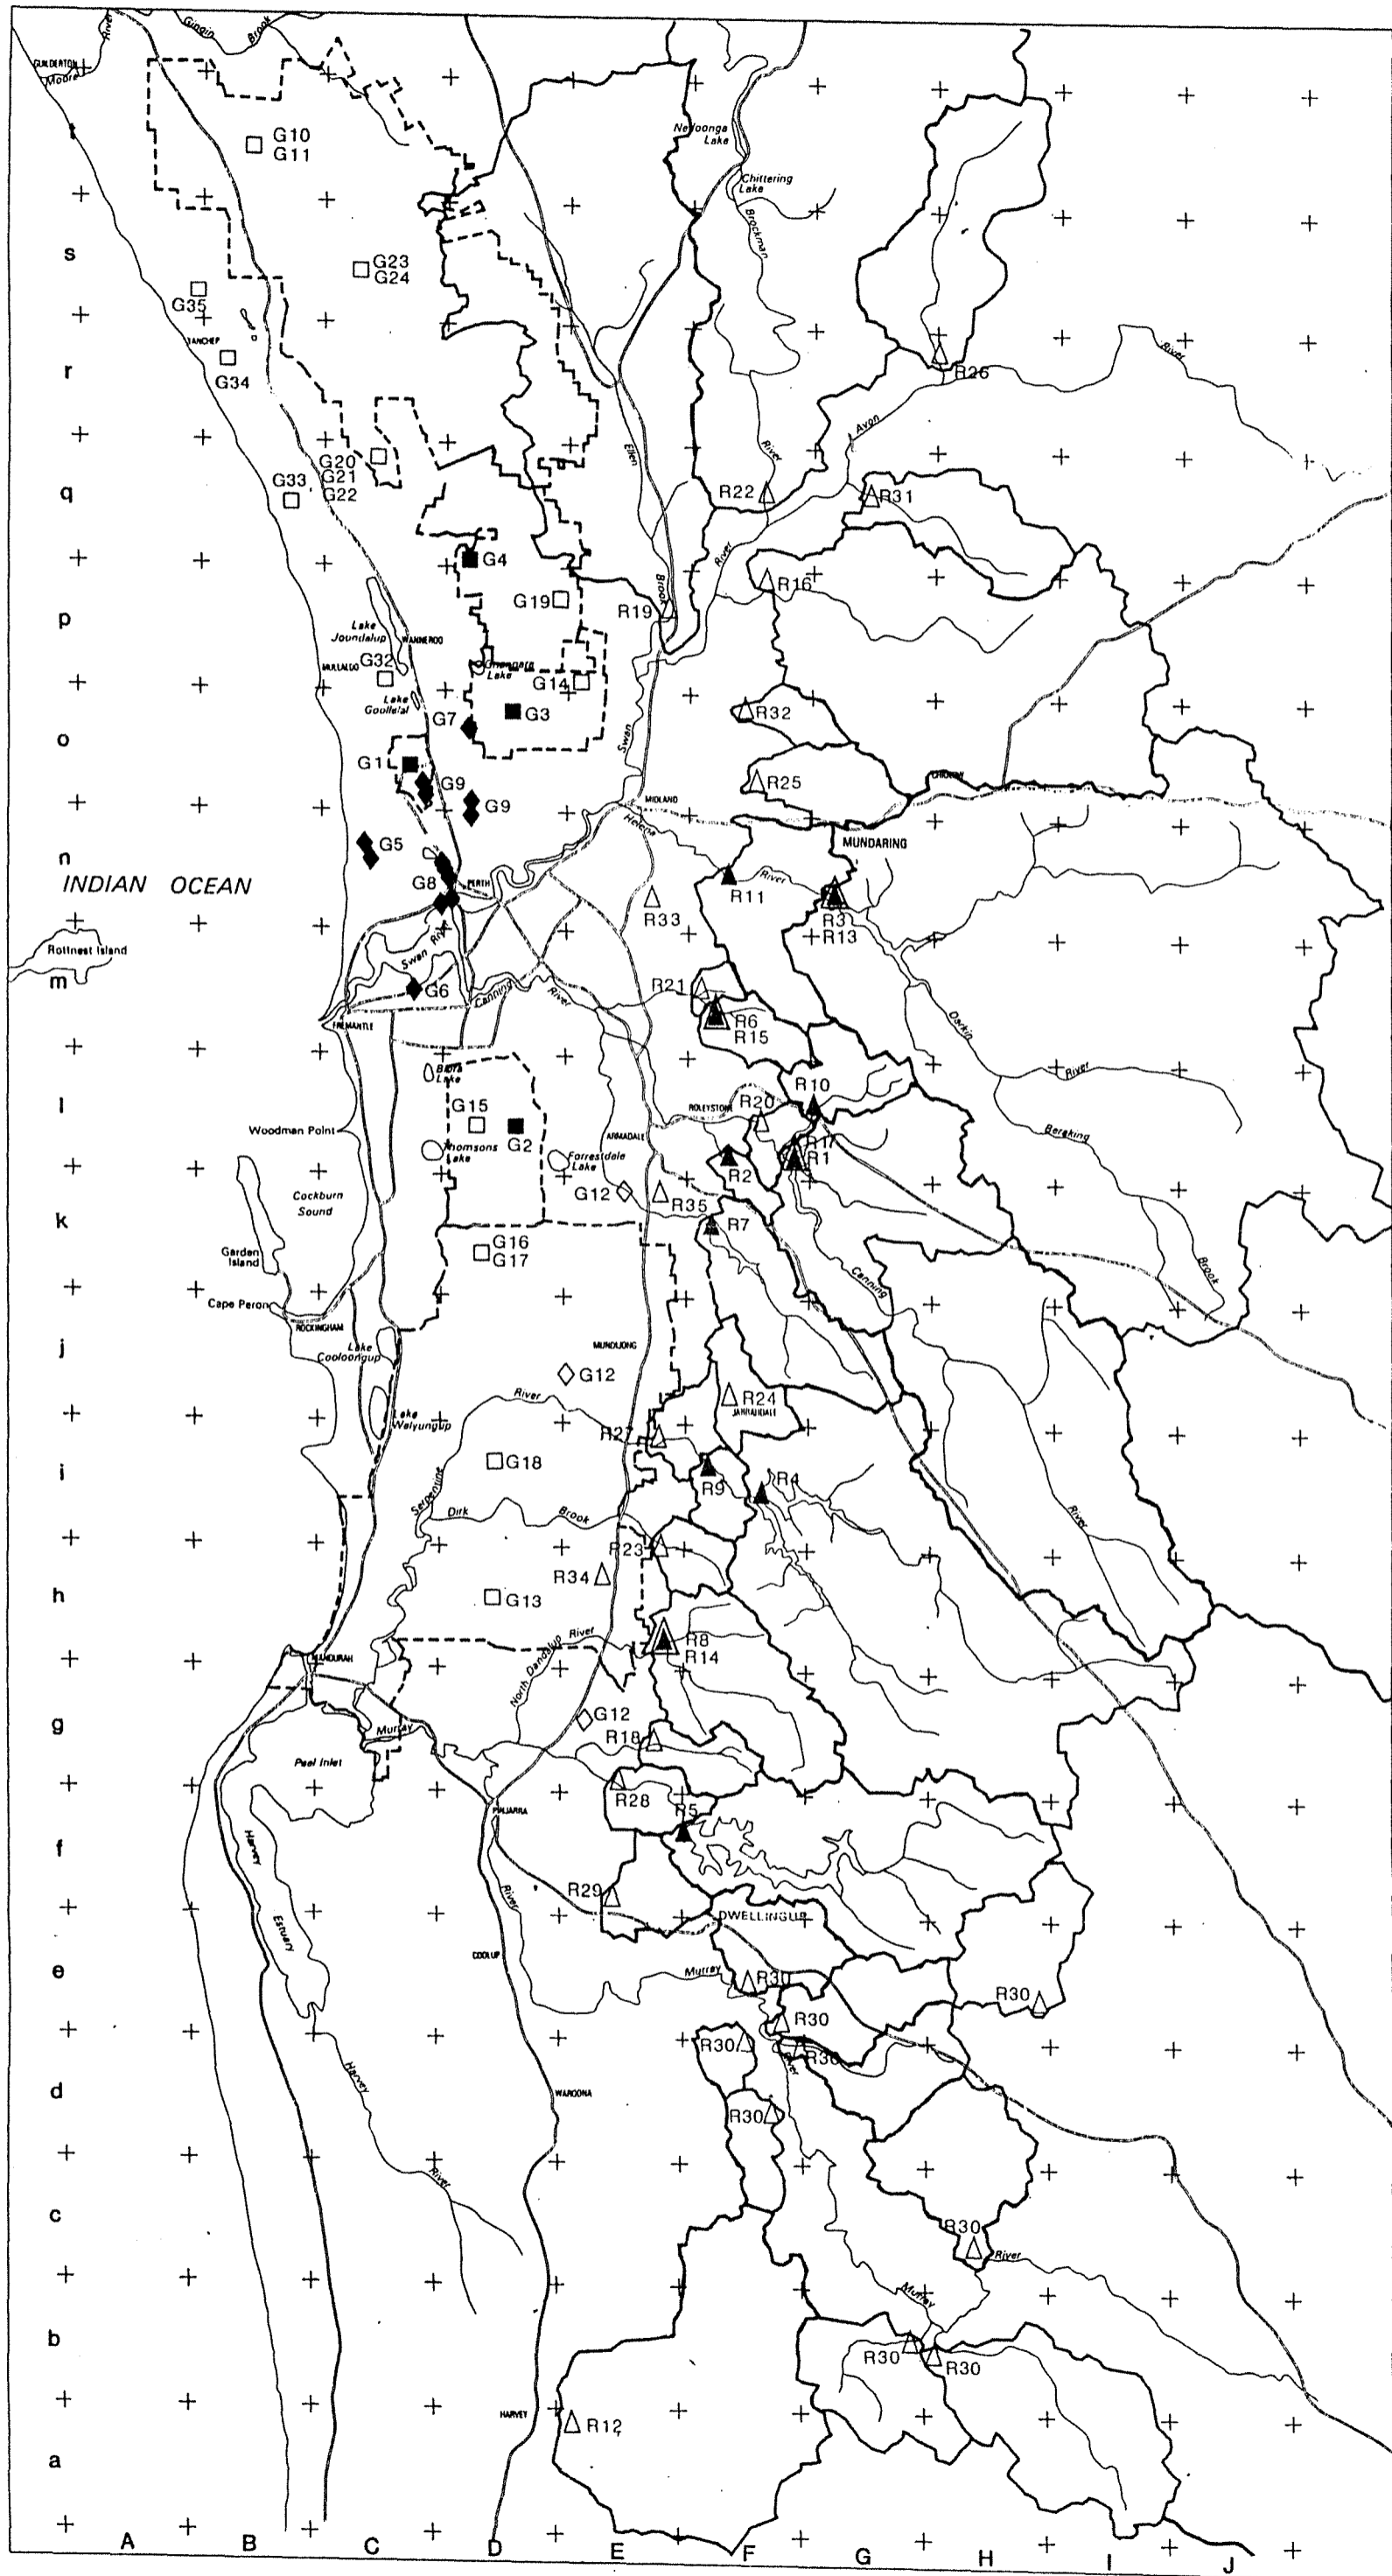

LEGEND

- CATCHMENT BOUNDARY
- - - - GROUNDWATER AREA or PUBLIC WATER SUPPLY AREA BOUNDARY

River Schemes	Ground-water Schemes	Other Artesian Wells	
▲ R23	■ G23	◆ G23	Existing
△ R23	□ G23	◇ G23	Possible Future

Refer to Tables 4 & 5 for scheme names

Map 4 Water Supply Scheme Locations

these stages in the light of the outcome of the ERMP and refer them again to EPA for further consideration. This is the procedure being adopted by the Water Authority.

NEXT MAJOR HILLS STORAGE ERMP STAGE 1

The EPA has reported to the Government with its recommendation on this ERMP. (EPA 1988) It recommended that the proposal to build a dam on the North Dandalup River was environmentally acceptable, and that the Water Authority should proceed with documentation of the environmental management proposals. This documentation will be known as the Stage 2 ERMP for North Dandalup Dam.

The EPA also concluded that the options of raising Mundaring Weir and raising Canning Dam were both environmentally acceptable in principle, but recommended that detailed proposals on the options should be referred to the EPA for assessment before any final decisions were made. The EPA was advised by the Water Authority before it prepared its report, that the option of an upper dam at South Canning should no longer be considered due to uncertainty with estimated yield benefits and possible salinity problems arising from the Water Authority's decision to assume that mean rainfall will tend to reduce in the foreseeable future.

CONJURUNUP PIPEHEAD

In 1983 the Water Authority submitted to the EPA a Notice of Intent describing this project and its anticipated environmental impacts and management proposals. The EPA responded by recommending environmental approval to the project subject to final approval of detailed designs for the pipe route in the valley of Conjurunup Ck. The Water Authority will shortly submit the requested pipeline design and associated information to the EPA for its assessment. Detailed design for the complete project is in progress.

VICTORIA-BICKLEY REDEVELOPMENT

The Water Authority has decided that, for dam safety reasons, the existing Victoria Dam must be replaced within 10 years. The proposed redevelopment scheme includes a larger reservoir at about the same site as the existing reservoir, and a pumpback which collects water flowing from Bickley catchment and delivers it into the new reservoir (refer Scheme R15). The project has been referred to the EPA who will advise what form of environmental assessment is required.

JANDAKOT STAGE II GROUNDWATER

The Water Authority is preparing to refer this project to the EPA.

Table 6. Maximum Source Development Timetable
(includes G & AWS System)

All units Millions of Cubic Metres per Annum


D.A.W.=Deep Artesian Well G.W.=Groundwater Scheme P.H.=Pipehead P.B.=Pumpback ST=Stage

Year	Forecast Unrestrict- ed Demand	Sources Commissioned (Operational)	Groundwater		System Yield Benefit	Reduced Yield Benefit (1)	System Yield	Surplus Yield
			Interim Quota Scheme	Total				
1986/87	218.7	Storage Reservoirs: Canning,Serpentine, South Dandalup,Wungong (2), (Restricted Outlet), Churchmans,Victoria, Mundaring. Pipeheads/Pumpbacks: North Dandalup P.H. Lower Helena P.B. Groundwater Schemes: Gwelup 12.0 Mirrabooka 22.0 Wanneroo 21.2 Jandakot ST 1. 5.3 Deep Artesian 12.0	72.5				252.6	33.9
1987/88	223.0						251.3	28.3
1988/89	230.2	Wanneroo D.A.W. 1.5 Pinjar ST 1 G.W. Pt 1 6.3	80.3		2.0 7.0	2.0 6.9	259.0	28.8
1989/90	238.4	Pinjar ST 1 G.W. Pt 2 6.4 Delete 2 G.W. -2.0	84.7		7.1 -2.0	7.0 -2.0	262.7	24.3
1990/91	246.6	Mundaring Integration Delete Victoria Dam			0.0 -3.1	0.0 -3.0	258.4	11.8
1991/92	254.8	Victoria/Bickley Dam Redev Deletion of North Dandalup P.H. -10.6 Conjurunup Creek P.H. 4.5			6.0 -10.6 4.5	5.8 -10.3 4.4	257.0	2.2
1992/93	263.0	Dirk Brook P.B. Jandakot ST 2 G.W. 4.0	88.7		3.5 4.7	3.4 4.6	263.7	0.7
1993/94	271.2	Wungong Outlet Main Amp North dandalup Dam (Part) 8.0 Araluen P.B. 1.2			0.9 8.0 1.2	0.9 7.7 1.2	272.0	0.0
1994/95	279.4	North Dandalup Dam (add) Lexia G.W. 6.5	95.2		6.0 6.9	5.7 6.7	283.1	3.7
1995/96	288.6	North Dandalup Dam (add) Pinjar ST 2 G.W. 7.2	102.4		3.0 8.0	2.9 7.7	292.2	3.6
1996/97	297.8	North Dandalup Dam (add) Pinjar ST 3 G.W. 5.6	108.0		1.9 6.0	1.8 5.8	298.3	0.5
1997/98	307.0	Marrinup Brook P.B. Gooralong P.B. Raise Mundaring North Dandalup Main Amp			6.1 4.4 0.0 2.9	5.7 4.1 0.0 2.7	309.3	2.3
1998/99	316.2	Jandakot South ST 1 G.W. 3.1 Lower Serpentine P.B. Raise Mundaring (part) 111.1			3.3 4.6 3.0	3.2 4.3 2.8	317.9	1.7
1999/ 2000	324.4	Yeal ST 1 G.W. 6.1 Jandakot South ST 2 G.W. 3.1 Raise Mundaring (add) 120.3			6.7 3.3 1.0	6.4 3.1 0.9	326.7	2.3
2000/01	333.6	Yeal ST 2 G.W. 6.1 Barragoon ST 1 G.W. 4.8	131.2		6.4 6.0	6.1 5.7	336.8	3.2
2001/02	341.8	Barragoon ST 2 G.W. 4.8 Lower South Dandalup P.B. 136.0			6.0 2.3	5.7 2.1	342.8	1.0
2002/03	351.0	Jane Brook P.B. East Mirrabooka ST 3 G.W. 2.0 Raise Mundaring (add) 138.0			9.4 1.5 3.0	8.6 1.4 2.7	353.7	2.7
2003/04	360.2	Susannah Brook P.H. Ellen Brook P.H.			3.4 7.1	3.1 6.4	361.4	1.2
2004/05	368.4	Harvey Dam (Part)			20.0	18.0	377.4	9.0
2005/06	378.6	Harvey Dam (Add)			20.0	17.9	393.3	14.7
2006/07	386.8	Raise Mundaring (add)			3.0	2.7	393.8	7.0
2007/08	396.0	Karnup G.W. 7.5	145.5		7.4	6.8	398.5	2.5
2008/09	404.2	Dandalup G.W. 10.6	156.1		10.6	9.7	406.0	1.8
2009/10	414.4	Harvey Basin Sources			15.0	13.2	416.9	2.5
2010/11	422.6	Harvey Basin Sources			10.0	8.6	423.3	0.7
2011/12	432.8	Harvey Basin Sources			15.0	12.9	433.8	1.0

(1) Assumed yield reduction by 2040 due to climate change.

- Surfacewater Sources 30%.
- Groundwater Sources 20%.

(2) Assumes Wungong Tunnel and Outlet Pipes Completed to South West Highway.

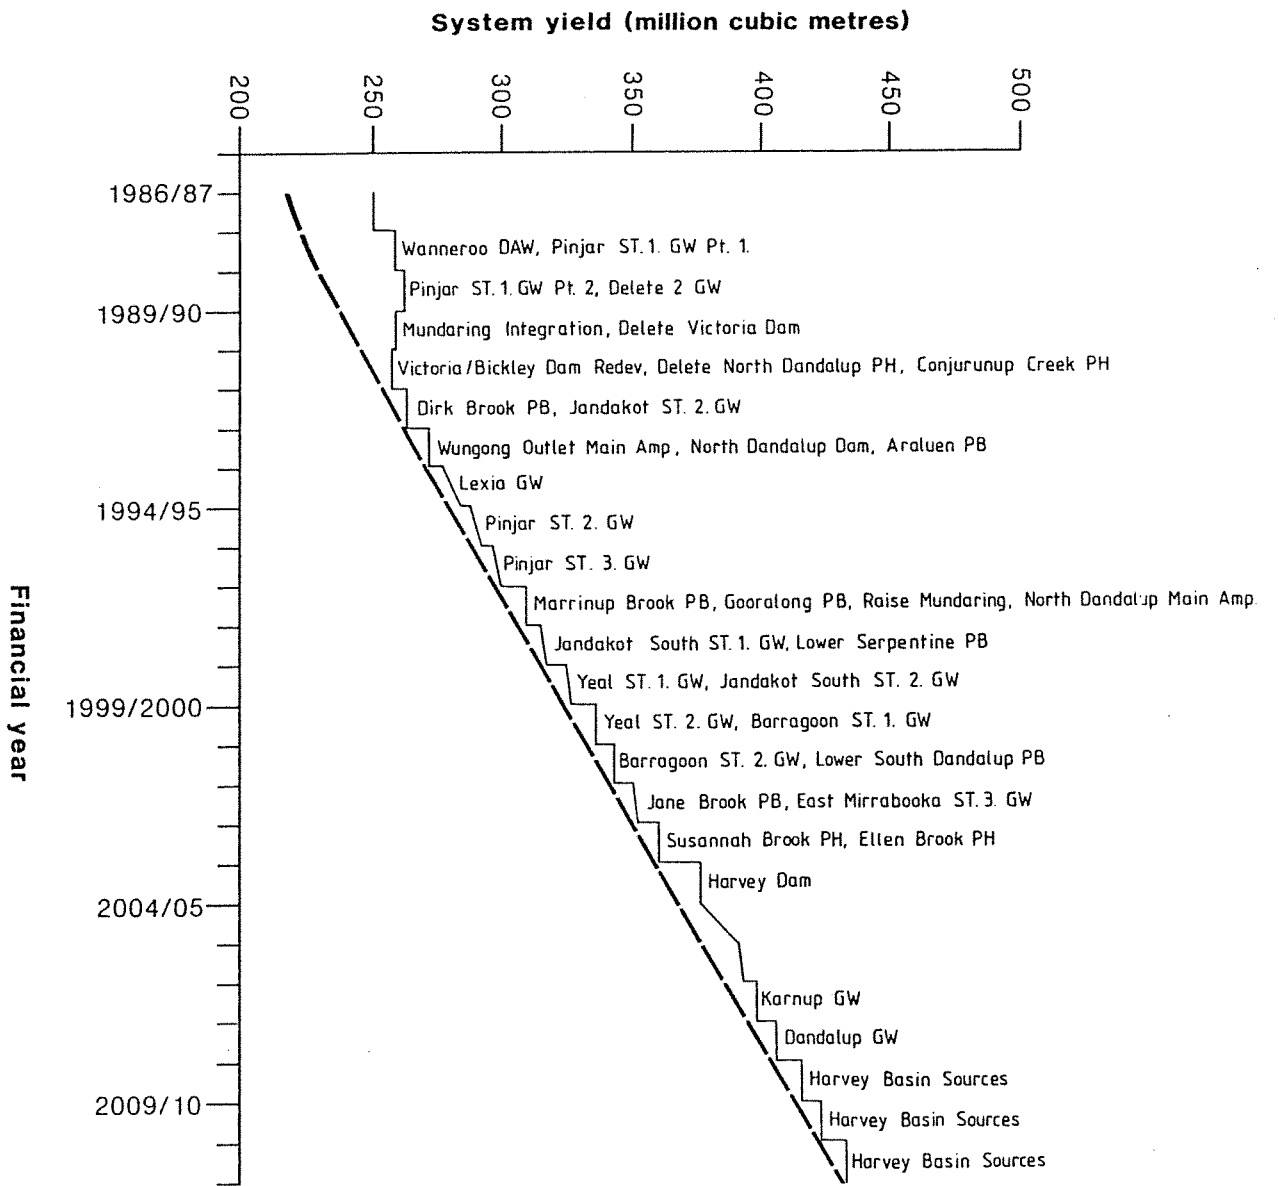

KEY

DAW Deep artesian well
 PH Pipehead
 PB Pumpback
 GW Groundwater scheme

Maximum forecast unrestricted demand
 Yield change when no source added.
 (Gain in years after major dams loss due to climate change)
 Yield change when new source added

Figure 10 'Maximum' Source Development Timetable

Table 7. Most Likely Source Development Timetable
(includes G & AWS System)

All units Millions of Cubic Metres per Annum


D.A.W.=Deep Artesian Well G.W.=Groundwater Scheme P.H.=Pipehead P.B.=Pumpback ST=Stage

Year	Forecast Unrestrict- ed Demand	Sources Commissioned (Operational)	Groundwater		System Yield Benefit	Reduced Yield Benefit (1)	System Yield	Surplus Yield
			Interim Quota Scheme	Total				
1986/87	218.7	Storage Reservoirs: Canning,Serpentine, South Dandalup,Wungong (2), (Restricted Outlet), Churchmans,Victoria, Mundaring. Pipeheads/Pumpbacks: North Dandalup P.H. Lower Helena P.B. Groundwater Schemes: Gwelup 12.0 Mirrabooka 22.0 Wanneroo 21.2 Jandakot ST 1. 5.3 Deep Artesian 12.0		72.5			252.6	33.9
1987/88	219.0						251.7	32.7
1988/89	224.2	Wanneroo D.A.W.	1.5		2.0	2.0		
		Pinjar ST 1 G.W. Pt 1	6.3	80.3	7.0	6.9	259.7	35.5
1989/90	227.4	Pinjar ST 1 G.W. Pt 2	6.4		7.1	7.0		
		Delete 2 D.A.W.	-2.0	84.7	-2.0	-2.0	263.7	36.3
1990/91	231.6	Mundaring Integration			0.0	0.0	262.7	31.1
1991/92	235.1						261.8	26.7
1992/93	240.1						260.8	20.7
1993/94	245.2	Wungong Outlet Main Amp Deletion of North Dandalup P.H.			0.9	0.9		
					-2.0	-1.9	258.7	13.5
1994/95	250.4	Delete Victoria Dam Conjurunup Creek P.H. Deletion of North Dandalup P.H.			-3.1	-3.0		
					4.5	4.4		
					-8.6	-8.3	250.8	0.4
1995/96	255.7	Victoria/Bickley Dam Redev Jandakot ST 2 G.W.	4.0	88.7	6.0	5.8	260.2	4.5
1996/97	260.8	North dandalup Dam (part)			8.0	7.7	266.9	6.1
1997/98	266.5	North Dandalup Dam (add)			6.0	5.8	271.6	5.1
1998/99	271.9	North Dandalup Dam (add)			3.0	2.9	273.4	1.5
1999/ 2000	276.7	North Dandalup Dam (add) Gooralong P.B.			1.9	1.8		
					4.4	4.2	278.4	1.7
2000/01	281.5	Araluen P.B. Pinjar ST 2 G.W. Pt 1	3.6		1.2	1.1		
		Raise Mundaring		92.3	4.0	3.8		
					0.0	0.0	282.2	0.7
2001/02	286.4	Lower Serpentine P.B. Raise Mundaring (part)			4.6	4.3		
					3.0	2.8	288.3	1.9
2002/03	291.1	Lexia G.W. Raise Mundaring (add)	6.5		6.9	6.5		
				98.8	1.0	0.9	294.6	3.5
2003/04	296.2	Marrinup Brook P.B.			6.1	5.7	299.2	3.0
2004/05	301.5	Pinjar ST 2 G.W. Pt 2	3.6	102.4	4.0	3.7	301.7	0.2
2005/06	306.8	Pinjar ST 3 G.W. Raise Mundaring (add)	5.6		6.0	5.6		
				108.0	3.0	2.8	308.9	2.1
2006/07	311.3	North Dandalup Main Amp Dirk Brook P.B.			2.9	2.9		
					3.5	3.2	313.8	2.5
2007/08	316.6	Jandakot South ST 1 G.W. Jandakot South ST 2 G.W.	3.1	114.2	3.3	3.0	318.6	2.0
2008/09	321.1	Yeal ST 1 G.W.	6.1	120.3	6.7	6.2	323.5	2.4
2009/10	326.6	Yeal ST 2 G.W. Raise Mundaring (add)	6.1		6.4	5.9		
				126.4	3.0	2.7	330.8	4.2
2010/11	331.6	Lower South Dandalup P.B.			2.3	2.1	331.6	0.5
2011/12	336.7	Barragoon ST 1 G.W. East Mirrabooka ST 3 G.W.	4.8	133.2	6.0	5.4	337.1	0.4
			2.0		1.5	1.4		

1. Assumed yield reduction by 2040 due to climate change.

- Surfacewater Sources 20 %.
- Groundwater Sources 20 %.

2. Assumes Wungong Tunnel and Outlet Pipes Completed to South West Highway.

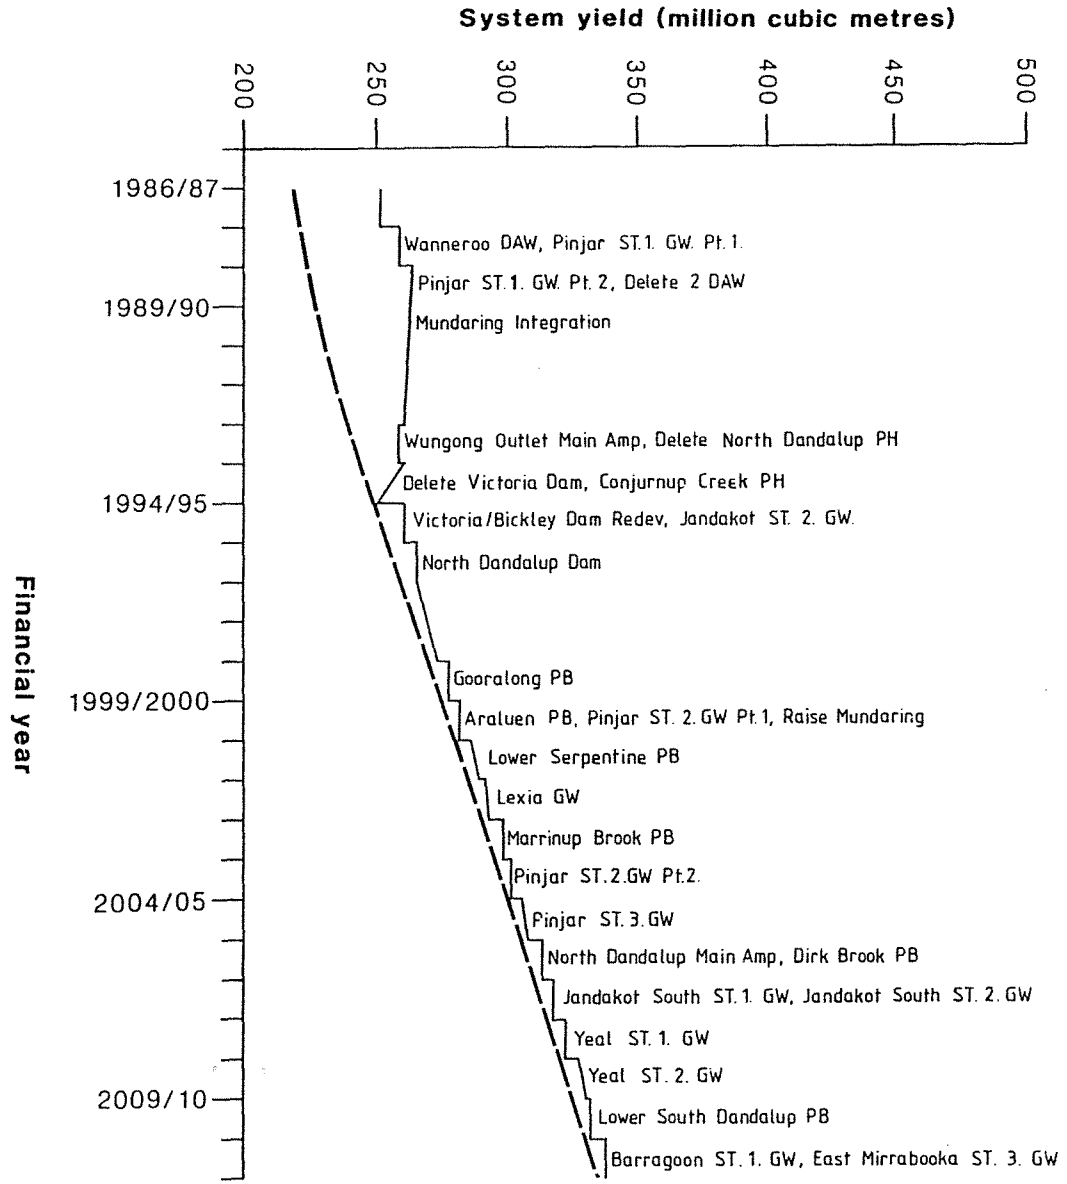

KEY

DAW Deep artesian well
 PH Pipehead
 PB Pumpback
 GW Groundwater scheme

--- Most likely forecast unrestricted demand
 — Yield change when no source added. (Gain in years after major dams loss due to climate change)
 — Yield change when new source added

Figure 11 'Most Likely' Source Development Timetable

Table 8. Minimum Source Development Timetable
(includes G & AWS System)

All units Millions of Cubic Metres per Annum


D.A.W.=Deep Artesian Well G.W.=Groundwater Scheme P.H.=Pipehead P.B.=Pumpback ST=Stage

Year	Forecast Unrestrict- ed Demand	Sources Commissioned (Operational)	Groundwater Interim		System Yield Benefit	Reduced Yield Benefit (1)	System Yield	Surplus Yield
			Quota Scheme	Total				
1986/87	218.7	Storage Reservoirs: Canning,Serpentine, South Dandalup,Wungong (2), (Restricted Outlet), Churchmans,Victoria, Mundaring. Pipeheads/Pumpbacks: North Dandalup P.H. Lower Helena P.B. Groundwater Schemes: Gwelup 12.0 Mirrabooka 22.0 Wanneroo 21.2 Jandakot ST 1. 5.3 Deep Artesian 12.0	72.5				252.6	33.9
1987/88	210.9						252.1	41.2
1988/89	213.5	Wanneroo D.A.W.	1.5	74.0	2.0	2.0		
		Pinjar ST 1 G.W. Pt 1	6.4	80.4	7.0	7.0	260.6	47.1
1989/90	216.3	Pinjar ST 1 G.W. Pt 2	6.3	86.7	7.1	7.1		
		Delete 2 D.A.W.	-2.0	84.7	-2.0	-2.0	265.2	48.9
1990/91	219.2	Mundaring Integration			0.0	0.0	264.7	45.5
1991/92	222.2						264.2	42.0
1992/93	225.5						263.7	38.2
1993/94	228.9	Wungong Outlet Main Amp			0.9	0.9	264.1	35.2
1994/95	232.3	Delete Victoria Dam			-3.1	-3.1	260.6	28.3
1995/96	235.7	Victoria/Bickley Dam Redev			6.0	5.9	266.0	30.3
1996/97	239.3						265.5	26.2
1997/98	242.8						265.0	22.2
1998/99	246.2						264.5	18.3
1999/ 2000	250.6	Deletion of North Dandalup P.H.			-2.0	-2.0	262.1	11.5
2000/01	255.2	Deletion of North Dandalup P.H.			-8.6	-8.4		
		Conjurunup Creek P.H.			4.5	4.4	257.6	2.4
2001/02	259.3	Jandakot ST 2 G.W.	4.0	88.7	4.7	4.6	261.7	2.4
2002/03	263.7	North dandalup Dam (Part)			8.0	7.8	268.9	5.2
2003/04	268.1	North Dandalup Dam (add)			6.0	5.8	274.2	6.1
2004/05	272.4	North Dandalup Dam (add)			3.0	2.9	276.6	4.2
2005/06	276.8	North Dandalup Dam (add)			1.9	1.8	277.9	1.1
2006/07	281.1	Gooralong P.B.			4.4	4.2	281.6	0.5
2007/08	285.6	Lower Serpentine P.B. Raise Mundaring			4.6 0.0	4.4 0.0	285.5	-0.1
2008/09	289.9	Pinjar ST 2 G.W. Pt 1 Raise Mundaring (part)	3.6	92.3	4.0 3.0	3.8 2.9	291.7	1.8
2009/10	294.5	Pinjar ST 2 G.W. Pt 2 Raise Mundaring (add)	3.6	95.9	4.0 1.0	3.8 1.0	295.9	1.4
2010/11	298.0	Lexia G.W.	6.5	102.4	6.9	6.6	301.9	3.9
2011/12	301.7						301.3	-0.4

(1) Assumed yield reduction by 2040 due to climate change.

- Surfacewater Sources 10 %.
- Groundwater Sources 10 %.

(2) Assumes Wungong Tunnel and Outlet Pipes Completed to South West Highway.

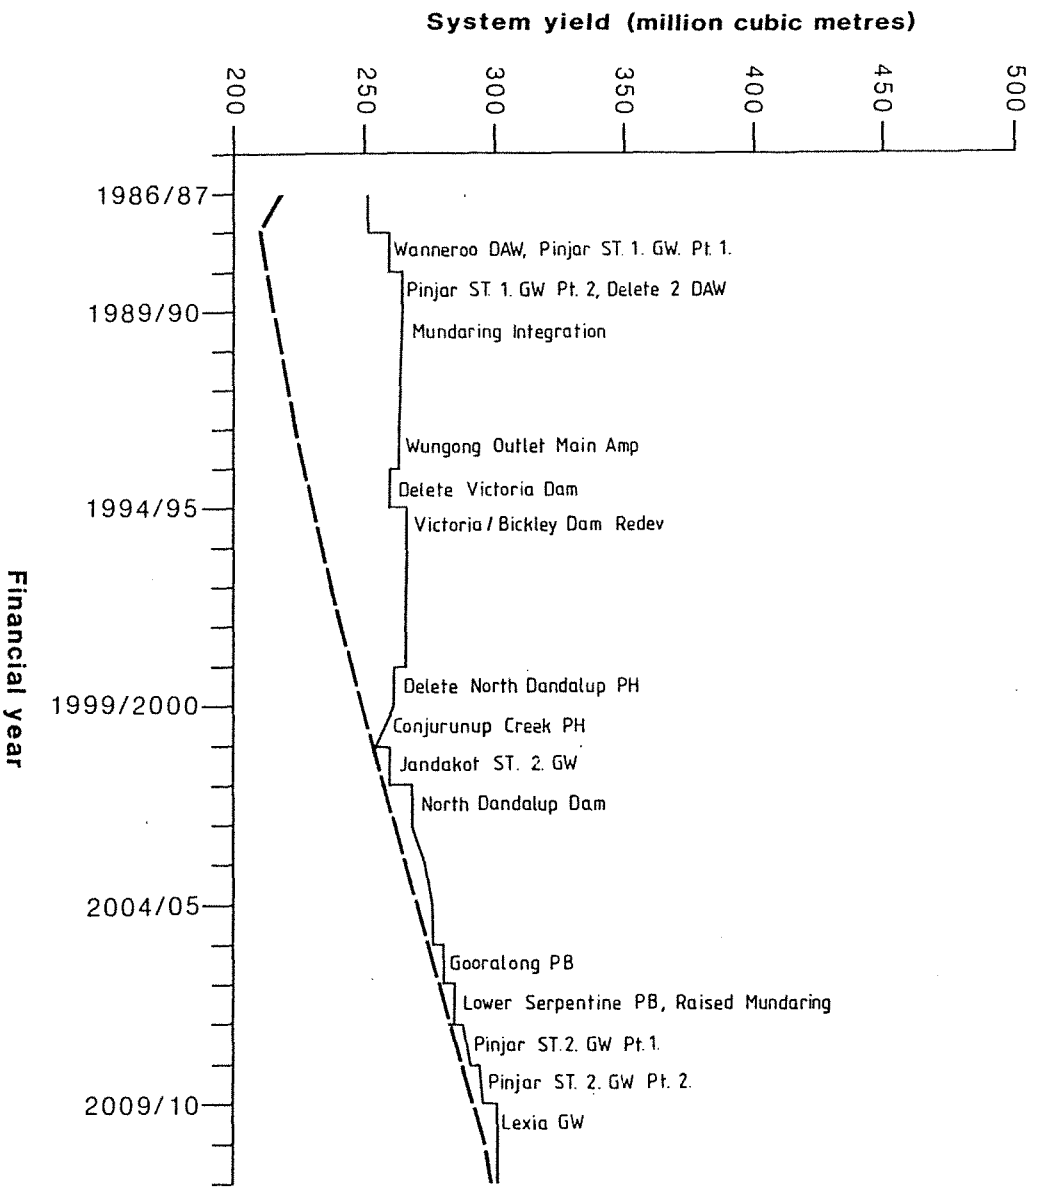

KEY

DAW Deep artesian well
 PH Pipehead
 PB Pumpback
 GW Groundwater scheme

Minimum forecast unrestricted demand
 Yield change when no source added.
 (Gain in years after major dams loss due to climate change)
 Yield change when new source added

Figure 12 'Minimum' Source Development Timetable

ACKNOWLEDGEMENTS

The author wishes to acknowledge the work of members of the Metropolitan and Systems Planning Section in preparing the Source Development Plan and compiling this report. The members were Paul VanderWal, Stewart Dallas, Peter Roberts and David Field. Thanks go to Fiona Carter for typing. Editorial consultation was provided by Ms Karen Majer, whose contribution is gratefully acknowledged.

REFERENCES

Australian Water Resources Council and Western Australian Water Resources Council (1986)

Working Papers for the National Workshop on Urban Water Demand.

Australian Water Resources Council and Western Australian Water Resources Council (1987)

Proceedings of the National Workshop on Urban Water Demand Management #AWRC Conference Series No. 14, Perth March 1987. ISBN 0 7244 67599.

Caldwell M. (1981).

Perth Water Supply. The Role of Groundwater Resources. Proc. of Symposium Groundwater Resources of the Swan Coastal Plain (1981). CSIRO Division of Land Resources Management and Western Australian State Committee of the Water Research Foundation of Australia. ISBN 0 643 02863 3 pp 1-28.

Cargeeg G.C., Boughton G.N., Townley L.R., Smith G.R., Appleyard S.J. and Smith R.A. (1987).

Perth Urban Water Balance Study. Water Authority of Western Australia #, May 1987. ISBN 0 7244 67878 1

Environmental Protection Authority (1987)

Gnangara Mound Groundwater Resources: Report and Recommendations of the Environmental Protection Authority EPA, Perth, Western Australia, Bulletin 295, August 1987.

Environmental Protection Authority (1988)

Next Major Water Supply Source for Perth (Post 1992): Report and Recommendations of the Environmental Protection Authority EPA, Perth, Western Australia, Bulletin 343 August 1988.

Department of Conservation and Environment (1980)

Atlas of Natural Resources, Darling System, Western Australia. University of Western Australia Press, Nedlands, W.A. 6009 ISBN 0 7244 80420.

Mauger G. (1987).

Planning Future Sources for Perth's Water Supply. Water Authority of Western Australia, January 1987. ISBN 0 7244 6743 2

Metropolitan Water Authority (1975-83).

Master Plan for Perth Water Supply - Phase 1 Development Programme 1975-1985. Forward Planning and Computing Section, December 1975.

Master Plan for Perth Water Supply - Update and Review of Development Programme. Forward Planning and Computing Section, September 1977.

- Sources Development Plan - 1979 Review. Forward Planning and Computing Section, December 1979.
- Source Development Plan - 1983 Review. Water Resources Section, September 1983.
- Metropolitan Water Authority (1985).
Domestic Water Use in Perth, Western Australia. John Tonkin Water Centre, 629 Newcastle St, Leederville, W.A. 6007. ISBN 0 7244 6766 1
- Pearman G.I. (1988)
Greenhouse: Planning for Climate Change. CSIRO Division of Atmospheric Research. EJ Brill Publishing Company ISBN 0 643 04863 4.
- Sadler B.S. and Field C.A.R. (1976).
Water Supply and Alternate Sources. Proc. of Symposium Groundwater Resources of the Swan Coastal Plain. EPA and CSIRO Division of Land Resources Management, Western Australia. ISBN 0 643 02044 6. pp 37-60.
- Sadler B.S. and Williams P.J. (1981).
The Evolution of a Regional Approach to Salinity Management in Western Australia. Land and Stream Salinity Seminar and Workshop. Elsevier Scientific Publishing Company. ISBN 0 444 41999 3. pp 353-382.
- State Planning Commission (1987)
Planning for the Future of the Perth Metropolitan Region. State Planning Commission, November 1987
- Water Authority of Western Australia (1986a).
Corporate Plan 1986-1991. July 1986. ISBN 0 7244 6854 4.
- Water Authority of Western Australia (1986b).
Gnangara Mound Groundwater Resources Environmental Review and Management Programme. Dames and Moore, Water Resources Management Branch, Report No. WM4, November 1986 ISBN 0 7244 6870 6.
- Water Authority of Western Australia (1986c).
Sources Development Plan 1986 Review. Water Resources Planning Branch, Report No. WP14, May 1986.
- Water Authority of Western Australia (1987a)
Water Conservation Plan 1987/89. Water Resources Directorate December 1987.
- Water Authority of Western Australia (1987b)
Forest Management to Increase Water Yield from the Northern Jarrah Forest. Steering Committee for Research on Land use and Water Supply, Water Authority of Western Australia, Report No. WS3, August 1987. ISBN 0 7244 6847 1

Western Australian Treasury (#1986).
Projected Population of Western Australia and the Perth
Statistical Division #1986-2025. W.A. Treasury, #March
1986.

Western Australian Water Resources Council (1986).
Water Conservation Through Good Design. Western
Australian Water Resources Council. ISBN 0 7244 6830 7

Western Australian Water Resources Council (1988)
Water for the 21st Century: Supply Options for the Long-
term Water Requirements of Southern Western Australia.
WAWRC Publication No. WRC 4/88 (in prep.)

GLOSSARY

Artesian:	artesian water is trapped in an aquifer between impermeable layers, usually at a considerable depth
Aquifer:	a formation in the soil or underlying rock strata which holds and is sufficiently permeable to yield significant quantities of water
Biological pollution:	pollution by micro-organisms e.g. bacteria and viruses (see Pollution)
Brackish:	water resources of salinity 1000-3000 mg/L TSS (see Salinity)
Catchment:	the surface area from which runoff flows to a river or any other collecting reservoir, e.g. swamp, groundwater
Chemical pollution:	alteration of the chemical properties of the environment (e.g. the water resource) (see Pollution).
Cubic metre:	the volume occupied by a cube measuring one metre along each edge. One cubic metre equals one kilolitre.
Demand:	the amount of water required from the water supply system
Desalination:	the process of removing salts from water to produce fresh water (see salinity)
Effluent:	the liquid, solid or gaseous products discharged by a process, treated or untreated
Fresh Water Resources:	water resources of salinity less than 500 mg/L TSS
Groundwater:	water which occupies the pores and crevices of rock or soil
Groundwater area) Groundwater reserve)	areas defined under the Water Authority Act (1984) for the protection and management of groundwater resources
Kilolitre:	see cubic metre
Main dam:	a major reservoir (see Chapter 5: Water Supply Schemes)

Marginal water resources: water resources of salinity 500-1000 mg/L TSS

Nutrients: materials conveying, serving as or providing nourishment to some organisms

Pesticides: collective name for a variety of insecticides, fungicides, herbicides, fumigants and rodenticides

Pipehead: a small dam allowing the water flowing in a river to be diverted into a pipe (see Chapter 5: Water Supply Schemes)

Pollution: any direct or indirect alteration of the physical, chemical, thermal, biological, or radioactive properties of any part of the environment by discharging, emitting or depositing wastes or substances so as to affect any beneficial use adversely, to cause a condition which is hazardous or potentially hazardous to public health, safety or welfare, or to animals or plants.

Potable: fresh and marginal water generally considered suitable for human consumption

Public water supply area: see Groundwater area

Pumpback: a pipehead dam diverting streamflow through a pipeline into a storage dam (see Chapter 5: Water Supply Schemes).

Runoff: the discharge of water through surface streams into larger water courses

Saline water resources: water resources of salinity greater than 3000 mg/L TSS

Salinity: the measure of the total soluble (or dissolved) salt, i.e. mineral constituents in water. Water resources are classified on the basis of that salinity in terms of milligrams per litre Total Soluble Salts (mg/L TSS)

Service reservoir: a reservoir built near consumers to receive bulk supplies of water from major sources prior to final distribution to services

Sewage: domestic wastewater

Storage dam: see main dam

Stormwater: rain water which has run off roads etc., and is usually disposed of by drains

System yield: the maximum demand that the water supply system can sustain under specified expectation of restrictions (currently restrictions are expected in 10% of years).

Transpiration: the process by which plants take up water from the soil and release water vapour through the leaves.

Treatment: application of techniques such as settlement, filtration, chlorination, to render water suitable for drinking purposes

Turbidity: clouding of water due to suspended material in the water causing a reduction in the transmission of light

Underground Water Pollution Control Areas: see Groundwater Area

Upper dam: a major reservoir on a river upstream of a main dam (see Chapter 5: Water Supply Schemes).

Wastewater: water which has been used for some purpose and would normally be discarded. Wastewater usually contains significant quantities of pollutant (see Pollution)

Water-table: the surface of the groundwater

Well: a hole drilled from the ground surface into an aquifer to withdraw water

Yield benefit: the increase in system yield which occurs when a new source is added to the system.

LIST OF ABBREVIATIONS

MAIN TEXT

AWRC	Australian Water Resources Council
CALM	Department of Conservation and Land Management
EPA	Environmental Protection Authority
ERMP	Environmental Review and Management Programme
G & AWS	Goldfields and Agricultural Water Supply Scheme
MWA	Metropolitan Water Authority
MWS	Metropolitan Water Supply Scheme
PER	Public Environmental Report
SDP	Source Development Plan
WAWRC	Western Australian Water Resources Council

TABLES AND APPENDICES

GA	Groundwater area
g/w	groundwater
GWTP	Groundwater Treatment Plant
ha	hectares
Km	kilometres
m	metres
m ³	cubic metres
mg/L	milligrams per litre
mill.cu.m	million cubic metres
mill.cu.m/yr	million cubic metres per year
N/A	not applicable
Nat. veg.	Native vegetation
PWSA	Public Water Supply Area
Res.	reservoir
Spec. rural	Special rural
sq. km	square kilometres
thou. cu.m.	thousand cubic metres
TSS	Total Soluble Salts
WR	Water reserve

Appendix A

SOURCES ASSESSED FOR INCLUSION
IN THE SOURCE DEVELOPMENT PLAN

Appendix A

SOURCES ASSESSED FOR INCLUSION IN THE SOURCE DEVELOPMENT PLAN

Existing schemes supplying water to the MWS and schemes for development of water resources for public water supply which have been given consideration by the Water Authority are identified in Tables A1 (river sources) and A2 (groundwater sources). The location of the schemes is shown on Map A1 which also shows the resource area associated with each scheme (catchment areas for rivers, and Groundwater Areas, Public Water Supply Areas or Groundwater Reserves for groundwater). Details of each scheme are presented in Table A3 in scheme number sequence.

The base map used for Map A1 is taken from Atlas of Natural Resources, Darling System, Western Australia (DCE, 1980). It shows the nature and distribution of land use within the resource areas. The significance of this land use in terms of its potential impact on the water resources, and the potential impacts of water supply schemes on the land use, are summarized in table form in Appendix B.

The following notes explain the data presented in the panels (Table A3) for each scheme:

1. Scheme No. (upper left of panel):
2. Title (at right of scheme no.):

Name of scheme as shown in Tables A1 and A2.

Identifies scheme in Tables A1 and A2 and on Map A1. The G prefix on a number denotes a groundwater scheme, and the R prefix denotes a river scheme. Schemes which are not preferred alternatives for development of a resource have the same number as the preferred alternative, with a lower case letter added.

3. Map reference:

To locate a scheme from its map reference, find the upper case letter on the south boundary of Map A1, find the lower case letter on the west boundary, then find the box where lines drawn across the map from the two letters would intersect. The symbol marking the position of the scheme will be found within that box, and its scheme number will be printed close by.

4. Map (upper left of panel):

Shows the major components of the scheme. Existing scheme components are shown with solid symbols and solid lines. Proposed scheme components are shown with open symbols and dashed lines. The base map is a selection of features from the 1:250 000 Topographic Survey map series produced by Department of Lands and Surveys, W.A. presented at a scale of 1:200 000.

5. Scheme:

Brief description of the function of the scheme.

6. Special Notes:

Significant features of the scheme, and in particular, any specific environmental concerns associated with the scheme.

7. Status of Option:

'Existing' - scheme is part of the existing MWS.

'Preferred alternative' - scheme is the option currently preferred by the Water Authority for future development of the particular water resource. Note that for all future proposals the alternative of 'do-nothing' is available for consideration.

'Further investigation is required' - the option has been proposed after a preliminary assessment, but more efficient schemes may be devised with more detailed study.

Where an option is not the preferred alternative, a brief reason is given.

8. Land Use:

Categories of land use are compatible with titles in Tables in Appendix B. The land uses listed are those which occupy major areas within the catchment or resource area, or which may be significant in relation to the proposed scheme.

% Area:

Area of land use is given as percentage of catchment or resource area, to nearest 5%. Asterisk (*) marks significant land uses which occupy only a small area.

9. Catchment Area:

Area of catchment to site of development, not including areas of previous development upstream.

10. Streamflow:

Average annual streamflow at development site.
The average is calculated for the period of years shown in parentheses.

11. Reservoir area and Capacity:

Sizes for pipehead or pumpback schemes are only approximate and tend to be overestimated.

12. Resource Area:

Area of Public Water Supply Area (PWSA), Water Reserve (WR) or Groundwater Area (GA) associated with the groundwater scheme. The name of the relevant resource area is shown in parenthesis. Note that, with the exception of Gwelup PWSA, there is more than one scheme proposed for each resource area.

13. Quota:

Volume of water that, according to current estimates could be safely drawn from the resource each year, allowing for environmental constraints.

14. No. of Wells - Shallow and artesian groundwater:

The number of wells indicated are spaced along the collector mains shown for the scheme.

15. Yield Benefit:

Quoted for proposed schemes. The figure is the increase in System Yield which would result from adding the scheme to the system. For some groundwater schemes the yield benefit is greater than the quota because more efficient use is made of river schemes when such groundwater schemes are added to the system.

Water Used:

Quoted for existing schemes. The figure is the average annual usage of water the source would supply if the MWS was supplying the System Yield, i.e. was at its capacity.

16. Cost:

The cost per cubic metre of yield is the cost of delivering water from the scheme into the distribution system, assuming the MWS is supplying the System Yield. The cost is quoted in December #1987 dollars and includes capital costs converted to an annual charge at #6% interest rate, plus operating costs directly associated with the source.

17. Treatment:

A brief statement of the type of treatment that the development proposal has allowed for, based on the expected quality of the raw water.

18. Most likely date:

When the scheme has been included in the 'Most Likely' Source Development Timetable, its date of commissioning (coming into operation) is shown for easy reference. When a scheme is the preferred alternative for development of a resource but it is not expected to be required in the next 25 years, the date is shown as 'post #2012'.

Table A1 Existing and Possible Future River Schemes for the MWS

	MAP REF	SCHEME No.	MAIN DAMS	MAP REF	SCHEME No.	UPPER DAMS	MAP REF	SCHEME No.	PIPEHEADS
EXISTING	F1	R1	Canning				Eh	R8	Nth Dandalup
	F1	R2	Churchmans				Fi	R9	Serpentine
	Gn	R3	Helena						
	Fi	R4	Serpentine						
	Ff	R5	Sth Dandalup						
	Fm	R6	Victoria						
	Fk	R7	Wungong						
POSSIBLE FUTURE	Ea	R12	Harvey	Hn	R13b	Helena Upper Dam (Helena R.)	Eg	R18	Conjurunup
	Gn	R13	Helena Res. Raised				Ep	R19	Ellen
	Fn	R13a	Helena Lower Dam	Hm	R13c	Helena Upper Dam (Darkin R.)			
	Eh	R14	Nth Dandalup	Gk	R17	Sth Canning			
	Fm	R15	Victoria						
	Fp	R16	Wooroloo						
	F1	R17a	Canning Dam Raised						
	Eg	R18a	Conjurunup Dam						
	Ef	R29b	Marrinup Dam						
	Ee, Hc	R30a	Murray Dam outside Lane-Poole Reserve						
	Ee, Hc	R30b	Murray Two Dams						
	Ee	R30c	Murray Single Dam						

Table A1 (continued)

MAP REF	SCHEME No.	PUMPBACKS	MAP REF	SCHEME No.	ADDITIONAL PIPELINES
G1	R10	Kangaroo Gully			
Fn	R11	Lower Helena			
F1	R20	Araluen	Fn	R33	Mundaring Integration
Fm	R21	Bickley	Eh	R34	North Dandalup Mains Amplification
Fq	R22	Brockman	Ek	R35	Wungong Outlet Amplification
Ei	R23	Dirk			
Ei	R23a	Dirk Pumpback to Serpentine Pipehead			
Fj	R24	Gooralong			
Fo	R25	Jane			
Hr	R26	Julimar			
Ei	R27	Lower Serpentine Stage II			
Ei	R27a	Lower Serpentine Single P/B			
Eg	R28	Lower South Dandalup			
Ef	R29	Marrinup (Site 1)			
Ef	R29a	Marrinup (Site 2)			
Gd	R30	Murray Tributaries			
Gq	R31	Red Swamp			
Fo	R32	Susannah			


Table A2 Existing and Possible Future Groundwater Schemes for the MWS

	MAP REF	SCHEME No.	GROUNDWATER SCHEMES	No. OF WELLS	
				Shallow G'water	Artesian (Treated)
EXISTING	Co	G1	Gwelup	12	5
	Dl	G2	Jandakot	15	2
	Do	G3	Mirrabooka	34	5
	Dq	G4	Wanneroo	24	8
POSSIBLE FUTURE	Bt	G10	Barragoon Stage I	12	2
	Bt	G11	Barragoon Stage II	11	2
	Ek, Ej, Eg	G12	Cockleshell Gully Artesian	-	3
	Dh	G13	Dandalup	20	25
	Ep	G14	East Mirrabooka Stage III	4	-
	<u>Br (Map 4)</u> <u>(only)</u>	<u>G34</u>	<u>Eglinton</u>	<u>14</u>	<u>2</u>
	Dl	G15	Jandakot Stage II	15	2
	Dk	G16	Jandakot South Stage I	7	2
	Dk	G17	Jandakot South Stage II	7	1
	Di	G18	Karnup	20	15
	Ep	G19	Lexia	15	-
	Cq	G20	Pinjar Stage I	<u>#9</u>	<u>#5</u>
	#	#	#	#	#
	Cq	G21	Pinjar Stage II	<u>#9</u>	<u>#3</u>
	Cq	G22	Pinjar Stage III	<u>#10</u>	<u>#2</u>
	<u>Bq (Map 4)</u> <u>(only)</u>	<u>G33</u>	<u>Quinns</u>	<u>14</u>	-
	<u>As (Map 4)</u> <u>(only)</u>	<u>G35</u>	<u>Two Rocks/Yanchep</u>	<u>14</u>	<u>2</u>
	<u>Cp (Map 4)</u> <u>(only)</u>	<u>G32</u>	<u>Whitfords</u>	<u>12</u>	-
	Cs	G23	Yeal Stage I	12	2
	Cs	G24	Yeal Stage II	12	2

Table A2 (continued)

MAP REF	SCHEME No.	OTHER ARTESIAN WELLS (Untreated)	No. OF WELLS
Cn	G5	Bold Park	2
Cm	G6	Melville	1
Do	G7	Mirrabooka	1
Dn	G8	Mt Eliza	6
Do	G9	Yokine	4
C1	G25	Hamilton Hill	1
D1	G26	Lake Thomson	1
Br	G27	McNess East	1
Cj	G28	Tamworth	1
Cp	G29	Wanneroo	1
Co	G30	Whitfords	1
Bs	G31	Yanchep	1

The map "Darling System Land Use"
was published in "Atlas of Natural Resources",
Darling System, Western Australia" by the
Department of Conservation and Environment
and is used with their kind permission

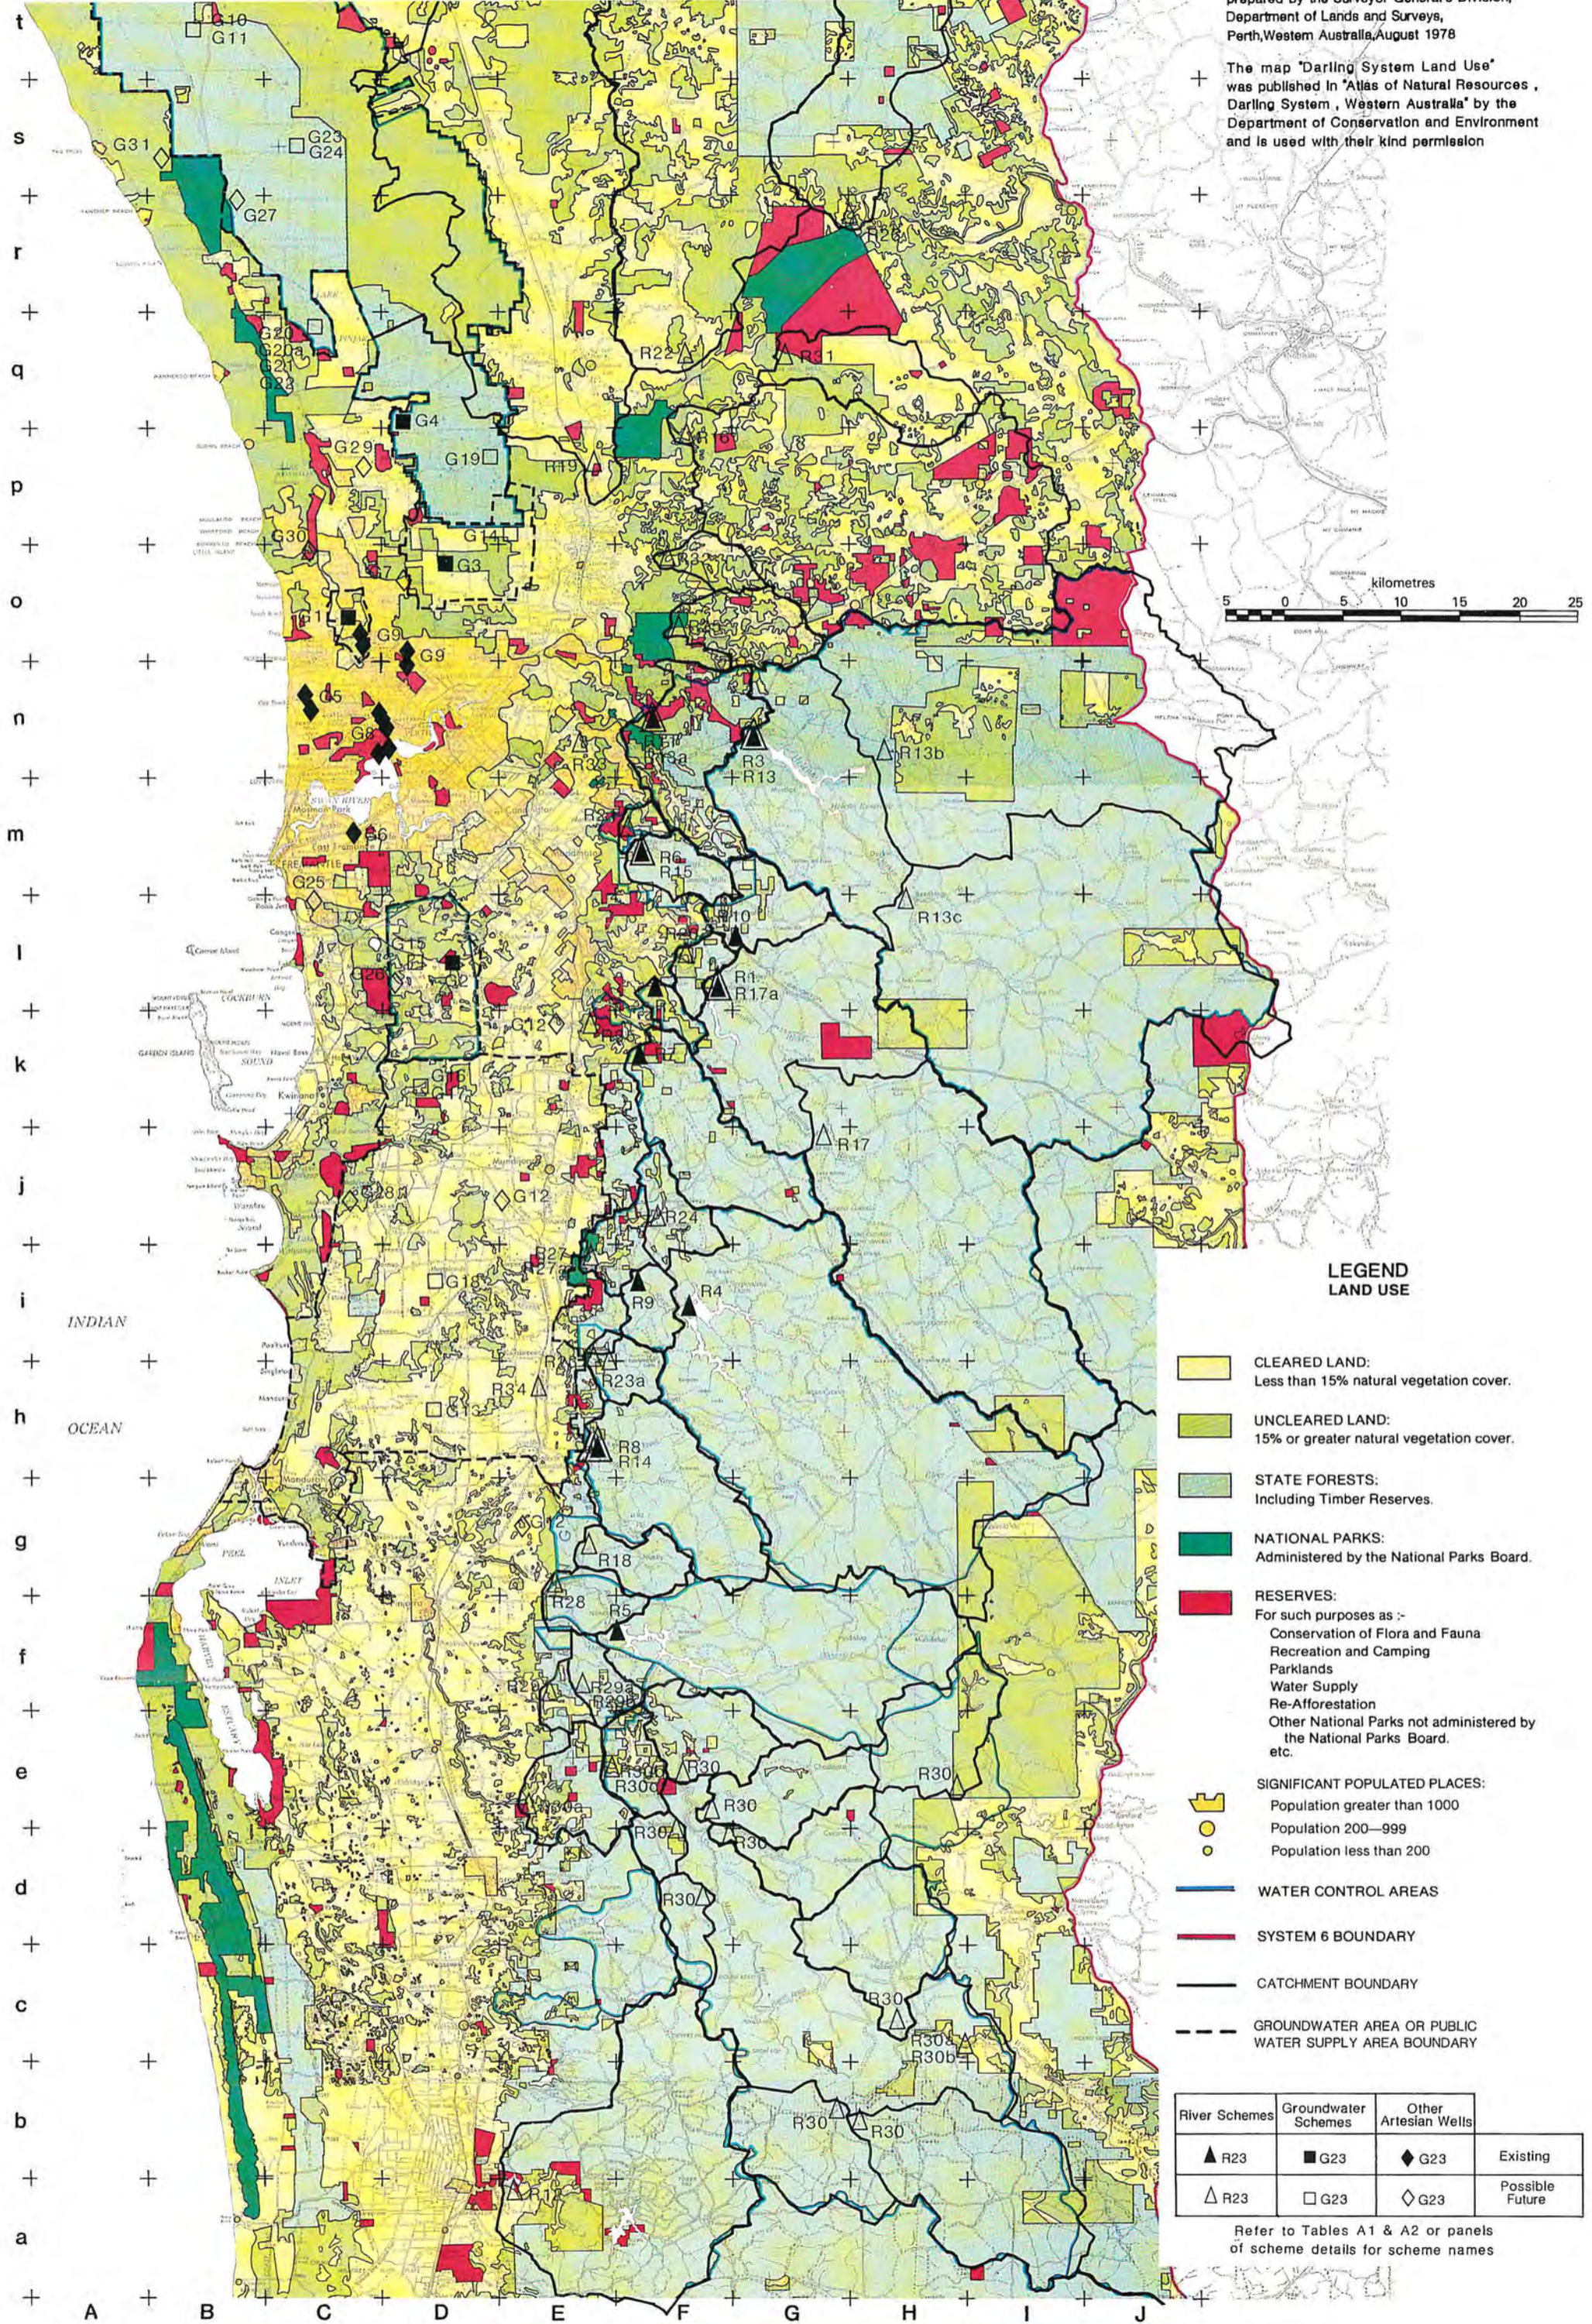

**LEGEND
LAND USE**


- CLEARED LAND:**
Less than 15% natural vegetation cover.
- UNCLEARED LAND:**
15% or greater natural vegetation cover.
- STATE FORESTS:**
Including Timber Reserves.
- NATIONAL PARKS:**
Administered by the National Parks Board.
- RESERVES:**
For such purposes as :-
Conservation of Flora and Fauna
Recreation and Camping
Parklands
Water Supply
Re-Afforestation
Other National Parks not administered by
the National Parks Board,
etc.
- SIGNIFICANT POPULATED PLACES:**
Population greater than 1000
 Population 200—999
 Population less than 200
- WATER CONTROL AREAS**
- SYSTEM 6 BOUNDARY**
- CATCHMENT BOUNDARY**
- GROUNDWATER AREA OR PUBLIC
WATER SUPPLY AREA BOUNDARY**

River Schemes	Groundwater Schemes	Other Artesian Wells	
▲ R23	■ G23	◆ G23	Existing
△ R23	□ G23	◇ G23	Possible Future

Refer to Tables A1 & A2 or panels
of scheme details for scheme names

WATER SUPPLY SCHEME LOCATIONS and LAND USE

R3 HELENA RESERVOIR

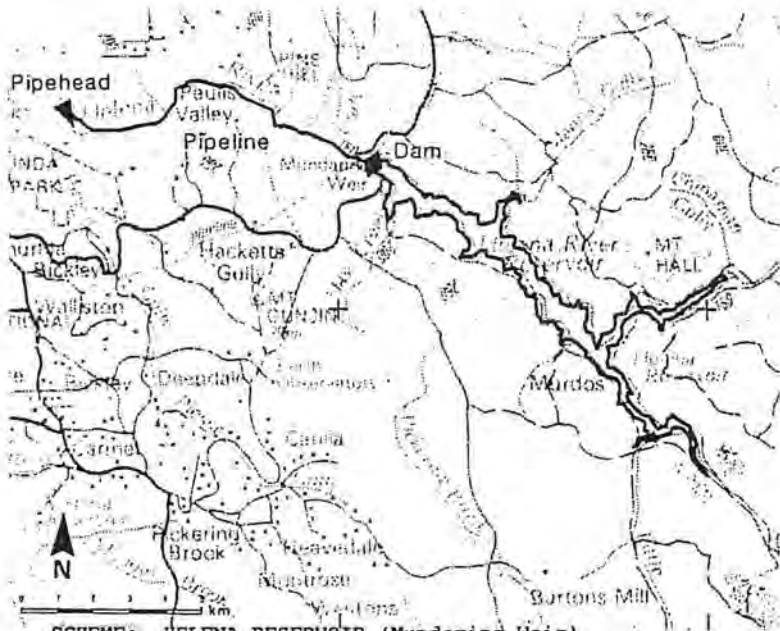

SCHEME: HELENA RESERVOIR (Mundaring Weir).
Principally supplies water for the G&AWS System but also contributes to the MWS. Receives water from L. Helena Pumpback (R11).

SPECIAL NOTES: Famous for being originally constructed by C.Y. O'Connor to supply the Goldfields. A museum is established in the old pumping station. Scheme R13 proposes to raise Mundaring Weir.

STATUS OF OPTION: Existing.

Map reference Gn

Catchment Area
1482 sq.km

Streamflow (1947-86)
38.3 mill.cu.m/yr

Reservoir
Area
761 ha
Capacity
77.1 mill.cu.m

Water used
22.3 mill.cu.m/yr


Cost
6.6 cents/cu.m

Treatment
Disinfection

Most likely date
Existing

Land use	% of area
Forest	95
Pasture	5

R4 SERPENTINE DAM

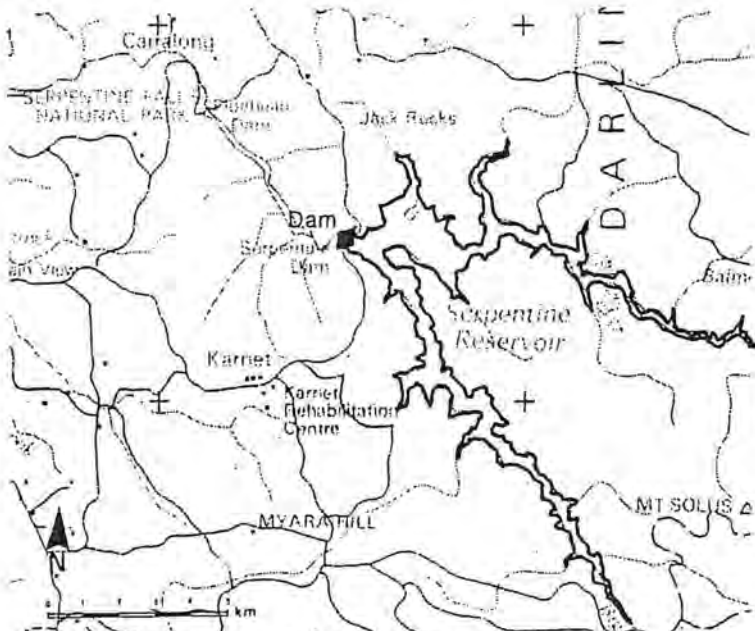

SCHEME: SERPENTINE MAIN DAM releases to the pipehead dam downstream (R9) for entry to the distribution system. (Cost includes Serpentine Pipehead)

SPECIAL NOTES: Bauxite mining in the catchment is planned within 25 years. Schemes R23, R24, R27 and R27a are proposals to pumpback to Serpentine Reservoir.

STATUS OF OPTION: Existing.

Map reference Fi

Catchment Area
660 sq.km

Streamflow (1911-80)
72.4 mill.cu.m/yr

Reservoir
Area
1280 ha
Capacity
194.5 mill.cu.m

Water used
63.6 mill.cu.m/yr

Cost
6.8 cents/cu.m

Treatment
Nil


Most likely date
Existing

Land use	% of area
Forest	95
Pasture	*

Existing Works shown as solid symbols and lines.
Proposed Works shown as open symbols and dashed lines.

* small but significant area

R7 WUNGONG DAM

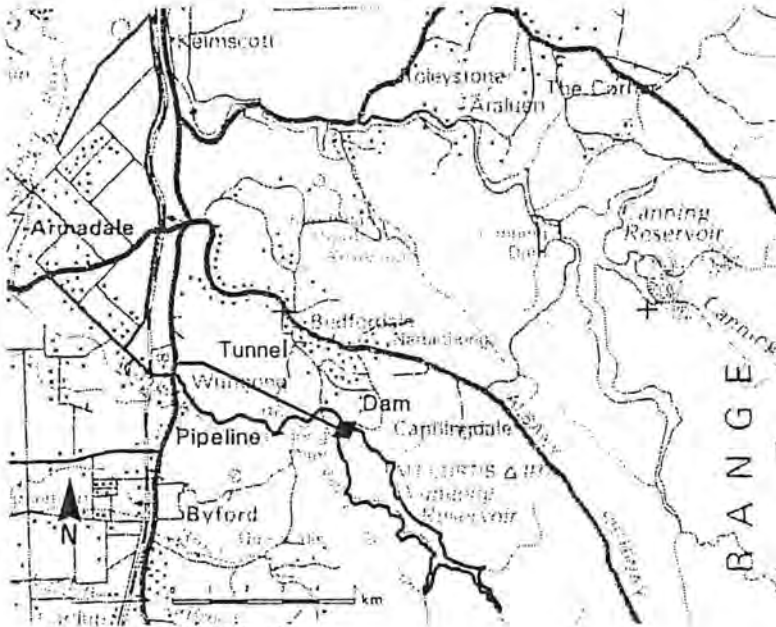

SCHEME: WUNGONG DAM.


SPECIAL NOTES: Bauxite mining has occurred in the catchment. Scheme R35 is proposed to increase the outlet capacity of Wungong Dam.

STATUS OF OPTION: Existing.

Map reference	Fk
Catchment Area	130 sq.km
Streamflow (1947-86)	25.6 mill.cu.m/yr
Reservoir	
Area	330 ha
Capacity	60 mill.cu.m
Water used	20.9 mill.cu.m/yr
Cost	17.8 cents/cu.m
Treatment	Disinfection
Most likely date	Existing

Land use	% of area
Forest	100

R8 NORTH DANDALUP PIPEHEAD

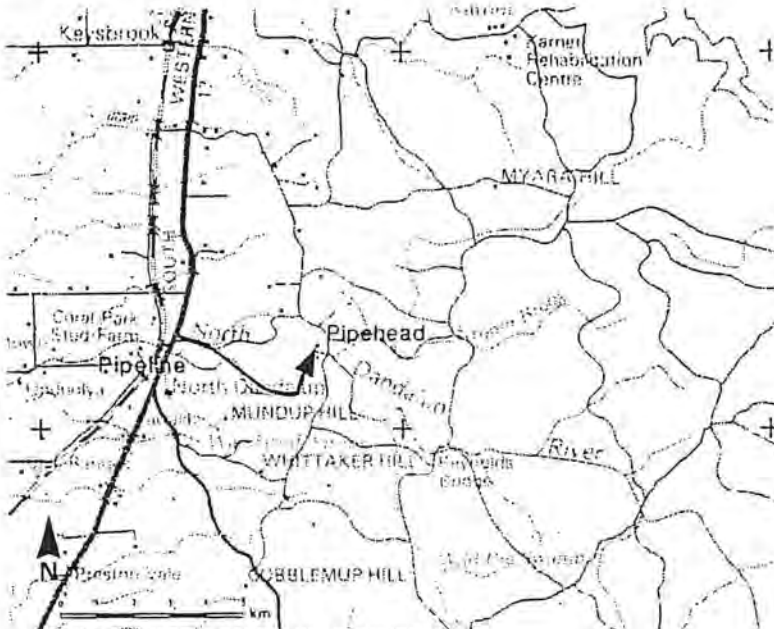

SCHEME: NORTH DANDALUP PIPEHEAD.

SPECIAL NOTES: Scheme R14 is a proposal to to replace this pipehead with a main dam.

STATUS OF OPTION: Existing.


Map reference	Eh
Catchment Area	153 sq.km
Streamflow (1947-86)	28.0 mill.cu.m/yr
Reservoir	
Area	1 ha
Capacity	0.02 mill.cu.m
Water used	11.3 mill.cu.m/yr
Cost	2.2 cents/cu.m
Treatment	Disinfection
Most likely date	Existing

Land use	% of area
Forest	100

Existing Works shown as solid symbols and lines.
Proposed Works shown as open symbols and dashed lines.

* small but significant area

R9 SERPENTINE PIPEHEAD

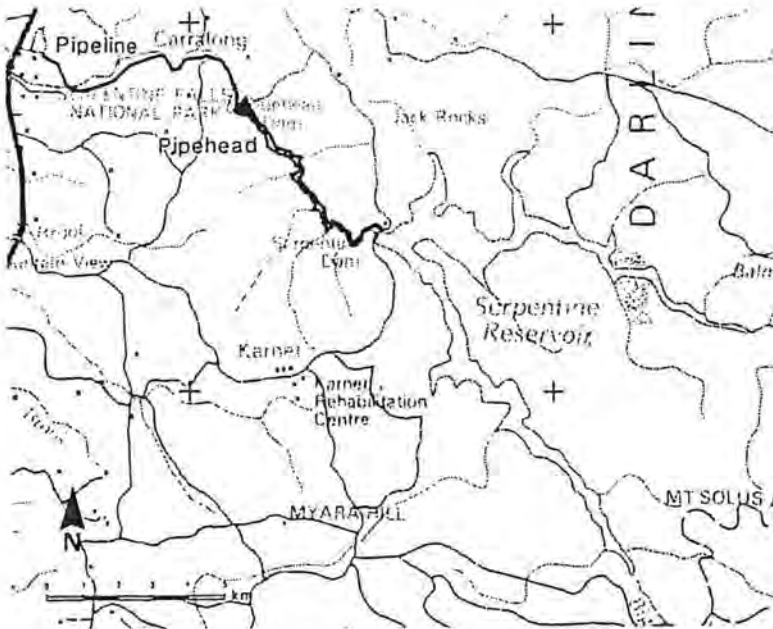

SCHEME: SERPENTINE PIPEHEAD.
Functions with Serpentine Dam (R4).


SPECIAL NOTES: The reservoir is surrounded by System 6 reserves M86 and M87.

Map reference	Fi 0
Catchment Area	29 sq.km
Streamflow (1911-80)	4.8 mill.cu.m/yr
Reservoir Area	61 ha
Capacity	3.1 mill.cu.m
Water used	2.8 mill.cu.m/yr
Cost	see Scheme R4
Treatment	Disinfection
Most likely date	Existing

Land use	% of area
Forest	100

STATUS OF OPTION: Existing.

R10 KANGAROO GULLY DIVERSION

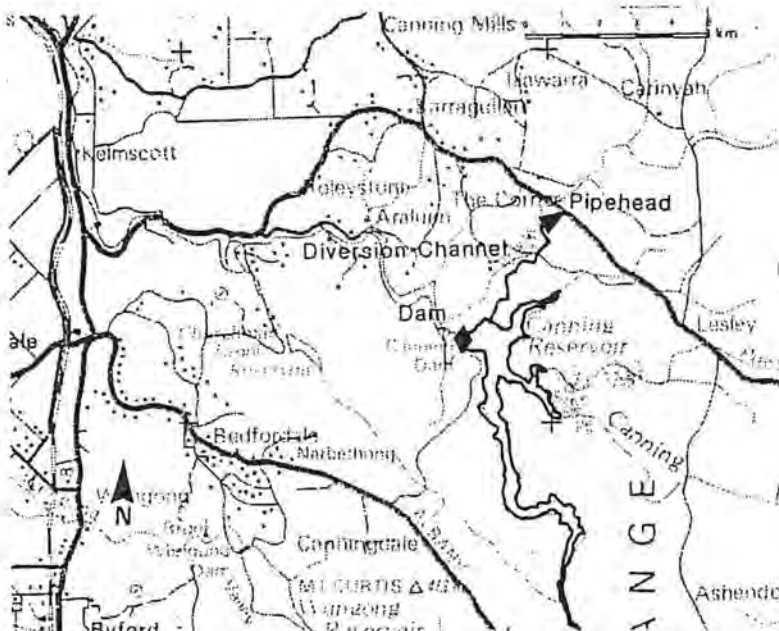

SCHEME: KANGAROO GULLY DIVERSION to Canning Dam (R1) operates in a similar manner to a pumpback.

SPECIAL NOTES:

Map reference	G1
Catchment Area	54 sq.km
Streamflow (1911-80)	5.3 mill.cu.m/yr
Reservoir Area	1 ha
Capacity	0.02 mill.cu.m
Water used	3.5 mill.cu.m/yr
Cost	Scheme R1
Treatment	Retention in Canning Reservoir
Most likely date	Existing


Land use	% of area
Forest	95
Horticulture	*

STATUS OF OPTION: Existing.

Existing Works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

R11 LOWER HELENA PUMPBACK

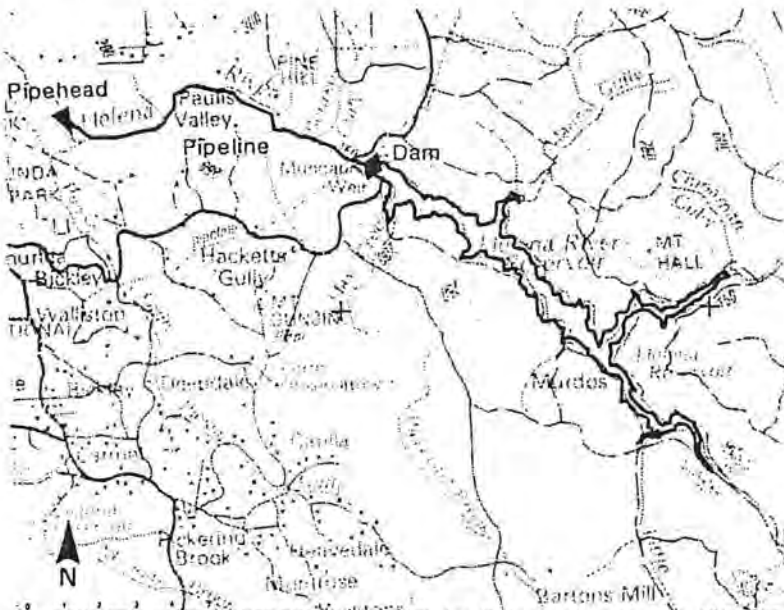

SCHEME: LOWER HELENA PUMPBACK to Helena Reservoir (R3). Also used to transfer water from the MWS distribution system to Helena Reservoir when required by the Mundaring Integration Scheme (see R33).

SPECIAL NOTES: Catchment contains part of Kalamunda townsite and Pickering Brook orchards.

STATUS OF OPTION: Existing

Map reference Fn

Catchment Area
118 sq.km

Streamflow (1947-86)
18.0 mill.cu.m/yr

Reservoir
Area
4 ha
Capacity
0.13 mill.cu.m

Water used
9.1 mill.cu.m/yr


Cost
18.7 cents/cu.m

Treatment
Retention in Helena Reservoir

Most likely date
Existing

Land use	% of area
Forest	70
Horticulture	8
Special rural	19
Urban	3

R12 HARVEY RIVER DAM

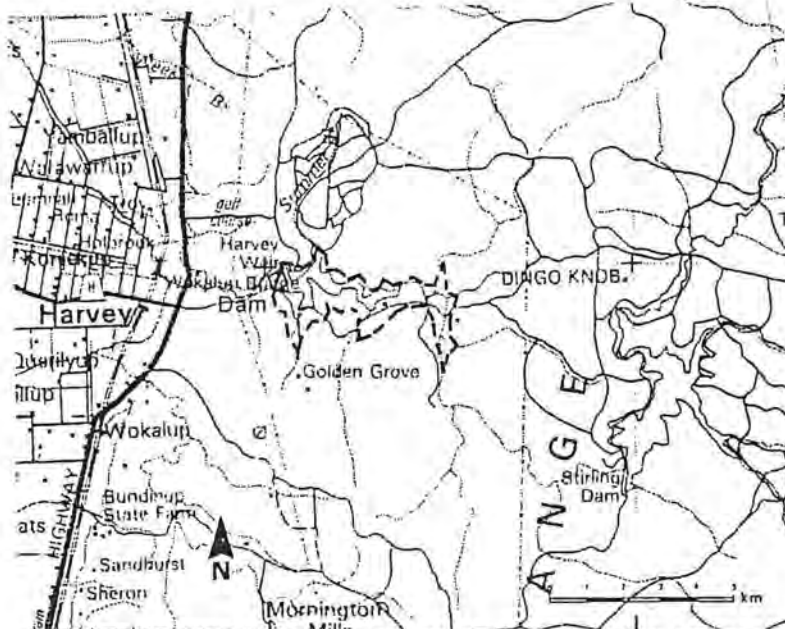

SCHEME: HARVEY RIVER DAM redevelopment including transfer of water to Mandurah area.

SPECIAL NOTES: Harvey Dam will continue to provide water for the Harvey townsite and for irrigation purposes. The quoted yield is additional to a current use of 56 mill.cu.m/yr. This cost assumes a supply of water to Forrestdale for distribution into the MWS system.

STATUS OF OPTION: Currently preferred option, further investigation is required.

Map reference Ea

Catchment Area
353 sq.km

Streamflow (1911-80)
106.4 mill.cu.m/yr

Reservoir
Area
600 ha
Capacity
140 mill.cu.m

Yield benefit
40.0 mill.cu.m/yr

Cost
46.0 cents/cu.m
(see SPECIAL NOTES)

Treatment
Disinfection


Most likely date
Post 2012

Land use	% of area
Forest	75
Pasture	25

Existing Works shown as solid symbols and lines.
Proposed Works shown as open symbols and dashed lines.

* small but significant area

R13 HELENA RES. RAISED DAM

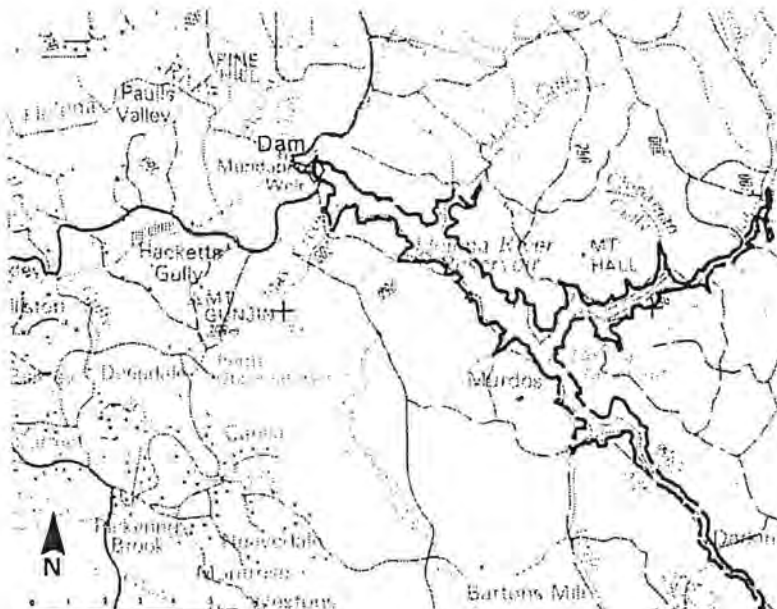

SCHEME: HELENA RESERVOIR RAISED by 12 metres. (R3) capacity increased by raising Mundaring Weir.

SPECIAL NOTES: Mundaring Weir has been raised before. In its recommendations to Government on the 'Next Major Public Water Supply Source for Perth (Post 1992)' ERMP, the EPA has stated that this scheme is environmentally acceptable. Yield benefit as next major source i.e. before more pumpbacks added to system would be 7.5 mill.cu.m/yr at a cost of 25.3 cents/cu.m. STATUS OF OPTION: Preferred option.

Map reference Gn

Catchment Area
1482 sq.km

Streamflow (1947-86)
38.3 mill.cu.m/yr

Reservoir
Area
1400 ha
Capacity
200 mill.cu.m


Yield benefit
additional
10.0 mill.cu.m/yr
Cost
19.0 cents/cu.m

Treatment
Disinfection

Most likely date
2000/01

Land use % of area
Forest 95
Pasture 5

R13a HELENA LOWER DAM

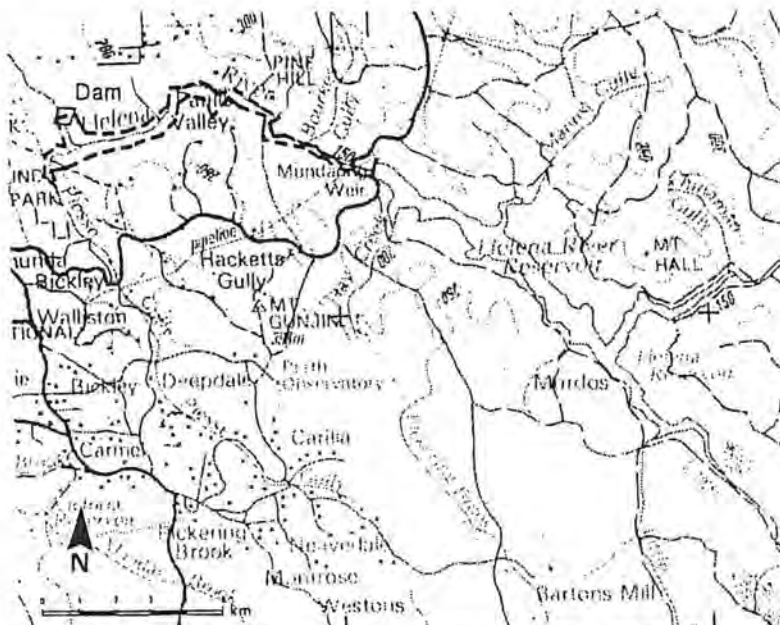

SCHEME: HELENA LOWER DAM at the site of the existing Lower Helena Pumpback (R11).

SPECIAL NOTES:

STATUS OF OPTION: Not preferred due to high cost compared to raising Helena Reservoir.

Map reference Fn

Catchment Area
118 sq.km

Streamflow (1911-80)
18.9 mill.cu.m/yr

Reservoir
Area
390 ha
Capacity
80 mill.cu.m

Yield benefit
13.5 mill.cu.m/yr
Cost
66.5 cents/cu.m

Treatment
Disinfection


Most likely date
N/A

Land use % of area
Forest 70
Horticulture 8
Special rural 19
Urban 3

Existing Works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

R13b HELENA UPPER DAM (HELENA)

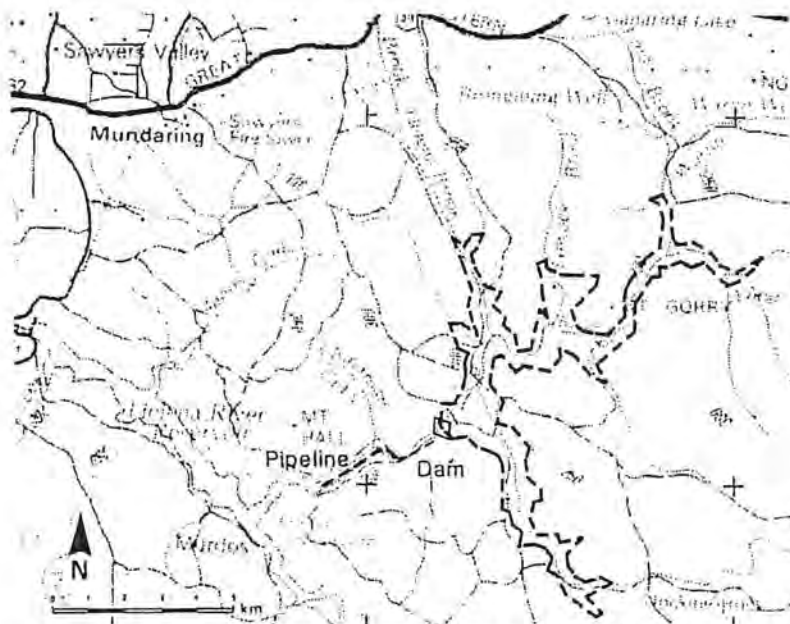

SCHEME: UPPER HELENA DAM on Helena River with pumping from Helena Reservoir (R3) into upper reservoir.

SPECIAL NOTES: Pine plantations at present in part of reservoir basin. Stored water likely to have high salt content due to clearing in catchment for agriculture and reservoir basin.

STATUS OF OPTION: Not preferred due to high cost compared to raising Helena Reservoir.

Map reference Hn

Catchment Area
583 sq.km

Streamflow (1911-80)
13.1 mill.cu.m/yr

Reservoir
Area
1700 ha
Capacity
247 mill.cu.m

Yield benefit
8.9 mill.cu.m/yr


Cost
40.2 cents/cu.m

Treatment
Nil

Most likely date
N/A

Land use	% of area
Forest	95
Pasture	5

R13c HELENA UPPER DAM (DARKIN)

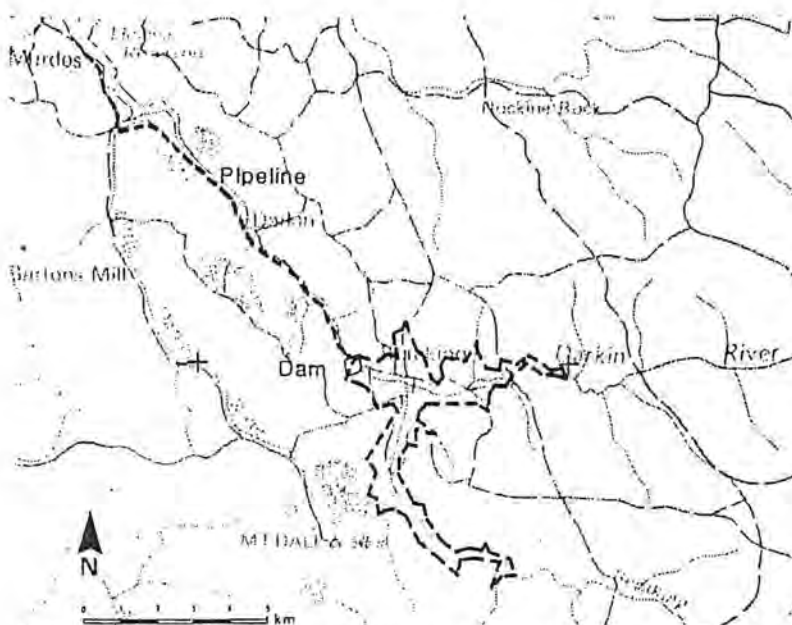

SCHEME: UPPER HELENA DAM on Darkin River with pumping from Helena Reservoir (R3) into upper reservoir.

SPECIAL NOTES: Geological problems at damsite. Conservation Reserve adjacent to proposed reservoir. Effects on salinity due to clearing reservoir basin have not been investigated.

STATUS OF OPTION: Not preferred due to high cost compared to raising Helena Reservoir.

Map reference Hm

Catchment Area
664 sq.km

Streamflow (1911-80)
5.7 mill.cu.m/yr

Reservoir
Area
914 ha
Capacity
<200 mill.cu.m

Yield benefit
<12 mill.cu.m/yr

Cost
38.3 cents/cu.m

Treatment
Nil


Most likely date
N/A

Land use	% of area
Forest	100
Pasture	*

Existing Works shown as solid symbols and lines.
Proposed Works shown as open symbols and dashed lines.

* small but significant area

R14 NORTH DANDALUP DAM

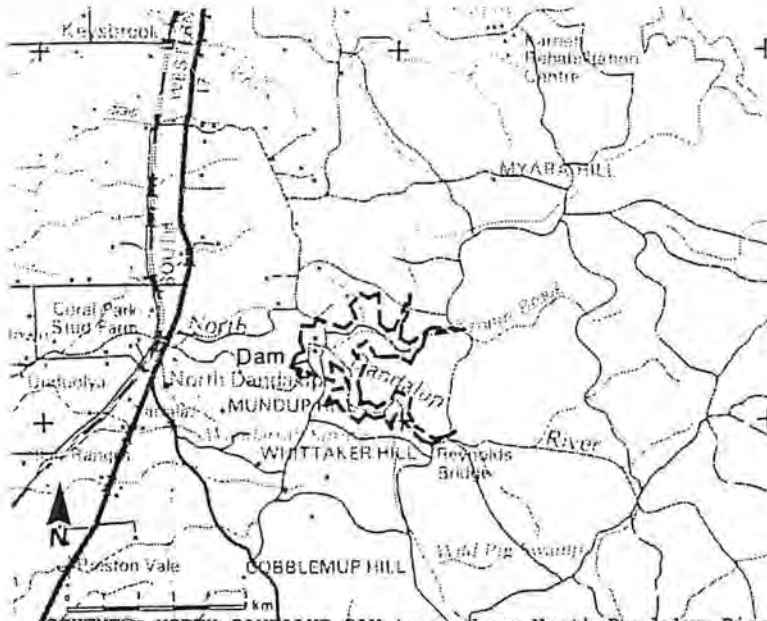

SCHEME: NORTH DANDALUP DAM to replace North Dandalup Pipehead (R8). Uses existing pipe from pipehead.

SPECIAL NOTES: Yield is additional to the yield of the existing pipehead. Some of proposed works at damsite would lie within System 6 reserve C49. In its recommendations to Government on the 'Next Major Public Water Supply Source for Perth (Post 1992)' ERMP, The EPA has stated that this scheme is environmentally acceptable, and that the Water Authority should proceed with preparing its environmental management proposals.

STATUS OF OPTION: Preferred option.

Map reference	Eh
Catchment Area	153 sq.km
Streamflow (1947-86)	28.0 mill.cu.m/yr
Reservoir	
Area	500 ha
Capacity	75 mill.cu.m
Yield benefit	11.2 mill.cu.m/yr
Cost	30.0 cents/cu.m
Treatment	Disinfection
Most likely date	1996/97
Land use	% of area
Forest	100

R15.21 VICTORIA/BICKLEY REDEVELOPMENT



SCHEME: VICTORIA /BICKLEY REDEVELOPMENT.
Pumpback from below join of Munday and Bickley Brooks to new larger reservoir.

SPECIAL NOTES: Bickley catchment is at present a declared Water Reserve, but does not contribute to MWS. Pumpback site selected to avoid damage to historic bridge on Hardinge Rd alignment.


STATUS OF OPTION: Preferred option.

Map reference	Fm
Catchment Area	52 sq.km
Streamflow (1911-80)	7.9 mill.cu.m/yr
Reservoir	
Area	75 ha
Capacity	7 mill.cu.m
Yield benefit	6.0 mill.cu.m/yr
Cost	25.0 cents/cu.m
Treatment	Pump-back water detained in new res. Draw from reservoir disinfected
Most likely date	1995/96
Land use	% of area
Forest	95
Horticulture	5
Pasture	*

Existing Works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

R16 WOOROLOO BROOK DAM

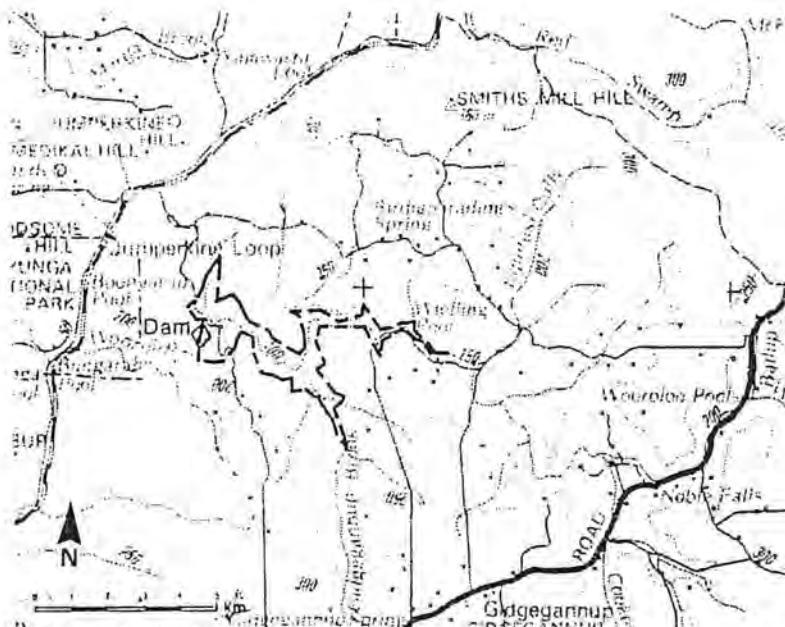

SCHEME: WOOROLOO BROOK DAM.


SPECIAL NOTES: Outlet pipe route from dam uncertain. Could receive pumpback water from schemes R22, R26 and R31.

STATUS OF OPTION: Currently preferred option, further investigation is required.

Map reference	Fp
Catchment Area	536 sq.km
Streamflow (1911-85)	42.8 mill.cu.m/yr
Reservoir	
Area	360 ha
Capacity	180 mill.cu.m
Yield benefit	26.6 mill.cu.m/yr
Cost	68.0 cents/cu.m
Treatment	Full treatment & desalination
Most likely date	Post 2012

Land use	% of area
Forest	50
Pasture	50
Horticulture	*
Industrial	*
Special rural	*
Urban	*

R17 RAISE CANNING DAM

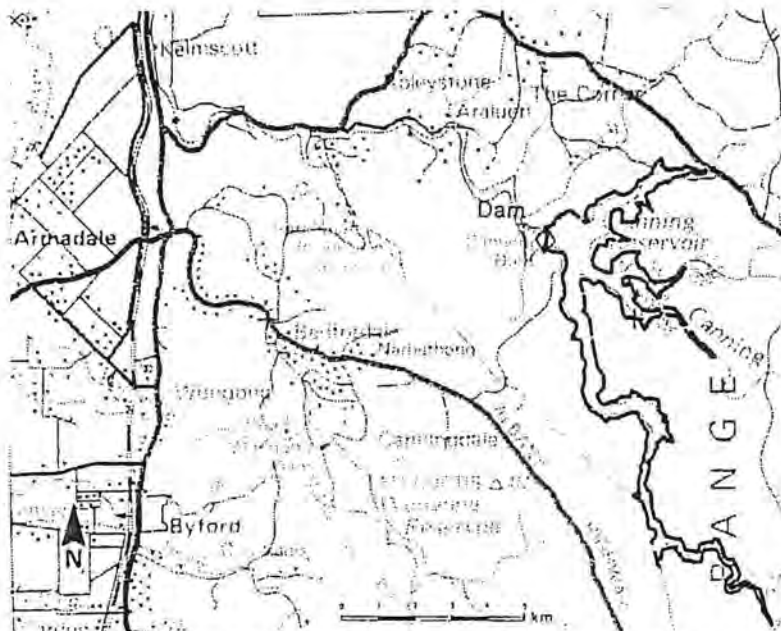

SCHEME: Canning Reservoir (R1) capacity increased by raising CANNING DAM by 11.6 metres.

SPECIAL NOTES: Extension of cleared area for enlarged reservoir basin is much less than clearing required for South Canning (R17). Extremity of southern arm extends into Monadnock Reserve (System 6 reserve C36). In its recommendations to Government on the 'Next Major Public Water Supply Source for Perth (Post 1992)' ERMP, the EPA stated that this scheme was environmentally acceptable.
STATUS OF OPTION: Preferred Option.


Map reference	F1
Catchment Area	727 sq.km
Streamflow (1911-80)	61.5 mill.cu.m/yr
Reservoir	
Area	990 ha
Capacity	170.5 mill.cu.m
Yield benefit	additional 9.8 mill.cu.m/yr
Cost	34.2 cents/cu.m
Treatment	Disinfection
Most likely date	Post 2012

Land use	% of area
Forest	100

Existing Works shown as solid symbols and lines.
Proposed Works shown as open symbols and dashed lines.

* small but significant area

R17a SOUTH CANNING DAM

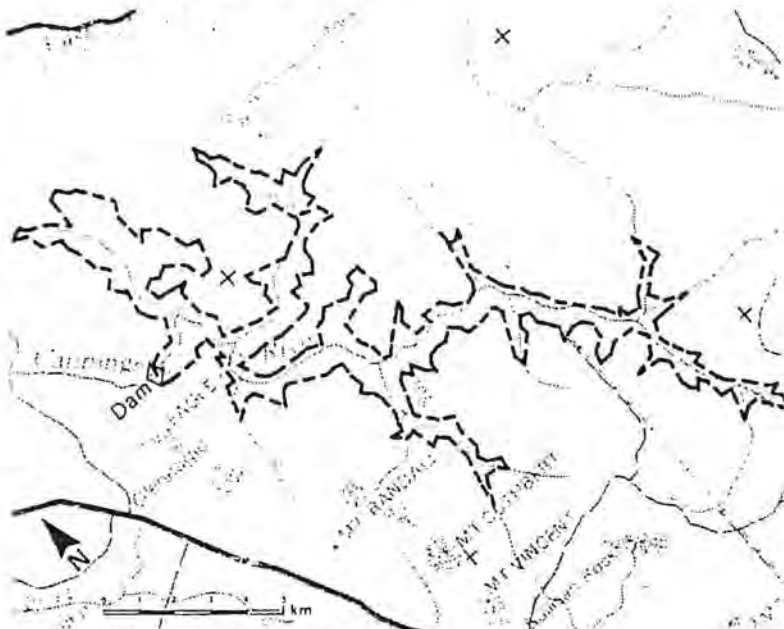


SCHEME: SOUTH CANNING DAM.
Upper dam to Canning Reservoir (R1).

SPECIAL NOTES: Increased salinity due to clearing reservoir basin and evaporation from reservoir have been given special consideration. Yield benefit is affected by position of scheme in the development timetable. If developed as next major source, yield benefit would be 11 mill.cu.m/yr, and extra yield would be developed by pumpback schemes R23, R24, R27 and R29.
STATUS OF OPTION: Rejected due to uncertainty of yield benefit when considering Climate change and possible salinity problems.

Map reference Gk
Catchment Area 495 sq.km
Streamflow (1911-80) 24 mill.cu.m/yr
Reservoir Area 2500 ha
Capacity 210 mill.cu.m
Yield benefit 14.6 mill.cu.m/yr
Cost 16.1 cents/cu.m
Treatment Nil
Most likely date N/A

Land use % of area
Forest 100

R18 CONJURUNUP PIPEHEAD

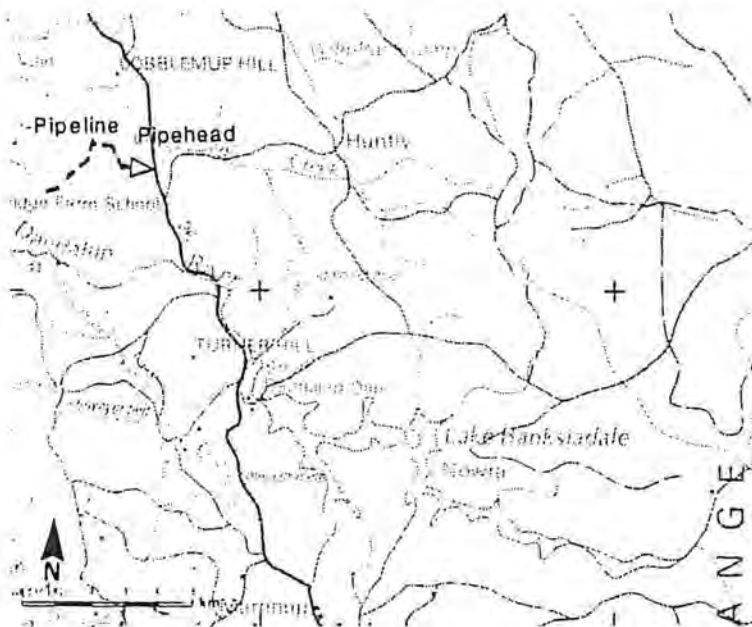

SCHEME: CONJURUNUP PIPEHEAD.

SPECIAL NOTES: This scheme is presently under review.

STATUS OF OPTION: Preferred option.


Map reference Eg
Catchment Area 39.2 sq.km
Streamflow (1947-86) 9.5 mill.cu.m/yr
Reservoir Area 10 ha
Capacity 100 thou.cu.m
Yield benefit 4.5 mill.cu.m/yr
Cost 10.0 cents/cu.m
Treatment Disinfection
Most likely date 1994/95

Land use % of area
Forest 100

Existing Works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

R18a CONJURUNUP DAM

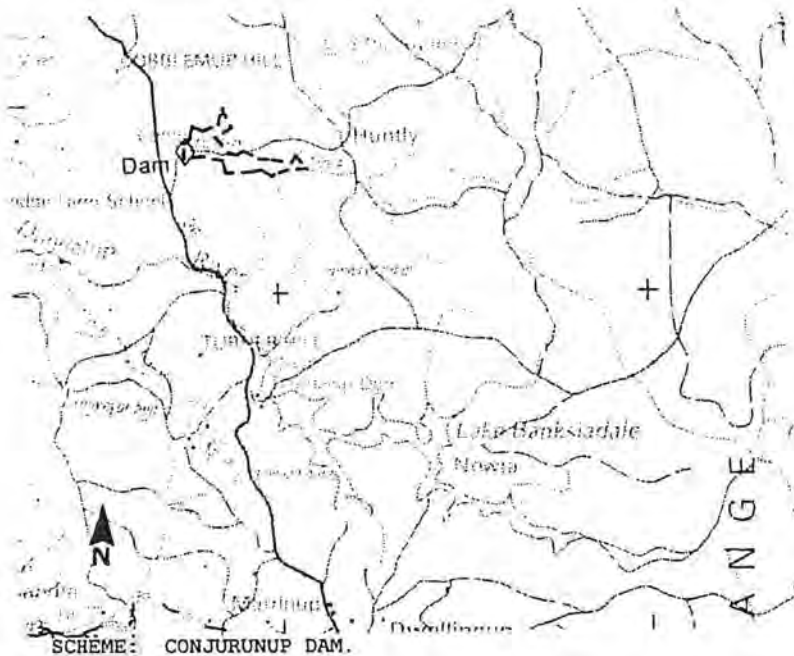


Map reference	Eg
Catchment Area	37 sq.km
Streamflow (1911-80)	10.5 mill.cu.m/yr
Reservoir	
Area	100 ha
Capacity	49 mill.cu.m
Yield benefit	8.2 mill.cu.m/yr
Cost	28.2 cents/cu.m
Treatment	Disinfection
Most likely date	N/A
Land use	% of area
Forest	100

SPECIAL NOTES:

STATUS OF OPTION: Not preferred due to high cost compared to Conjurunup Pipehead (R18). May replace pipehead when cost of alternative sources exceeds 28.2 cents/cu.m. This scheme is presently under review.

R19 ELLEN BROOK PIPEHEAD

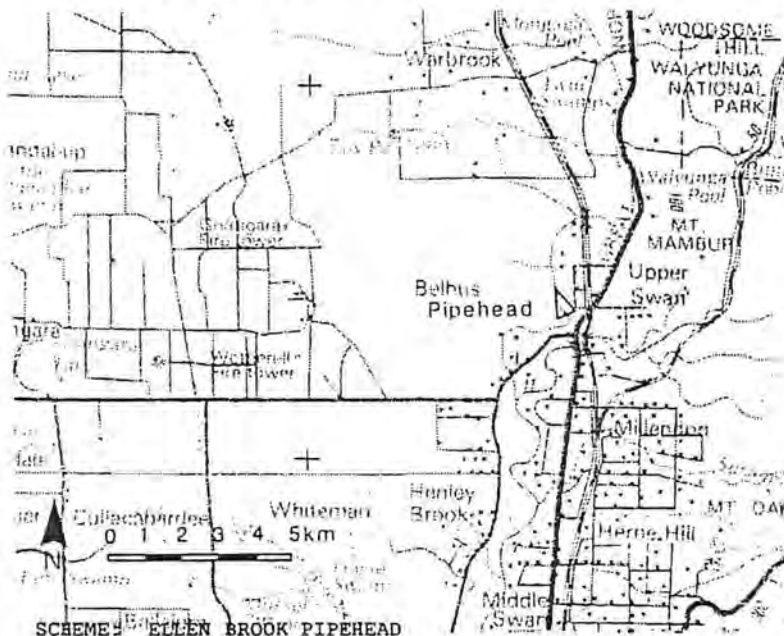

Map reference	Ep
Catchment Area	590 sq.km
Streamflow (1911-85)	26.2 mill.cu.m/yr
Reservoir	
Area	<40 ha
Capacity	110 thou.cu.m
Yield benefit	7.1 mill.cu.m/yr
Cost	41.0 cents/cu.m
Treatment	As for Groundwater Treatment
Most likely date	Post 2012
Land use	% of area
Forest	40
Pasture	20
Special rural	25
Horticulture	10
Urban	5
Industrial	*
Intensive animal husbandry	*


SPECIAL NOTES: Details of site for treatment have not been assessed. Design of pipehead will need sensitive consideration of nearby residential land.

STATUS OF OPTION: Currently preferred option, further investigation is required.

Existing Works shown as solid symbols and lines.
Proposed Works shown as open symbols and dashed lines.

* small but significant area

R20 ARALUEN PUMPBACK

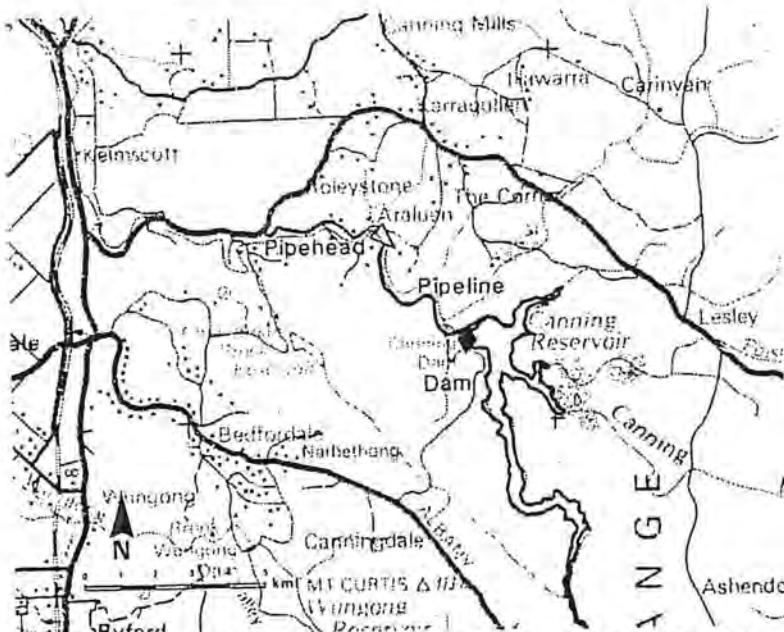

SCHEME: ARALUEN PUMPBACK to replace temporary pumpback to Canning Reservoir (R1).

SPECIAL NOTES: Located on Canning R. upstream of confluence with Stinton Ck. Includes overflows of Kangaroo Gully.

STATUS OF OPTION: Preferred option.

Map reference F1

Catchment Area
20.4 sq.km

Streamflow (1947-86)
3.5 mill.cu.m/yr

Reservoir
Area <5 ha
Capacity 55 thou.cu.m

Yield benefit
1.2 mill.cu.m/yr


Cost
29.0 cents/cu.m

Treatment
Detention in Canning Reservoir

Most likely date
2000/01

Land use	% of area
Forest	100
Pasture	*

R22 BROCKMAN RIVER PUMPBACK

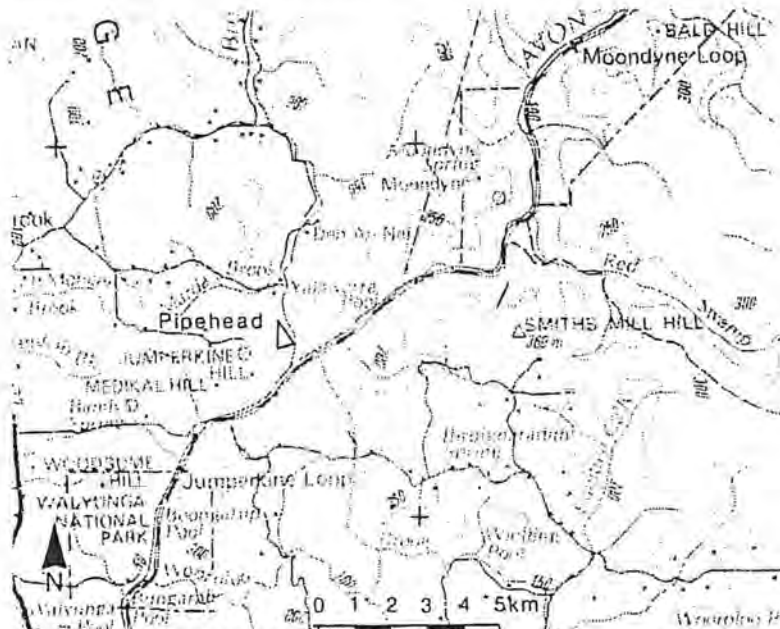

SCHEME: BROCKMAN RIVER PUMPBACK to Wooroloo Brook Dam (R16).

SPECIAL NOTES: Pipe route to Wooroloo Brook not yet known. Main dam option at site not preferred due to impact of reservoir on Chittering Valley. Pumpback dam approximately 300m upstream of confluence of Brockman and Avon Rivers. Wooroloo outlet main will require duplicating when Brockman comes on line.

STATUS OF OPTION: Currently preferred option. further investigation is required.

Map reference Fq

Catchment area
1510 sq.km

Streamflow (1911-85)
45.8 mill.cu.m/yr

Reservoir
Area 40 ha
Capacity 140 thou.cu.m

Yield benefit
15 mill.cu.m/yr

Cost
\$1.02 /cu.m

Treatment
Retention in Wooroloo Reservoir


Most likely date
Post 2012

Land use	% of area
Forest	60
Horticulture	5
Pasture	35
Urban	*

Existing Works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

R23 DIRK PUMPBACK

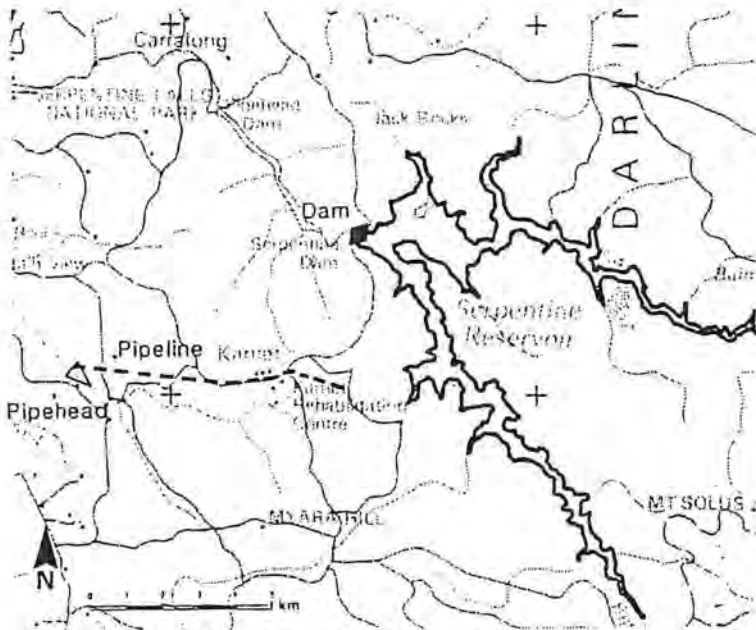

SCHEME: PUMPBACK from Dirk Brook to Serpentine Reservoir (R4).

SPECIAL NOTES: Catchment contains Karnet Rehabilitation Centre.

STATUS OF OPTION: Preferred option.

Map reference E1

Catchment area
30.7 sq.km

Streamflow (1947-86)
9.5 mill.cu.m/yr

Reservoir
Area <5 ha
Capacity <70 thou.cu.m

Yield benefit
3.5 mill.cu.m/yr


Cost
32.0 cents/cu.m

Treatment
Retention in
Serpentine
Reservoir

Most likely date
2006/07

Land use	% of area
Forest	85
Pasture	15
Horticulture	*
Industry	*
Urban	*

R23a DIRK PUMPBACK TO PIPEHEAD

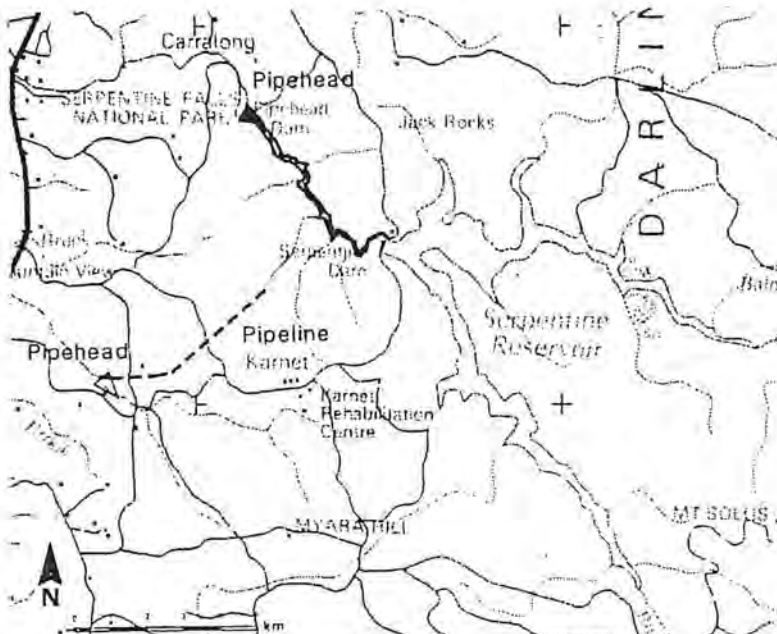

SCHEME: DIRK PUMPBACK from Dirk Brook to Serpentine Pipehead Reservoir (R9). Demonstrates a) alternative site and b) alternative pipe route.

SPECIAL NOTES: a) Alternative site has smaller catchment than R23. b) Pipe route is shortest possible, but discharged water flows through Conservation Reserve (M86) and retention time of water in pipehead reservoir may not be adequate.

STATUS OF OPTION: Not preferred.

a) Alternative site is less economic.

b) Alternative pipe route has environmental and operational disadvantages.

Map reference Ek

Catchment area
26.6 sq.km

Streamflow (1911-80)
7.7 mill.cu.m/yr

Reservoir
Area <5 ha
Capacity <70 thou.cu.m

Yield benefit
3.0 mill.cu.m/yr

Cost
30.7 cents/cu.m

Treatment
Retention in
Serpentine Pipehead
Reservoir

Most likely date
N/A


Land use	% of area
Forest	85
Pasture	15

Horticulture	*
Industry	*
Urban	*

Existing Works shown as solid symbols and lines.
Proposed Works shown as open symbols and dashed lines.

* small but significant area

R24 GOORALONG PUMPBACK

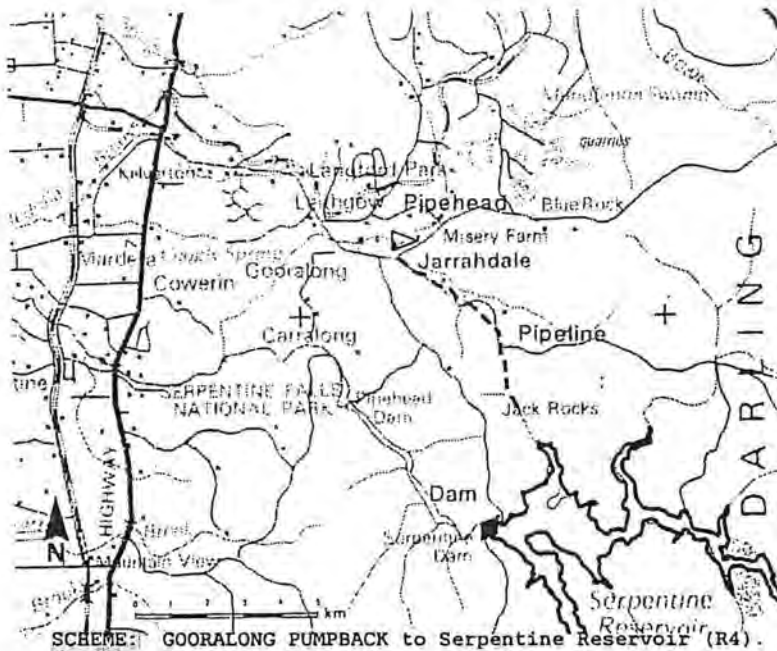

SPECIAL NOTES: Development of Lower Serpentine Catchment in conjunction with Lower Serpentine Pumpback (R27). A design objective will be to minimise flooding of local properties at pipehead dam site.

STATUS OF OPTION: Preferred option.

Map reference Fj

Catchment area
42.4 sq.km

Streamflow (1947-86)
9.0 mill.cu.m/yr

Reservoir
Area <20 ha
Capacity <70 thou.cu.m

Yield benefit
4.4 mill.cu.m/yr


Cost
14.0 cents/cu.m

Treatment
Retention in Serpentine Reservoir

Most likely date
1999/2000

Land use	% of area
Forest	90
Horticulture	5
Pasture	5

R25 JANE BROOK PIPEHEAD

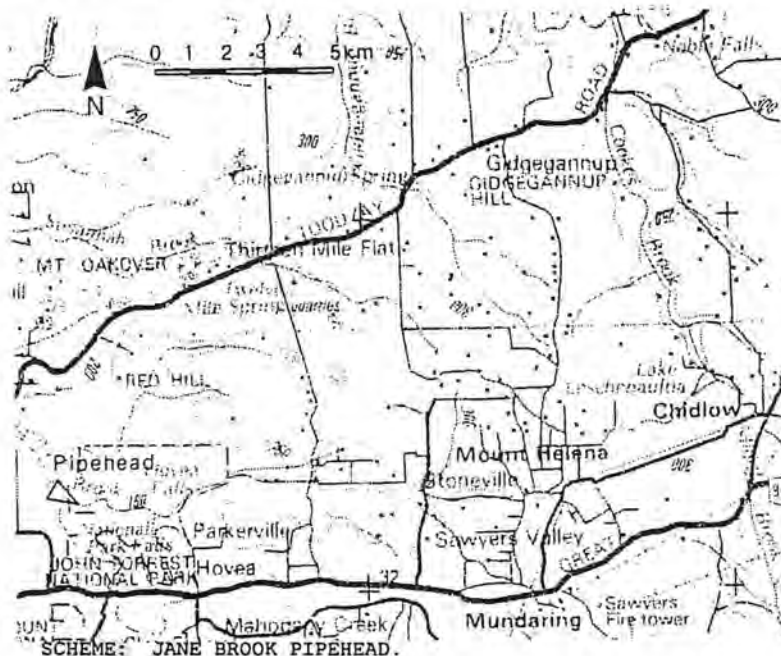

SPECIAL NOTES: Boosted pipehead from a site downstream of Rocky Pool, to the Mirrabooka GWTP. Design of pipehead will require sensitive consideration of nearby residential land.

STATUS OF OPTION: Preferred option. further investigation is required.

Map reference Fo

Catchment area
83 sq.km

Streamflow (1911-80)
14.8 mill.cu.m/yr

Reservoir
Area <5 ha
Capacity 72 thou.cu.m

Yield benefit
9.4 mill.cu.m/yr

Cost
26.0 cents/cu.m

Treatment
As for groundwater treatment


Most likely date
Post 2012

Land use	% of area
Spec. Rural	46
Forest	39
Urban	10
Horticulture	5

Existing Works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

R26 JULIMAR BROOK PUMPBACK

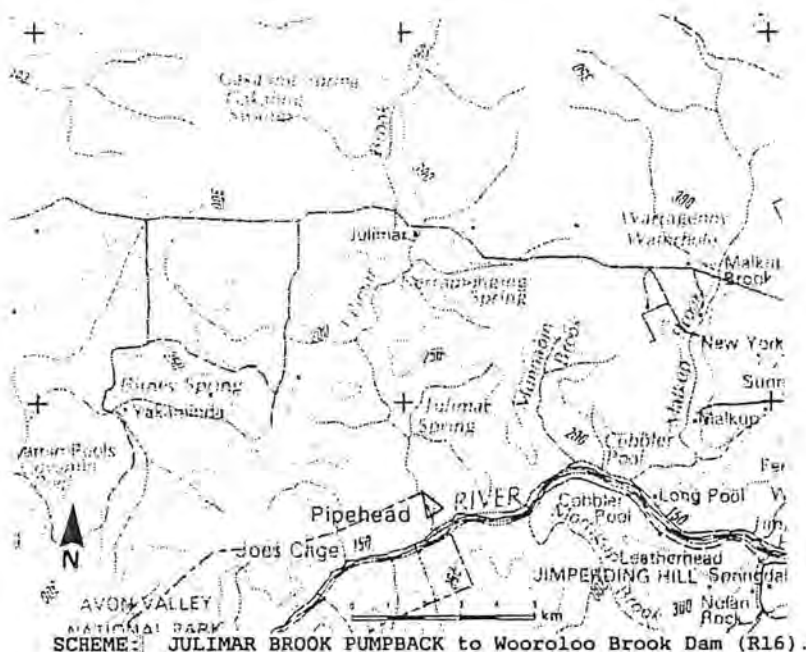


Map reference	Hr
Catchment area	179 sq.km
Streamflow (1911-80)	4.6 mill.cu.m/yr
Reservoir	
Area	3 ha
Capacity	28 thou.cu.m
Yield benefit	2 mill.cu.m/yr
Cost	100.4 cents/cu.m
Treatment	Retention in Wooroloo Reservoir
Most likely date	Post 2012
Land use	% of area
Forest	80
Pasture	20

SPECIAL NOTES: Pipe route to Wooroloo Dam not yet known. Cost includes full treatment and desalination of water drawn from Wooroloo Brook Reservoir.

STATUS OF OPTION: Currently preferred option, further investigation is required.

R27 LOWER SERPENTINE PUMPBACK

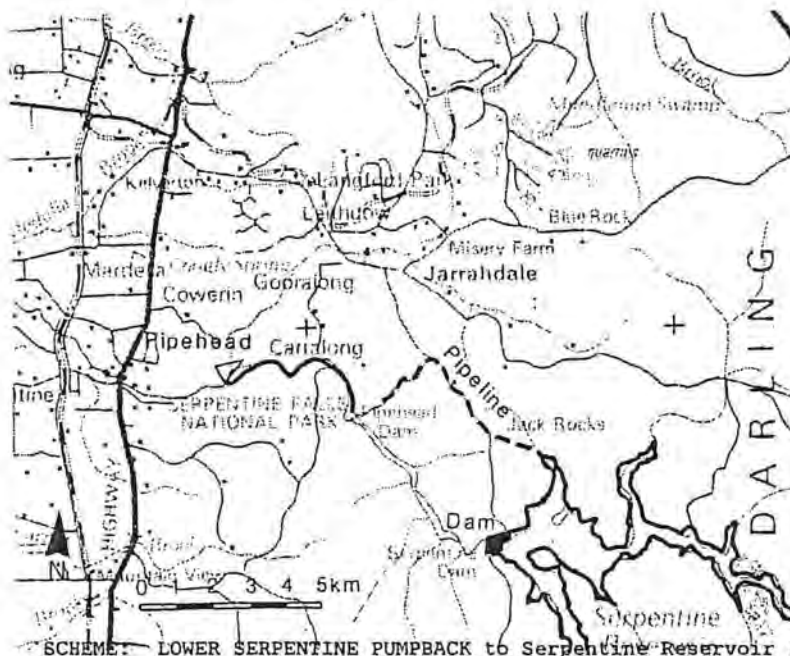

Map reference	Ei
Catchment area	29.4 sq.km
Streamflow (1947-86)	9.6 mill.cu.m/yr
Reservoir	
Area	<5 ha
Capacity	40 thou.cu.m
Yield benefit	4.6 mill.cu.m/yr
Cost	18.0 cents/cu.m
Treatment	Retention in Serpentine Reservoir
Most likely date	2001/02
Land use	% of area
Forest	83
Pasture	12
Horticulture	2
Urban	3


SPECIAL NOTES: Development of Lower Serpentine Catchment subsequent to Gooralong Pumpback (R24). Jarrahdale townsite within catchment. Pipehead reservoir on boundary of National Park. Pipe route crosses Conservation Reserve (M87) along Day Rd.

STATUS OF OPTION: Preferred option.

Existing Works shown as solid symbols and lines.
Proposed Works shown as open symbols and dashed lines.

* small but significant area

R27a LOWER SERPENTINE PUMPBACK

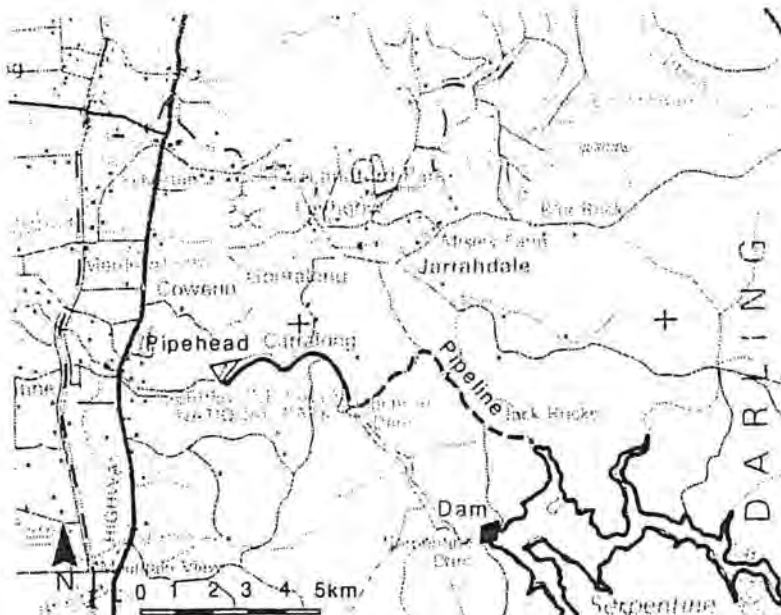

SCHEME: LOWER SERPENTINE single stage pumpback to Serpentine Reservoir as an alternative to the two stage development (Gooralong (R24) and Lower Serpentine (R27)).


SPECIAL NOTES: Impacts are the same as the Lower Serpentine Pumpback.

STATUS OF OPTION: Not preferred because it is more costly than the two stage development (R24, R27).

Map reference	Ei
Catchment area	71.8 sq.km
Streamflow (1911-80)	13.9 mill.cu.m/yr
Reservoir	
Area	10 ha
Capacity	110 thou.cu.m
Yield benefit	5.3 mill.cu.m/yr
Cost	26.9 cents/cu.m
Treatment	
Retention in Serpentine Main Dam reservoir	
Most likely date	N/A

Land use	% of area
Forest	77
Pasture	12
Industry	7
Horticulture	3
Urban	1

R28 LOWER SOUTH DANDALUP

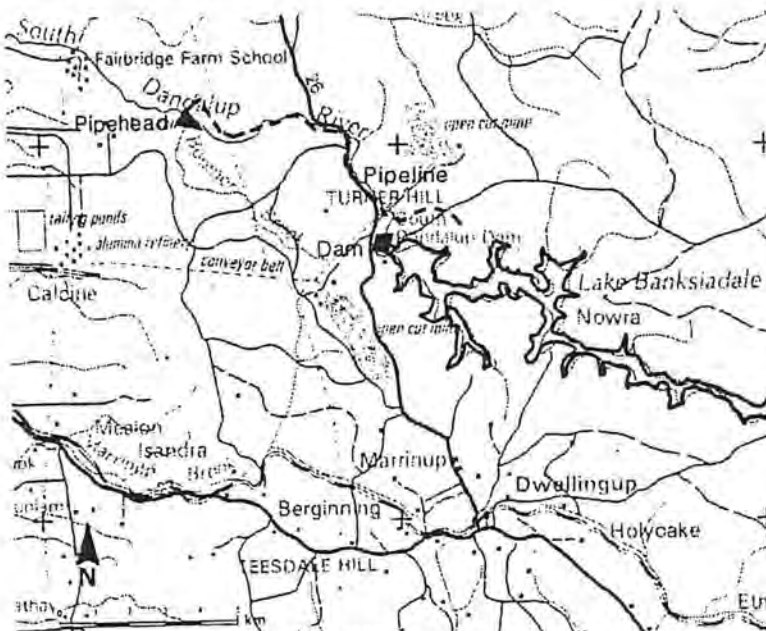

SCHEME: LOWER SOUTH DANDALUP PUMPBACK to South Dandalup Reservoir. The pipehead structure already exists as the Pinjarra Pipehead. Pinjarra townsite and Alcoa's Pinjarra Refinery currently use this pipehead. Alcoa will continue to use the pipehead whilst Pinjarra will be fed from South Dandalup Dam. This scheme allows greater use of winter flows.

SPECIAL NOTES:

STATUS OF OPTION: Preferred option.


Map reference	Eg
Catchment area	37.8 sq.km
Streamflow (1947-86)	12.3 mill.cu.m/yr
Reservoir	
Area	<5 ha
Capacity	43 thou.cu.m
Yield benefit	2.3 mill.cu.m/yr
Cost	58.0 cents/cu.m
Treatment	
Retention in South Dandalup Reservoir	
Most likely date	2010/11

Land use	% of area
Forest	93
Pasture	7

Existing Works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

R29 MARRINUP PUMPBACK

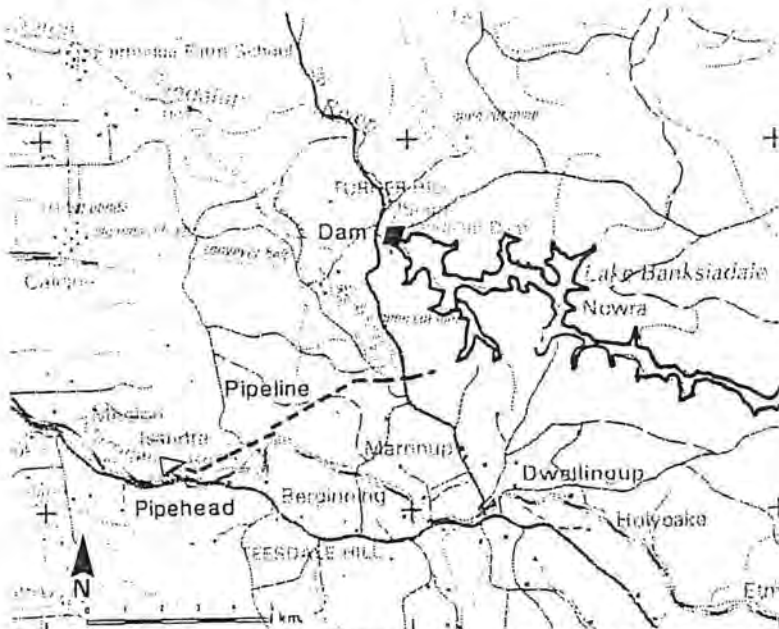

SCHEME: MARRINUP PUMPBACK from the Lower Site to South Dandalup Reservoir (R5).

SPECIAL NOTES: The Hotham Valley Railway runs near the proposed pipehead and will restrict the size of the development. Bauxite mining is active within the catchment.

STATUS OF OPTION: Preferred option.

Map reference EF

Catchment area
46.1 sq.km

Streamflow (1947-86)
12.3 mill.cu.m/yr

Reservoir
Area <5 ha
Capacity <80 thou.cu.m

Yield benefit
6.1 mill.cu.m/yr


Cost
29.0 cents/cu.m

Treatment
Retention in South Dandalup Reservoir

Most likely date
2003/04

Land use	% of area
Forest	85
Pasture	15
Urban	*

R29a MARRINUP PUMPBACK

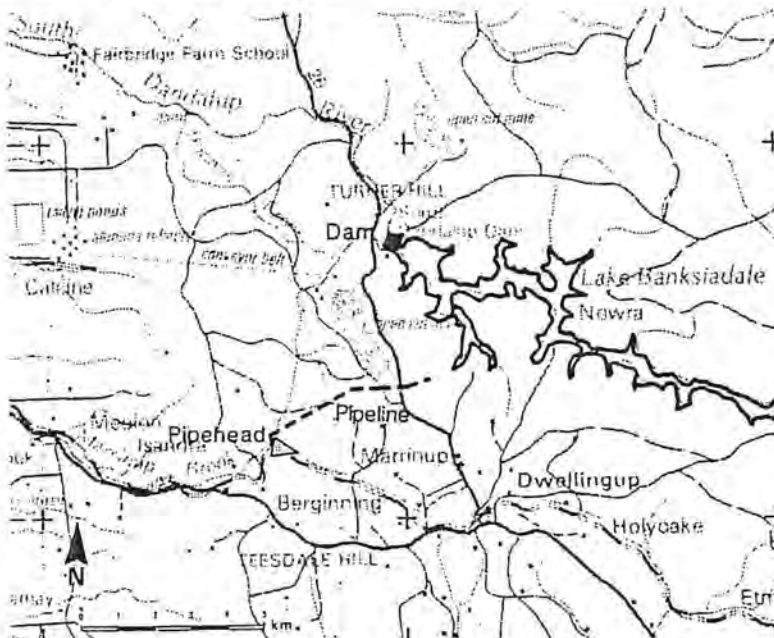

SCHEME: MARRINUP PUMPBACK from the Upper Site to South Dandalup Reservoir.

SPECIAL NOTES: As for pumpback from Lower Site (R29).

STATUS OF OPTION: Not preferred. Economically feasible but doesn't contribute as much yield as a pumpback at the Lower Site (R29).

Map reference EF

Catchment area
28.1 sq.km

Streamflow (1911-80)
7.5 mill.cu.m/yr

Reservoir
Area <5 ha
Capacity <130 thou.cu.m

Yield benefit
4.2 mill.cu.m/yr

Cost
27.7 cents/cu.m

Treatment
Retention in South Dandalup Reservoir


Most likely date
N/A

Land use	% of area
Forest	95
Pasture	5
Urban	*

Existing Works shown as solid symbols and lines.
Proposed Works shown as open symbols and dashed lines.

* small but significant area

R29b MARRINUP DAM

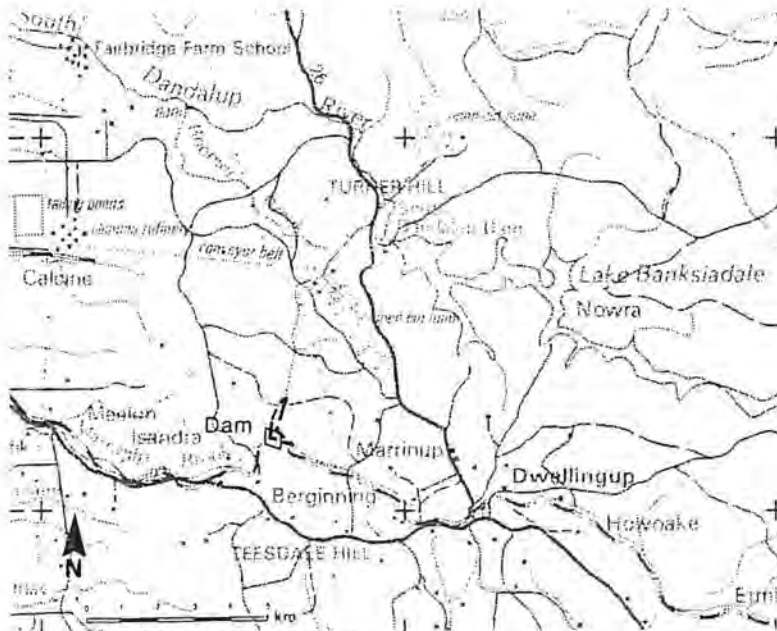

SCHEME: MARRINUP DAM at Upper Site.

SPECIAL NOTES: Inundates a section of the Hotham Valley Railway.

STATUS OF OPTION: Not preferred. More costly than preferred option (R29).

Map reference Ef

Catchment area
28.1 sq.km

Streamflow (1911-80)
7.5 mill.cu.m/yr

Reservoir
Area
35 ha
Capacity
4800 thou.cu.m

Yield benefit
7.1 mill.cu.m/yr


Cost
33.8 cents/cu.m

Treatment
Disinfection

Most likely date
N/A

Land use	% of area
Forest	95
Pasture	5
Urban	*

R30 MURRAY RIVER

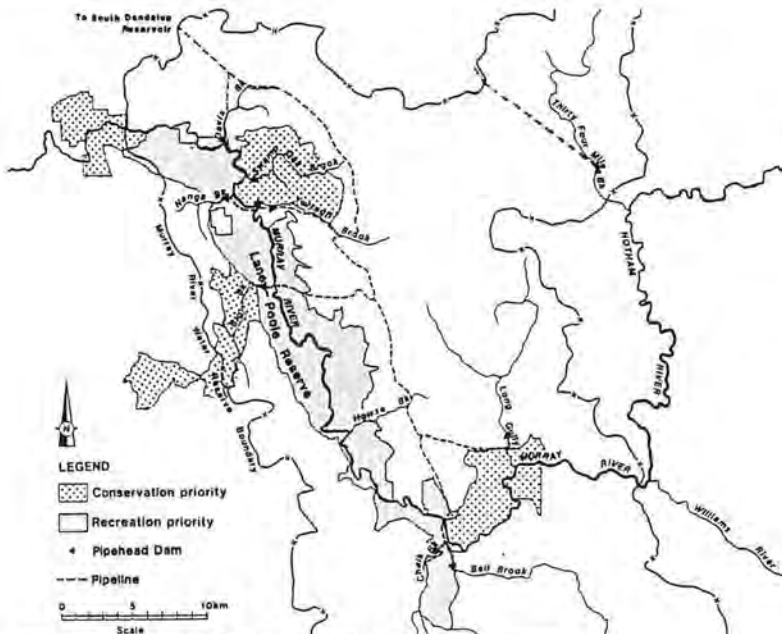

SCHEME: MURRAY RIVER TRIBUTARY DEVELOPMENT.

SPECIAL NOTES: This development involves a series of pumpbacks to South Dandalup Dam from tributaries of the Murray River. Some pipelines and pipehead dams are located within the Lane-Poole Reserve which are expected to have minimal effect on the purposes of the Reserve. 34 Mile Brook could not be used while goldmining is active within its' catchment. Davis Brook could be developed completely outside Lane-Poole Reserve.

STATUS OF OPTION: There is no provision made for water supply development in the vesting of the Lane-Poole Reserve.

Map reference Gd

Catchment area
738 sq.km

Streamflow (1911-80)
37.2 mill.cu.m/yr

Reservoir
Area
200 ha
Capacity
35 mill.cu.m

Yield benefit
21 mill.cu.m/yr

Cost
35.2 cents/cu.m


Treatment
Retention in South Dandalup Reservoir

Most likely date
Post 2012

Land use	% of area
Forest	100
Pasture	*

Existing Works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

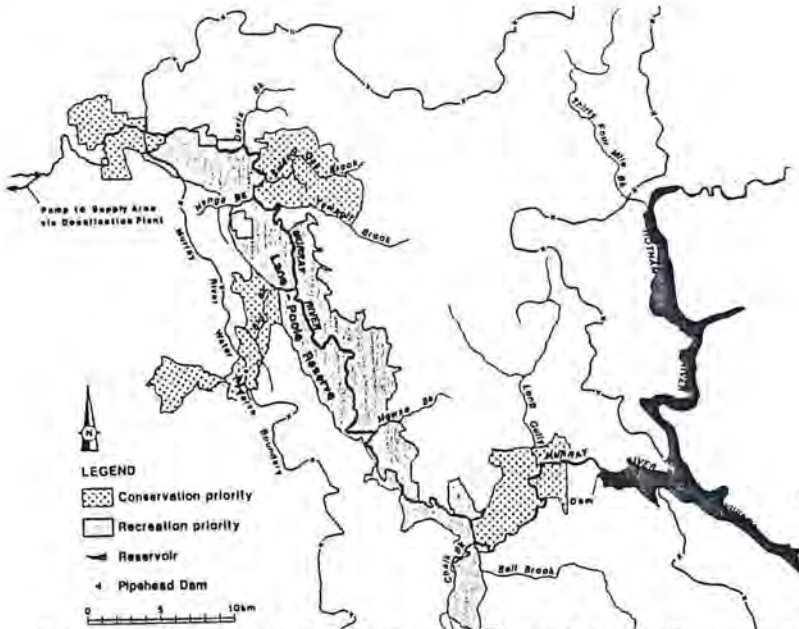


SCHEME: DAM below confluence of HOTHAM and WILLIAMS river to control flow to PIPEHEAD on MURRAY river at foot of Darling Scarp, downstream of Lane-Poole Reserve.

SPECIAL NOTES: Average flows through the Lane-Poole Reserve would be unchanged but winter floods would be reduced and flow would be maintained in summer. Some agricultural land would be flooded by upper dam.

STATUS OF OPTION: A possible development outside Lane-Poole Reserve, but would not be economic until well after 2012. Further investigation required.

R30b MURRAY TWO DAMS

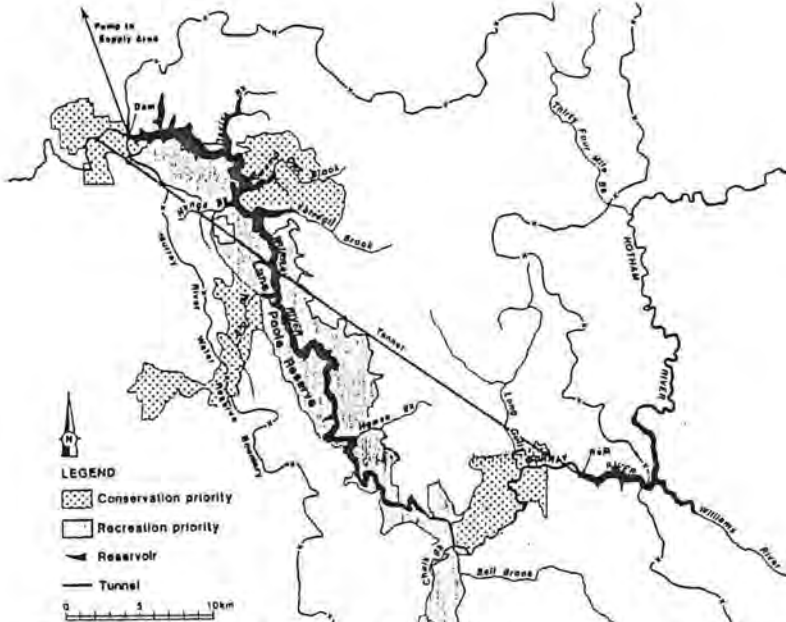

SCHEME: DAM on the MURRAY RIVER at HUGHES BRIDGE to store fresh streamflow, plus DAM below confluence of HOTHAM and WILLIAMS river with tunnel to divert saline flow.

SPECIAL NOTES: Although the dam at Hughes Bridge is smaller than for the single dam option, significant flooding of Lane-Poole Reserve will still occur. Catchment of upper dam not included in assessment of catchment or land use.

STATUS OF OPTION: Rejected due to impact on Lane-Poole Reserve.

Map reference Ee

Catchment area
6903 sq.km

Streamflow (1911-80)
350 mill.cu.m/yr

Reservoir
Area
3100 ha
Capacity
300 mill.cu.m

Yield benefit
150 mill.cu.m/yr

Cost
91.5 cents/cu.m

Treatment
Desalination

Most likely date
Post 2012

Land use	% of area
Forest	49
Pasture/crop	51
Horticulture	*
Urban	*

Map reference Hc

Catchment area
1056 sq.km

Streamflow (1911-80)
100 mill.cu.m/yr

Reservoir
Area
2700 ha
Capacity
400 mill.cu.m

Yield benefit
70 mill.cu.m/yr

Cost
47.4 cents/cu.m

Treatment
Disinfection


Most likely date

Land use	% of area
Forest	99
Horticulture	*
Pasture	*
Urban	*

Existing Works shown as solid symbols and lines.
Proposed Works shown as open symbols and dashed lines.

* small but significant area

R30c MURRAY SINGLE DAM

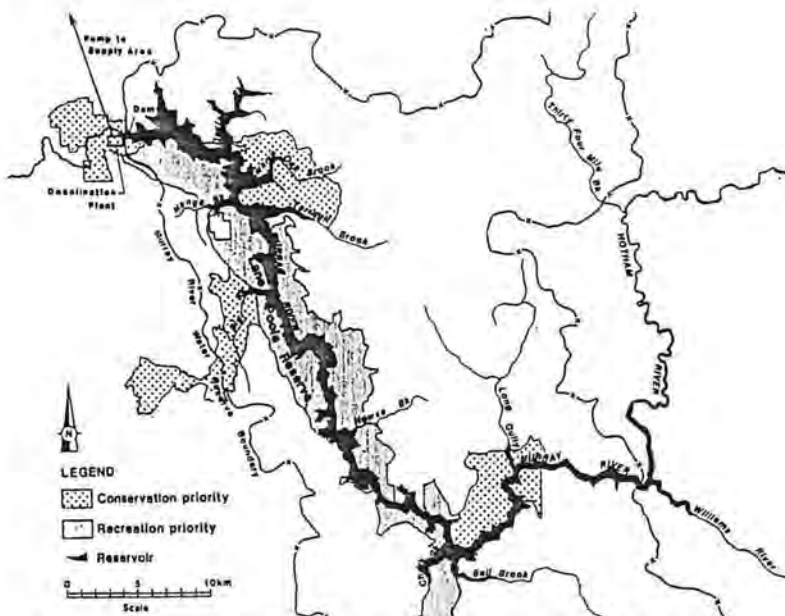

SCHEME: DAM on the MURRAY RIVER at Hughes Bridge with desalination.


SPECIAL NOTES: Severe inundation of Lane-Poole Reserve with loss of conservation and some recreation values.

Map reference	Ee
Catchment area	6840 sq.km
Streamflow (1911-80)	330 mill.cu.m/yr
Reservoir	
Area	6500 ha
Capacity	1000 mill.cu.m
Yield benefit	200 mill.cu.m/yr
Cost	83.8 cents/cu.m
Treatment	Desalination
Most likely date	

Land use	% of area
Forest	49
Pasture/Crop	51
Horticulture	*
Urban	*

STATUS OF OPTION: Rejected due to impact on Lane-Poole Reserve.

R31 RED SWAMP BROOK PUMPBACK

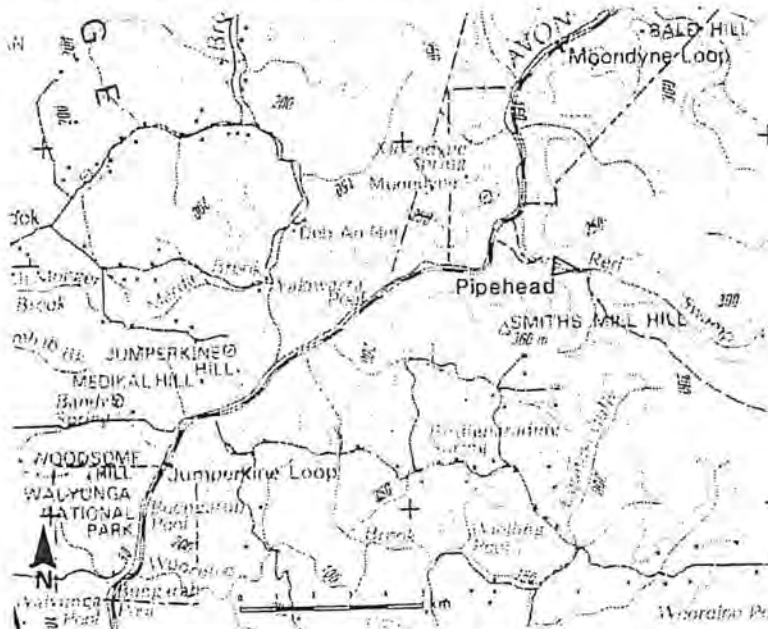

SCHEME: RED SWAMP BROOK PUMPBACK to Woorooloo Brook Dam.

SPECIAL NOTES: Pipe route to Woorooloo Dam not yet known.

Map reference	Gq
Catchment area	134 sq.km
Streamflow (1911-80)	5.9 mill.cu.m/yr
Reservoir	
Area	3 ha
Capacity	30 thou.cu.m
Yield benefit	3.0 mill.cu.m/yr
Cost	101.5 cents/cu.m
Treatment	Retention in Woorooloo Reservoir
Most likely date	Post 2012


Land use	% of area
Forest	75
Pasture	25

STATUS OF OPTION: Currently preferred option. further investigation is required.

Existing Works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

R32 SUSANNAH BROOK PIPEHEAD

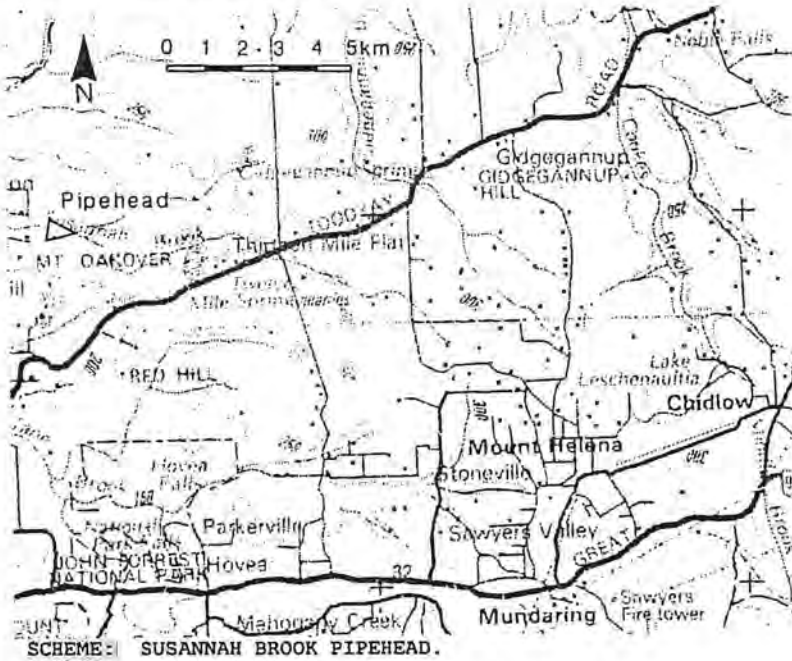


SPECIAL NOTES: Storage pipehead located 9 km upstream of confluence with Swan River, to a new treatment plant in the Swan Valley.

STATUS OF OPTION: Currently preferred option, further investigation is required.

Map reference	Fo
Catchment Area	44 sq.km
Streamflow (1911-80)	3.8 mill.cu.m/yr
Reservoir	
Area	13 ha
Capacity	750 thou.cu.m
Yield benefit	3.4 mill.cu.m/yr
Cost	36.4 cents/cu.m
Treatment	As for groundwater treatment
Most likely date	Post 2012

Land use	% of area
Forest	35
Pasture	40
Special rural	25

R33 MUNDARING INTEGRATION

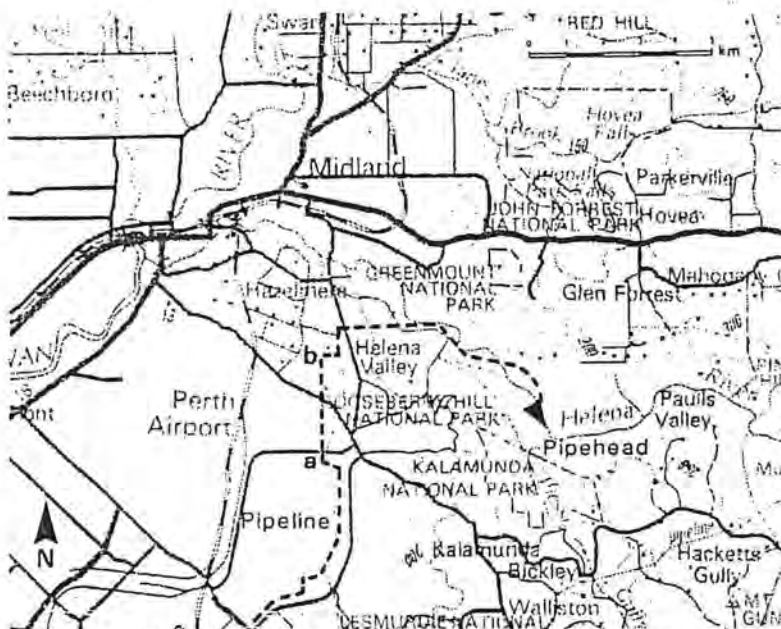

SCHEME: MUNDARING INTEGRATION involves the construction of 16 km of 1065 mm diameter pipe to increase the capacity to transfer water from the MWS to Helena Reservoir (R3) to meet increasing GSAWS needs and counteract increasing use of pipes in the existing Mundaring Integration Scheme to supply MWS demands. The total scheme includes some use of water from Helena Reservoir by the MWS in summer.

SPECIAL NOTES: a-b on above map marks 1st stage due 1990. Remainder most likely after 2004.

STATUS OF OPTION: Preferred option.


Map reference	Fn
Catchment Area	N/A sq.km
Streamflow	N/A mill.cu.m/yr
Reservoir	
Area	N/A ha
Capacity	N/A mill.cu.m
Yield benefit	0 mill.cu.m/yr
Cost	N/A cents/cu.m
Treatment	N/A
Most likely date	See Special Notes

Land use	% of area
N/A	N/A

Existing Works shown as solid symbols and lines.
Proposed Works shown as open symbols and dashed lines.

* small but significant area

R34 NORTH DANDALUP MAINS AMP.

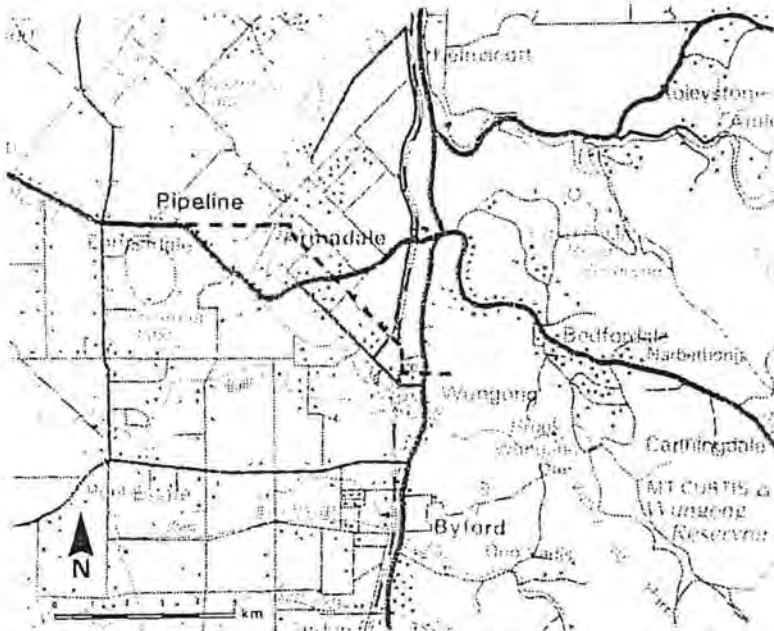

SCHEME: NORTH DANDALUP MAINS AMPLIFICATION involves a duplication of the existing 1065 mm diameter pipeline from the North Dandalup Dam Outlet Main to its junction with the Serpentine Outlet Main.


SPECIAL NOTES: The duplication is required when the Conjurunup Pipehead (R18) and the North Dandalup Dam (R14) are both operational. The yield benefit can be regarded as the yield which would be lost from these sources if the pipe was not constructed.

STATUS OF OPTION: Preferred option.

Map reference	Eh
Catchment Area	N/A sq.km
Streamflow	N/A mill.cu.m/yr
Reservoir	
Area	N/A ha
Capacity	N/A mill.cu.m
Yield benefit	2.9 mill.cu.m/yr
Cost	30.0 cents/cu.m
Treatment	N/A
Most likely date	2006/07

Land use	% of area
N/A	

R35 WUNGONG OUTLET AMP.

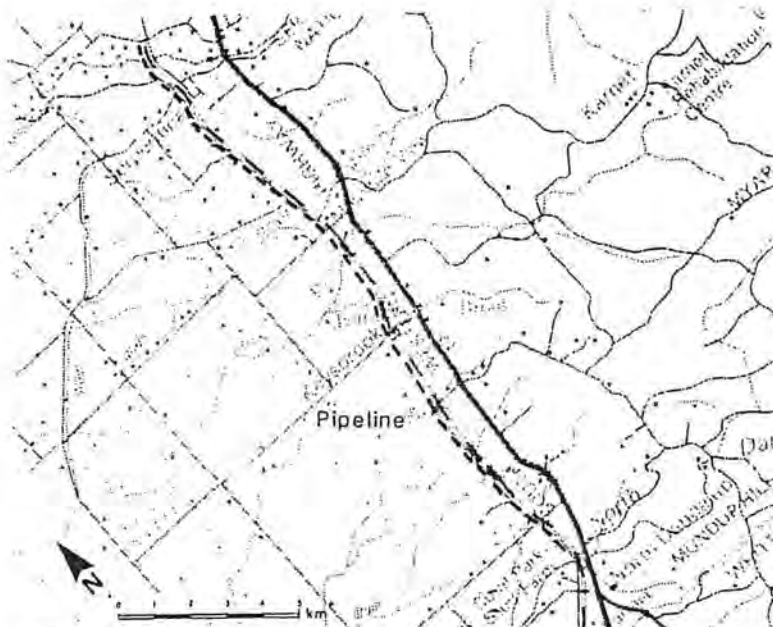

SCHEME: WUNGONG DAM MAINS OUTLET AMPLIFICATION adds a 1400 mm diameter pipe to the end of the Wungong Dam Outlet Tunnel (R7).

SPECIAL NOTES: This scheme is required for peak demand requirements, hence the cost is not expressed 'per cu.m of yield'. It is included in the Sources Development Timetable because it also produces a small increase in system yield.

STATUS OF OPTION: Preferred option.


Map reference	Ek
Catchment Area	N/A sq.km
Streamflow	N/A mill.cu.m/yr
Reservoir	
Area	N/A ha
Capacity	N/A mill.cu.m
Yield benefit	0.9 mill.cu.m/yr
Cost	\$13.31 million
Treatment	N/A
Most likely date	1993/94

Land use	% of area
N/A	

Existing Works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

G3 MIRRABOOKA G/WATER SCHEME

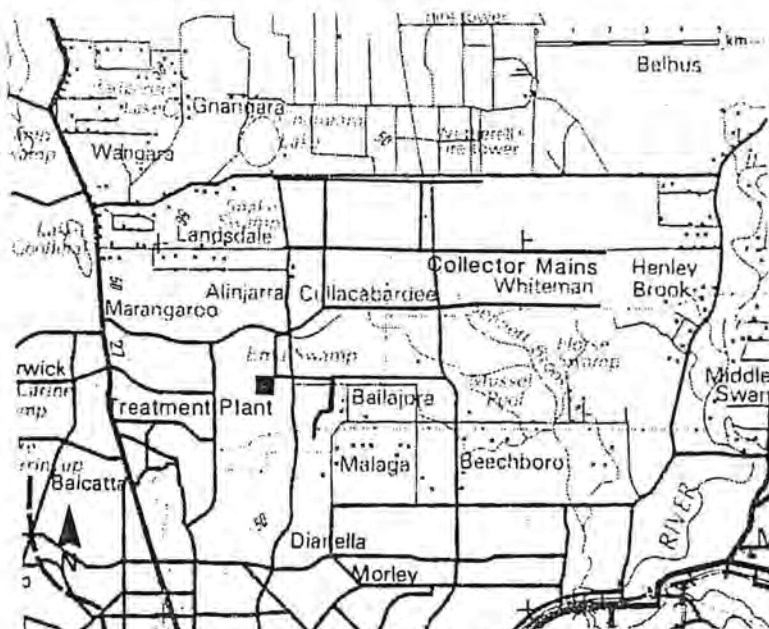

SCHEME: MIRRABOOKA GROUNDWATER SCHEME (Stages 1 & 2).

SPECIAL NOTES: Refer to G14 for proposed extension.

STATUS OF OPTION: Existing.

Map reference Do

Resource area
(Mirrabooka PWSA)
87 sq.km

Quota
22.0 mill.cu.m/yr

No of wells
34 shallow g/w
5 artesian g/w

Water used
22.0 mill.cu.m/yr

Cost
24.8 cents/cu.m


Treatment
Removal of iron,
colour & turbidity
and disinfection

Most likely date
Existing

Land use % of area
Horticulture 30
Natural veg. 60
Pines 5

Industrial *
Urban *
Wetlands *

G4 WANNEROO G/WATER SCHEME

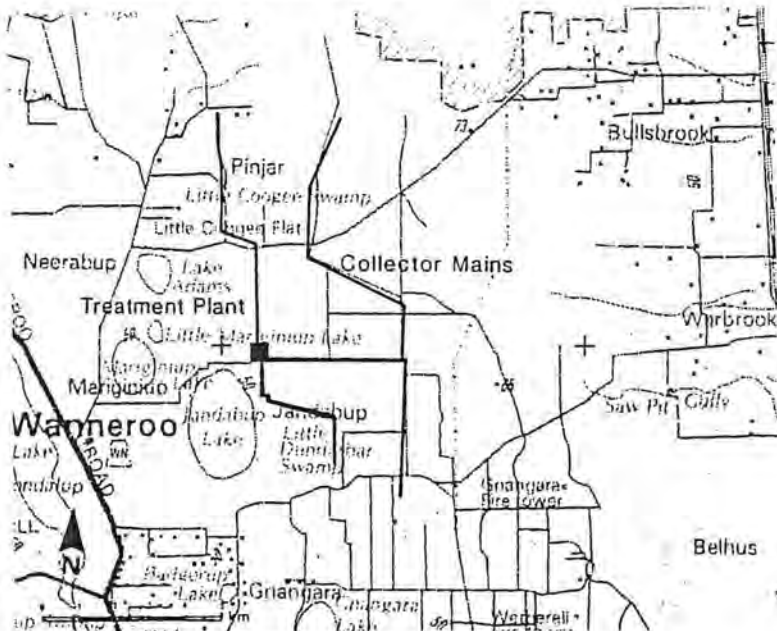

SCHEME: WANNEROO GROUNDWATER SCHEME.

SPECIAL NOTES: Refer to Lexia Scheme (G19).

STATUS OF OPTION: Existing.

Map reference Dq

Resource area
(Wanneroo PWSA)
144 sq.km

Quota
21.2 mill.cu.m/yr

No of wells
24 shallow g/w
8 artesian g/w

Water used
21.2 mill.cu.m/yr

Cost
19.5 cents/cu.m

Treatment
Removal of iron,
colour & turbidity
and disinfection

Most likely date
Existing

Land use % of area
Natural veg. 40
Pines 60

Existing Works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

G5-9 EXISTING DEEP ART'N WELLS

Map reference	see
	SCHEME
Resource area	
N/A	sq.km
Quota	
12	mill.cu.m/yr
No of wells	
0	shallow g/w
14	artesian g/w
Water used	
12	mill.cu.m/yr
Cost	
7.7	cents/cu.m
Treatment	
Dilution in service reservoir and disinfection	
Most likely date	
Existing	
Land use	% of area
N/A	


LOCATIONS MARKED ON MAP A1

SCHEME: DEEP ARTESIAN WELLS at Melville (G6, 1 well at Cm)
 Bold Park (G5, 2 wells at Cn)
 Mt Eliza (G8, 6 wells at Dn)
 Yokine (G9, 4 wells at Do)
 Mirrabooka (G7, 1 well at Do)

SPECIAL NOTES:

STATUS OF OPTION: Existing.

G10 BARRAGOON STAGE I

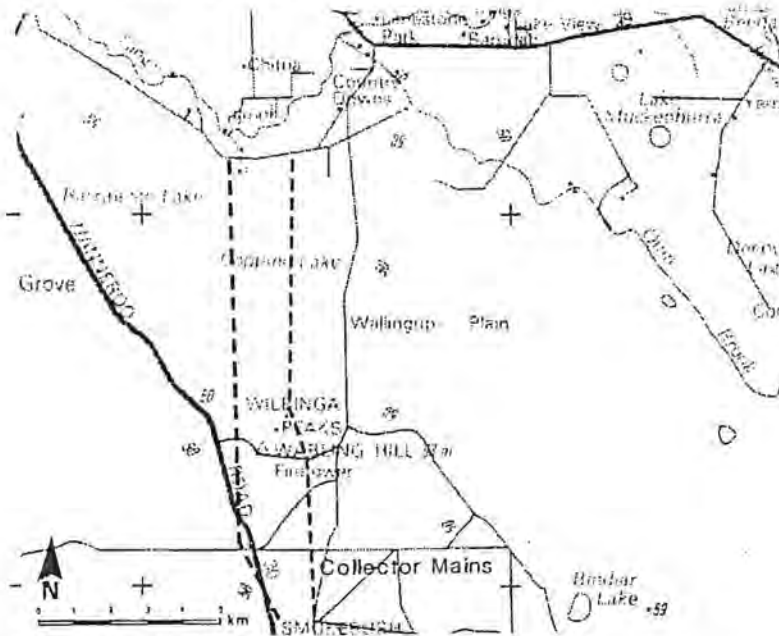

SCHEME: BARRAGOON STAGE I GROUNDWATER SCHEME.


Map reference	Bt
Resource area	
(Gnangara WR)	
680	sq.km
Quota	
4.8	mill.cu.m/yr
No of wells	
12	shallow g/w
0	artesian g/w
Yield benefit	
6.0	mill.cu.m/yr
Cost	
42.0	cents/cu.m
Treatment	
Removal of iron, colour & turbidity and disinfection	
Most likely date	
2011/12	
Land use	% of area
Natural veg.	80
Pines	10
Wetlands	10

SPECIAL NOTES: The Barragoon Groundwater scheme will be treated at the Yeal GWTP (G23). Barragoon Stage I and II (G11) will be developed mainly within the Gnangara Water Reserve, north of Yeal. However, some wells will be located just north of the Water Reserve. Artesian wells have been deleted from this scheme due to reduction in mean volume to be drawn from deep artesian aquifer.
 STATUS OF OPTION: Preferred option.

Existing works shown as solid symbols and lines
 Proposed Works shown as open symbols and dashed lines

* small but significant area

G11 BARRAGOON STAGE II

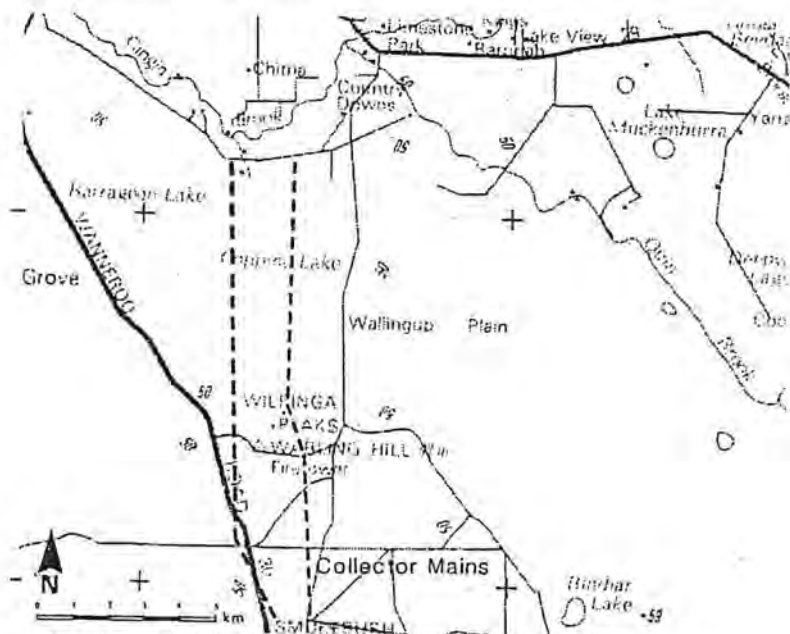

SCHEME: BARRAGOON STAGE II GROUNDWATER SCHEME.

SPECIAL NOTES: See special note for Barragoon Stage I (G10).

STATUS OF OPTION: Preferred option.

G12 COCKLESHELL GULLY ART'N

LOCATIONS MARKED ON MAP A1

SCHEME: 3 DEEP ARTESIAN WELLS (North, Central and South) tapping the COCKLESHELL GULLY FORMATION.

SPECIAL NOTES: Direct use of the water is not possible due to the high iron content. The quoted cost allows for the treatment of the water or for retention in a reservoir such as Serpentine Dam (R4) or Wungong Dam (R7). A test well is located at the central site.

STATUS OF OPTION: Rejected due to severe reductions in water levels in nearby shallow wells when pumping from test well.

Existing Works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

Map reference Bt

Resource area
(Gnangara WR)
680 sq.km

Quota
4.8 mill.cu.m/yr

No of wells
11 shallow g/w
0 artesian g/w

Yield benefit
6.0 mill.cu.m/yr

Cost
42.0 cents/cu.m

Treatment
Removal of iron,
colour & turbidity
and disinfection

Most likely date
Post 2012

Land use % of area
As for
Barragoon
St I

Map reference Eg

Resource area
N/A sq.km

Quota
3.7 mill.cu.m/yr

No of wells
0 shallow g/w
3 artesian g/w

Yield benefit
3.7 mill.cu.m/yr

Cost
17.6 cents/cu.m


Treatment
See special notes

Most likely date
N/A

Land use % of area
N/A

* small but significant area

G13 DANDALUP G/WATER SCHEME

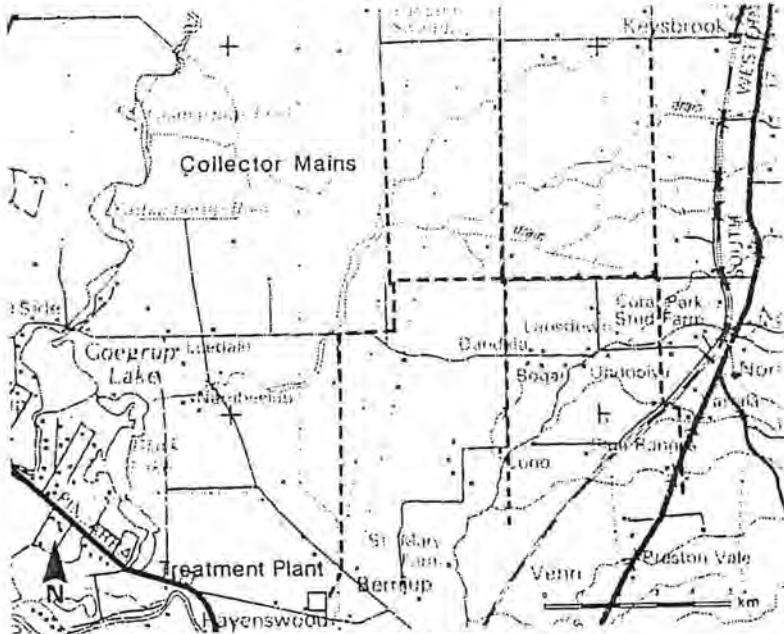

SCHEME: DANDALUP GROUNDWATER SCHEME.


Map reference	Dh
Resource area (Peel GA)	820 sq.km
Quota	10.6 mill.cu.m/yr
No of wells	20 shallow g/w 25 artesian g/w
Yield benefit	10.6 mill.cu.m/yr
Cost	39.0 cents/cu.m
Treatment	Removal of iron, colour & turbidity and disinfection
Most likely date	Post 2012

SPECIAL NOTES: Will serve the southern areas of Perth and Mandurah. The wellfield for this scheme will extend outside of the Peel Groundwater Area into the Murray Groundwater Area.

Land use	% of area
Horticulture	80
Natural veg.	10
Wetlands	10

STATUS OF OPTION: Preferred option.

G14 EAST MIRRABOOKA STAGE 3

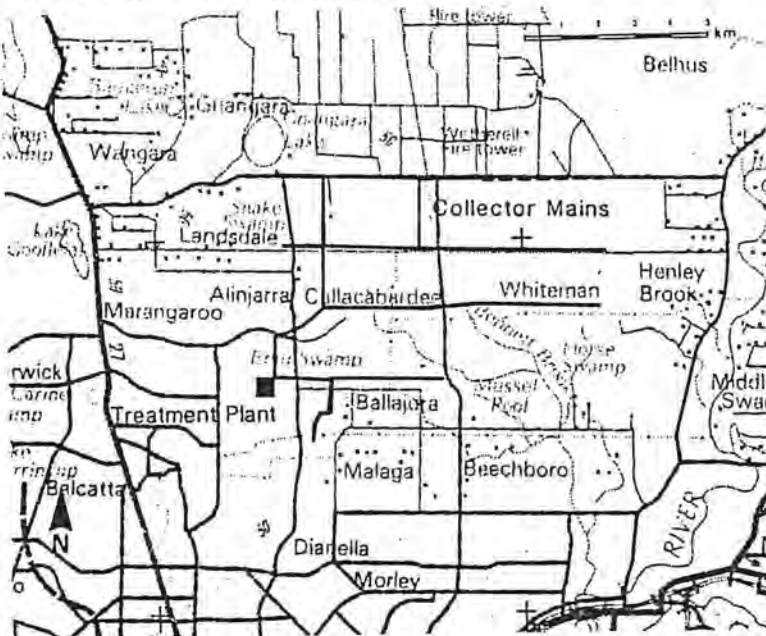

SCHEME: EAST MIRRABOOKA STAGE 3. is an eastern extension of Mirrabooka Stage I and II (G3).

SPECIAL NOTES: Water from this scheme will be treated at the existing Mirrabooka GWTP (see G3).

Map reference	Ep
Resource area (Mirrabooka PWSA)	87 sq.km
Quota	2 mill.cu.m/yr
No of wells	4 shallow g/w 0 artesian g/w
Yield benefit	1.5 mill.cu.m/yr
Cost	37.0 cents/cu.m
Treatment	Removal of iron, colour & turbidity and disinfection
Most likely date	2011/12


Land use	% of area
Horticulture	30
Natural veg.	60
Pines	5
Industrial	*
Urban	*
Wetlands	*

STATUS OF OPTION: Preferred option.

Existing works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

G15 JANDAKOT STAGE II

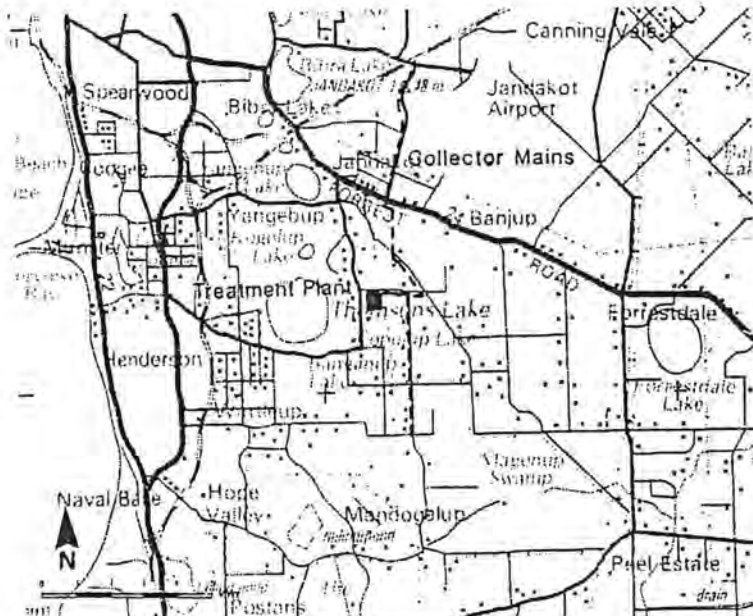

SCHEME: JANDAKOT STAGE II GROUNDWATER SCHEME, is an extension to the west of Jandakot Stage I (G2).

SPECIAL NOTES: Water will be treated at the existing Jandakot GWTP (see G2). A liquid waste disposal site is located within the PWSA. Scheme details will be revised to account for proposed urbanisation in the area of the wellfield. Scheme will be operated to maximise drainage outflows from the area which are not required for wetland maintenance.

STATUS OF OPTION: Preferred option.

Map reference D1

Resource area (Jandakot PWSA) 104 sq.km

Quota 4.0 mill.cu.m/yr

No of wells 15 shallow g/w
2 artesian g/w

Yield benefit 4.7 mill.cu.m/yr

Cost 18.0 cents/cu.m

Treatment Removal of iron, colour & turbidity and disinfection

Most likely date 1995/96

Land use	% of area
Horticulture	55
Natural veg.	35
Wetlands	5

Industrial	*
Urban	*

G16 JANDAKOT SOUTH STAGE I



SCHEME: JANDAKOT SOUTH STAGE I GROUNDWATER SCHEME.

SPECIAL NOTES: The water will be treated at the existing Jandakot GWTP (see G2).

STATUS OF OPTION: Preferred option.

Map reference Dk

Resource area (Jandakot PWSA) 104 sq.km

Quota 3.1 mill.cu.m/yr

No of wells 7 shallow g/w
2 artesian g/w

Yield benefit 3.3 mill.cu.m/yr

Cost 33.0 cents/cu.m

Treatment Removal of iron, colour & turbidity and disinfection


Most likely date 2007/08

Land use	% of area
Horticulture	10
Natural veg.	60
Wetlands	30

Existing Works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

G17 JANDAKOT SOUTH STAGE II

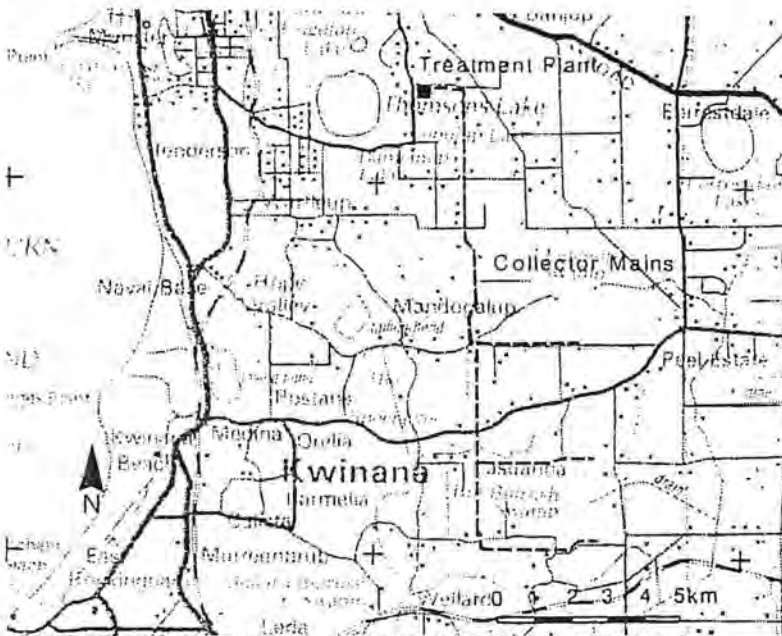


SCHEME: JANDAKOT SOUTH STAGE II GROUNDWATER SCHEME is a southwards extension of the scheme for Stage I (G16).

SPECIAL NOTES: Water will be treated at the existing Jandakot GWTP (see G2).

Map reference	Dk
Resource area (Peel GA)	820 sq.km
Quota	3.1 mill.cu.m/yr
No of wells	7 shallow g/w 1 artesian g/w
Yield benefit	3.3 mill.cu.m/yr
Cost	33.0 cents/cu.m
Treatment	Removal of iron, colour & turbidity and disinfection
Most likely date	2007/08
Land use	% of area
AS for Jandakot South St I	

STATUS OF OPTION: Preferred option.

G18 KARNUP GROUNDWATER SCHEME

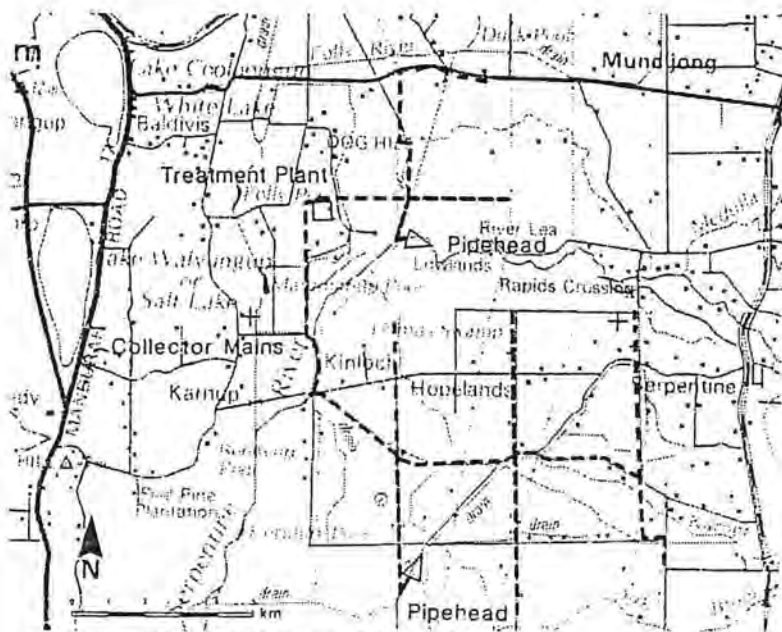

SCHEME: KARNUP GROUNDWATER SCHEME.

SPECIAL NOTES: Will be developed to serve the southern areas of Perth as the population growth extends southward. Some surface water will be delivered to the Treatment Plant from the pipeheads.


Map reference	Di
Resource area (Peel GA)	820 sq.km
Quota	7.5 mill.cu.m/yr
No of wells	20 shallow g/w 15 artesian g/w
Yield benefit	7.4 mill.cu.m/yr
Cost	39.0 cents/cu.m
Treatment	Removal of iron, colour & turbidity and disinfection
Most likely date	Post 2012
Land use	% of area
Horticulture	80
Natural veg.	10
Wetlands	10

STATUS OF OPTION: Preferred option.

Existing works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

G19 LEXIA GROUNDWATER SCHEME

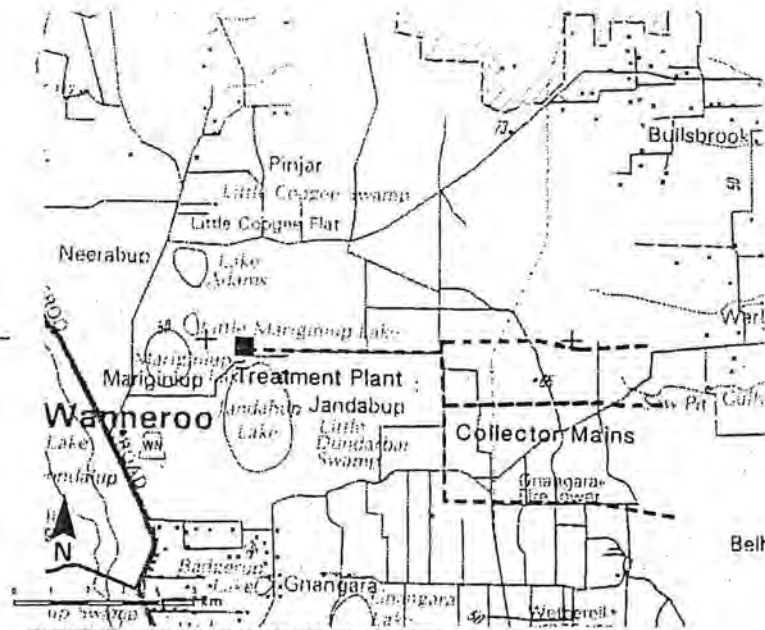

SCHEME: LEXIA GROUNDWATER SCHEME.

SPECIAL NOTES: The Lexia Scheme lies mainly within the the Wanneroo PWSA. However, some of the wells will be located outside of the existing PWSA. The groundwater will be treated at the existing Wanneroo GWTP unless urban development in the Swan Valley makes it practical to establish a new treatment plant closer to the wellfield.

STATUS OF OPTION: Preferred option.

Map reference Dp

Resource area
(Wanneroo PWSA)
144 sq.km

Quota
6.5 mill.cu.m/yr

No of wells
15 shallow g/w
0 artesian g/w

Yield benefit
6.9 mill.cu.m/yr


Cost
26.0 cents/cu.m

Treatment
Removal of iron,
colour & turbidity
and disinfection

Most likely date
2002/03

Land use	% of area
Natural veg.	40
Pines	60

G20 PINJAR STAGE I

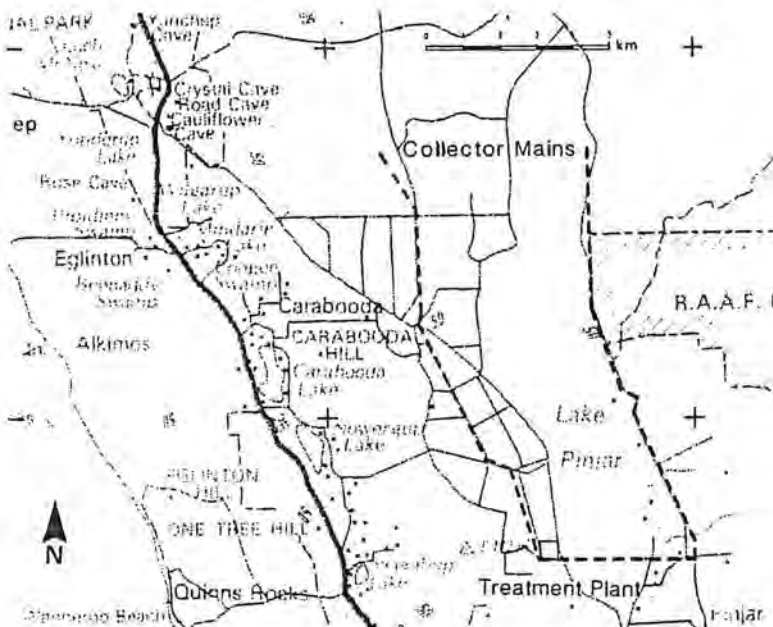

SCHEME: PINJAR STAGE I GROUNDWATER SCHEME. Parts 1 & 2.

SPECIAL NOTES: The development is within the Gnanagara Water Reserve, north of the Wanneroo PWSA (which is not included in the area stated for the Gnanagara Water Reserve). Development is to occur in two separate parts (1 & 2) with treatment at Wanneroo GWTP.

STATUS OF OPTION: Preferred option.

Map reference Cq

Resource area
(Gnanagara WR)
680 sq.km

Quota
12.7 mill.cu.m/yr

No of wells
9 shallow g/w
5 artesian g/w

Yield benefit
14.1 mill.cu.m/yr

Cost
17.0 cents/cu.m

Treatment
Removal of iron,
colour & turbidity
and disinfection


Most likely date
1988/89 & 1989/90

Land use	% of area
Natural veg.	70
Pines	10
Wetlands	20

Existing Works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

G21 PINJAR STAGE II

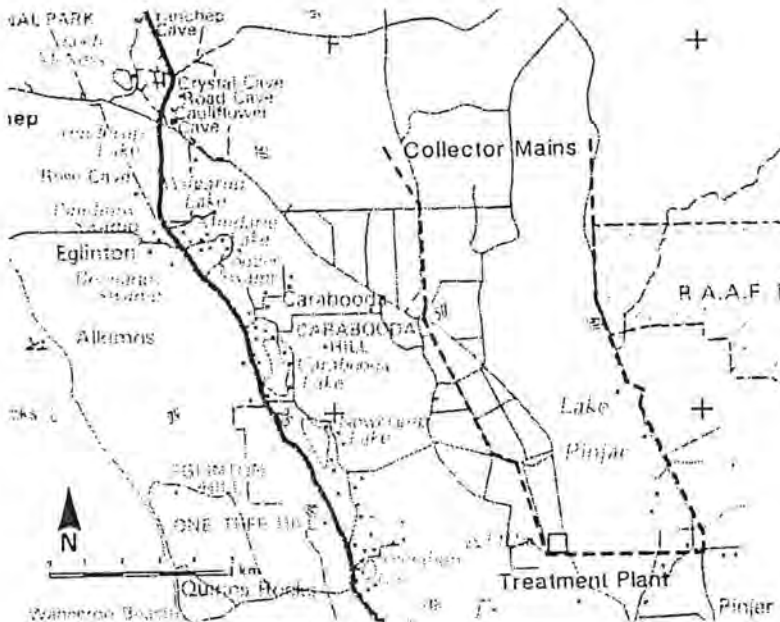

SCHEME: PINJAR STAGE II GROUNDWATER SCHEME. Parts 1 & 2.

Map reference Cq

Resource area
(Gnangara WR)
680 sq.km

Quota
7.2 mill.cu.m/yr

No of wells
9 shallow g/w
3 artesian g/w

Yield benefit
8.0 mill.cu.m/yr

Cost
27.0 cents/cu.m

Treatment
Removal of iron,
colour & turbidity
and disinfection

Most likely date
2000/01 & 2004/05

SPECIAL NOTES: Part 1 wells are on eastern leg of wellfield and will be treated at Wanneroo GWTP. Pinjar GWTP will be constructed Pinjar St I to treat water for Part 2 wells which are on western leg of wellfield. Some artesian wells have been deleted from this scheme due to reduction in mean volume to be drawn from the deep artesian aquifer.

Land use % of area
As for

STATUS OF OPTION: Preferred option.

G22 PINJAR STAGE III



SCHEME: PINJAR STAGE III GROUNDWATER SCHEME.

Map reference Cq

Resource area
(Gnangara WR)
680 sq.km

Quota
5.6 mill.cu.m/yr

No of wells
10 shallow g/w
2 artesian g/w

Yield benefit
6.0 mill.cu.m/yr

Cost
29.0 cents/cu.m

Treatment
Removal of iron,
colour & turbidity
and disinfection

Most likely date
2005/06

SPECIAL NOTES: Water will be treated at Pinjar GWTP (see G21). Some artesian wells have been deleted as per note in G21.

Land use % of area
As for
Pinjar St I

STATUS OF OPTION: Preferred option.

Existing works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

Map reference see SCHEME
 Resource area
 N/A sq.km
 Quota
 10.5 mill.cu.m/yr
 No of wells
 0 shallow g/w
 7 artesian g/w
 Yield benefit
 14 mill.cu.m/yr
 Cost
 11.3 cents/cu.m
 Treatment
 Dilution in service reservoir and disinfection
 Most likely date
 1988/89
 (See Special note)

LOCATIONS MARKED ON MAP A1


SCHEME: DEEP ARTESIAN WELLS, 1 each at Wanneroo (G29,Cp), Whitfords (G30,Co), Yanchep (G31,B5), McNess East (G27,Br), L. Thomson (G26,D1), Hamilton Hill (G25,C1) and Tamworth (G28,C1).

Land use % of area
 N/A

SPECIAL NOTES: Construction of wells other than Wanneroo would cause new limit on mean draw from deep artesian aquifer to be exceeded. Cost of Wanneroo DAW is 8.0 cents/cu.m.

STATUS OF OPTION: Preferred option for Wanneroo DAW. Other wells rejected to avoid excessive draw on deep artesian aquifer.

G32 WHITFORDS GROUNDWATER SCHEME

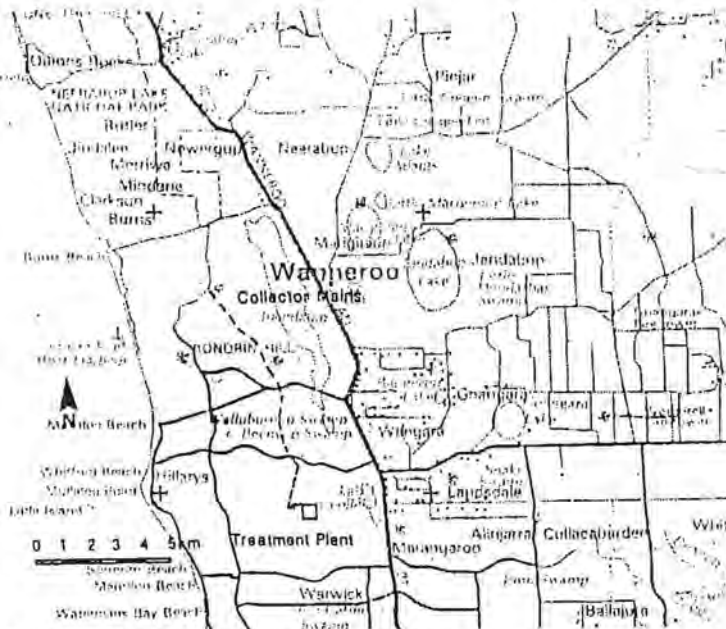

Map reference Cp
 Resource area
 (Whitford-Quinn's Coastal Strip)
 110 sq.km
 Quota
 6.0 mill.cu.m/yr
 No of wells
 12 shallow g/w
 0 artesian g/w
 Yield benefit
 6 - 7 mill.cu.m/yr
 Cost
 32.0 cents/cu.m
 Treatment
 Full treatment. See SPECIAL NOTES
 Most likely date
 See STATUS OF OPTION

SCHEME: WHITFORDS GROUNDWATER SCHEME.

Land use % of area
 Natural veg. 45
 Urban 55


SPECIAL NOTES: This scheme is currently under review. Preliminary cost estimates assume full treatment will be required. Town Planning for future land use indicates that a substantial portion of the scheme area may be urban at the time of development.

STATUS OF OPTION: Requires further investigation. Scheduling of this source will occur in the next Source Development review when investigations are further advanced.

Existing works shown as solid symbols and lines
 Proposed Works shown as open symbols and dashed lines

* small but significant area

G33 QUINNS GROUNDWATER SCHEME

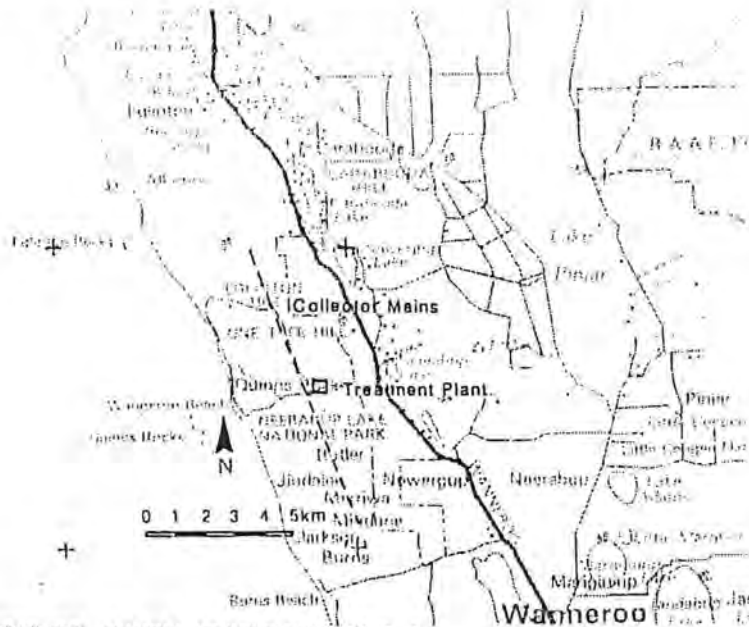

SCHEME: QUINNS GROUNDWATER SCHEME.

SPECIAL NOTES: This scheme is currently under review. Preliminary cost estimates assume full treatment will be required. Town Planning for future land use indicates that a substantial portion of the scheme area may be urban at the time of development.
STATUS OF OPTION: Requires further investigation. Scheduling of this source will occur in the next Source Development review when investigations are further advanced.

Map reference	Bq
See Map 4	
Resource area	(Whitford-Quinns Coastal Strip)
	110 sq.km
Quota	6 - 8 mill.cu.m/yr
No of wells	12 - 14 shallow g/w
	0 artesian g/w
Yield benefit	7 - 8 mill.cu.m/yr
Cost	30.2 cents/cu.m
Treatment	Full treatment.
	See SPECIAL NOTES
Most likely date	See STATUS OF OPTION

Land use	% of area
Natural veg.	95
Urban	*

G34 EGLINTON GROUNDWATER SCHEME



SCHEME: EGLINTON GROUNDWATER SCHEME.

SPECIAL NOTES: This scheme is currently under review. Preliminary cost estimates assume full treatment will be required. Town Planning for future land use indicates that a substantial portion of the scheme area may be urban at the time of development.
STATUS OF OPTION: Requires further investigation. Scheduling of this source will occur in the next Source Development review when investigations are further advanced.

Map reference	Br
See Map 4	
Resource area	(Yanchep GA)
	85 sq.km
Quota	7 - 10 mill.cu.m/yr
No of wells	14 shallow g/w
	0 - 2 artesian g/w
Yield benefit	7 - 11 mill.cu.m/yr
Cost	30.0 cents/cu.m
Treatment	Full treatment.
	See SPECIAL NOTES
Most likely date	See STATUS OF OPTION

Land use	% of area
Natural veg.	95
Wetlands	*

Existing Works shown as solid symbols and lines
 Proposed Works shown as open symbols and dashed lines

* small but significant area



Map reference As
See Map 4
Resource area
(Yanchep GA)
85 sq.km

Quota
6 - 10 mill.cu.m/yr

No of wells
12 - 14 shallow g/w
0 - 2 artesian g/w

Yield benefit
6 - 11 mill.cu.m/yr

Cost
30.6 cents/cu.m

Treatment
Full treatment.
See SPECIAL NOTES

Most likely date
See STATUS OF OPTION

SCHEME: TWO ROCKS/YANCHEP GROUNDWATER SCHEME.

SPECIAL NOTES: This scheme is currently under review. Preliminary cost estimates assume full treatment will be required. Town Planning for future land use indicates that a substantial portion of the scheme area may be urban at the time of development.
STATUS OF OPTION: Requires further investigation. Scheduling of this source will occur in the next Source Development review when investigations are further advanced.

Land use	% of area
Natural veg.	90
Urban	10

Existing works shown as solid symbols and lines
Proposed Works shown as open symbols and dashed lines

* small but significant area

Appendix B

IMPACTS OF LAND USE ON WATER RESOURCES
AND IMPACTS OF WATER RESOURCE DEVELOPMENT
ON LAND USE

Appendix B

IMPACTS OF LAND USE ON WATER RESOURCES AND IMPACTS OF WATER RESOURCE DEVELOPMENT ON LAND USE

The geographical relationship between proposed schemes and the surrounding land uses are shown in Map A1 in Appendix A and also for each scheme, in the map in the panel in Table A3 which gives the scheme details. An assessment of the significance of the relationships between water resource developments and surrounding land use can be made referring to the tables in this appendix. Table B1 is a key to the other tables in this appendix.

If it is evident that a scheme which is a preferred alternative will have an impact on other land uses in the area, then the Water Authority has assumed at this stage of investigation that the impact is acceptable. In some cases there are proposals to reduce impacts. These are mentioned in the 'Special Notes' in the scheme's panel in Appendix A. Other impacts may require special consideration at the project planning stage, with possible modification of the scheme if justified.

It would assist the planning process if readers draw to the attention of the Water Authority any potential impacts of the proposed schemes which are considered to be unacceptable.

Table B1 Key to Tables B2-B7

A. RIVERS

		forest land use	rural and urban land use
		conservation reserves	pasture crops
		timber production	horticulture
		minor forest products	industry
		mining	special rural urban
		service corridors	
		recreation	
		conservation of ecosystems	
		*****	*****
impact of land use on water resource	flow volume	*	*
	salinity	*	*
	turbidity	* TABLE B2	* TABLE B4
	chemical pollution	*	*
	biological poll'n	*	*
		*****	*****
impact of water resource development on land use	catchment areas	*	*
	storage dams	*	*
	a) dam & reservoir	* TABLE B3	* TABLE B5
	b) downstream	*	*
	pipehead dams	*	*
	pipelines	*	*
		*****	*****

B. SHALLOW GROUNDWATER

		land use
		natural vegetation
		wetlands
		pine forest
		horticulture
		industry
		urban

impact of land use on water resource	volume available annually	* TABLE B6
	pollution	*

impact of water resource development on land use	resource areas	*
	wells	*
	collector mains	* TABLE B7
	groundwater	*
	treatment plant	*

Table B2 Rivers in Forest Land

IMPACTS OF LAND USE ON WATER RESOURCE

	CONSERVATION RESERVES	TIMBER PRODUCTION	MINOR FOREST PRODUCTS (Beekeeping, Charcoal, Firewood, Gravel)
FLOW VOLUME (yield)	High density forest has low yield.	Higher yield from forest with reduced density from logging.	As for Timber Production except less intense.
SALINITY	Streams in conservation reserves usually fresh.	If logging spreads dieback and/or forest density is permanently reduced, salinity could develop in lower rainfall areas.	As for Timber Production except less intense.
TURBIDITY (muddy water)	Minimal	Careful management required to avoid turbidity from erosion of logging tracks or disturbance of streamzones.	As for Timber Production except less intense.
CHEMICAL POLLUTION	Nil	Minimal (fuel spills)	As for Timber Production except less intense.
BIOLOGICAL POLLUTION	Minimal (illegal entry)	Minimal (operators)	As for Timber Production except less intense.

Table B2 (continued)

MINING	SERVICE CORRIDORS	RECREATION	CONSERVATION OF ECOSYSTEMS
Some increase in yield during mining due to open pits, possible reduction after mining if rehab. vegetation very dense.	Negligible effects.	Negligible effects.	Possible reduction of water available for water supply due to constraint on development site.
No risk in high rainfall areas. Risk of bauxite mining causing salinity in drier areas is being assessed.	May have indirect effects in low rainfall areas through spread of dieback.	As for Service Corridors.	May help prevent commencement of activities with risk of causing salinity.
Careful mine management required to avoid turbid water entering streams from runoff from pits and haul roads.	A serious source of turbidity.	Recreation causes little turbidity.	Nil
Minor risk of fuel spills. Acid from coal tailings. Cyanide from gold tailings.	Risk from transport of hazardous chemicals in catchments.	Low (litter, nutrients)	Nil
Minimal (operators)	High risk where roads encourage human access to streams.	High risk where camping is popular in catchment areas and close to water. Management strategy is required.	Nil

Table B3 Rivers in Forest Land

IMPACTS OF WATER RESOURCE DEVELOPMENT ON LAND USE

	CONSERVATION RESERVES	TIMBER PRODUCTION	MINOR FOREST PRODUCTS (Beekeeping, Charcoal, Firewood, Gravel)
CATCHMENT AREAS	Priority for conservation does not prevent use as catchment.	Imposes costs of careful management.	As for Timber Production.
STORAGE DAMS	Storage dams cannot be located in conservation reserves.	Some loss of timber growing land in reservoir basin, which is likely to be above average quality, due to richer soils in valley floors.	As for Timber Production.
a) Impacts of dam site and reservoir basin.			
b) Downstream impacts.	Flow quantity and variation reduced.	Nil	Nil
PIPEHEAD DAMS	Although incompatible at site of works, small size makes compromise easier if there is conflict.	Negligible	As for Timber Production.
PIPELINES	Similar to roads and powerlines.	Similar to roads and powerlines.	As for Timber Production.

Table B3 (continued)

MINING	SERVICE CORRIDORS	RECREATION	CONSERVATION OF ECOSYSTEMS
Imposes costs of careful management.	Prefer routes away from streamlines.	May constrain particular activities in particular areas.	Recognition of catchment areas has limited clearing of native forests for agriculture.
Some mineral may be lost under water. Dam and reservoir may constrain routes of haul roads and conveyors.	May constrain routes.	Adds tourist attraction, but active water pastimes may be restricted. Reduces lengths of wild rivers by inundation.	The total area of Murray Valley - type landform is proportionately most reduced by reservoirs, compared to other landforms.
Nil	Nil	Flow regulation may improve value of river downstream for recreation.	Flow quantity and variation reduced.
No impact except for especially careful mine management in vicinity of pipehead.	Negligible	Access usually restricted. Little impact on recreational value of downstream flows.	Creates long lasting pool in river where previously there was only occasional flooding.
Constrain routes of haul roads.	Slightly higher costs at intersections of pipes with other services.	May be visually intrusive in landscape. May improve walking access to forest.	Similar to roads and powerlines.

Table B4 Rivers in Rural and Urban Land

IMPACTS OF LAND USE ON WATER RESOURCE

	PASTURE	CROPS	HORTICULTURE
FLOW VOLUME (yield)	Large increase in yield compared to forested catchment. Irrigation may reduce yield if water is taken from surrounding catchment, or may increase yield if water is imported from another catchment.	As for Pasture.	As for Pasture.
SALINITY FROM GROUNDWATER DISCHARGE	In lower rainfall areas with substantial salt stored in the soil profile, discharge of salt to stream may start some years after clearing as deep groundwater levels rise. Stream may become brackish or saline.	As for Pasture.	Not usually in salinity - risk areas.
TURBIDITY (muddy water)	High risk of turbidity if animals have direct access to stream.	High risk of turbid run-off from ploughed areas.	As for crops.
CHEMICAL POLLUTION	Risk of pollution from agricultural chemicals, pesticides and fertilisers.	As for pasture.	High risk of pollution from pesticides and fertilisers if their application is not controlled.
BIOLOGICAL POLLUTION	Risk from human and stock access to stream or reservoir.	Minimal	Usually higher density of human habitation than crops or pasture hence higher risk.

Table B4 (continued)

RURAL INDUSTRY (e.g. Abattoir, Refineries)	INTENSIVE ANIMAL HUSBANDRY (Piggeries)	SPECIAL RURAL (Hobby farms)	URBAN
Demand for industrial water supply may reduce flow.	Minor reduction in yield if water supply required.	As for intensive animal husbandry.	Increased run-off from roads and roofs, but not usually significant because urban areas are usually only a small fraction of catchment.
N/A	N/A	As for pasture.	N/A
Poor management of site or process can cause severe turbidity.	Turbidity is only a risk in some cases of poor management.	Low risk of turbidity with good soil management, but a significant level of poor management is likely when there is a large number of different land owners.	Run-off from roads and verges can cause turbidity.
Harmful chemicals may be discharged to stream if pollution is not controlled.	Risk of pollution from high nutrient loads in effluent and run-off from site unless adequately managed.	As for pasture.	Risk of pollution from urban run-off which contains rubber, fuel and oil from vehicles, or accidental spillage of poisons. Drainage from rubbish disposal sites is potentially dangerous if certain chemicals have been dumped.
Highly polluting effluent should be treated to acceptable standard before discharge to stream or preferably removed from catchment.	High risk if effluent not adequately treated or removed from catchment.	Relatively high density of housing using septic systems increases risk of badly located or malfunctioning units causing pollution of streams. Generally higher level of human activity near streams produces significant pollution.	Disposal of sewage can present a risk of pollution. High concentration of people increase risk of pollution from human contact with stream water or impounded water.

Table B5 Rivers in Rural and Urban Land

IMPACTS OF WATER RESOURCE DEVELOPMENT ON LAND USE

	PASTURE	CROPS	HORTICULTURE
CATCHMENT AREAS	No impact on conservative farming practices. Potential for rezoning to more densely inhabited or industrial land use may be restricted.	As for pasture.	As for pasture.
STORAGE DAMS	Private land would need to be resumed in reservoir basin and dam works area.	As for pasture.	As for pasture.
a) Impacts of dam site and reservoir basin.			
b) Downstream impacts.	Flows greater than required for riparian rights are markedly reduced. Flooding is reduced.	As for pasture.	As for pasture.
PIPEHEAD DAMS	As for storage dam except that required land area is very much smaller.	As for pasture.	As for pasture.
PIPELINES	Easement required on pipeline route. Above ground pipe can give problems of access and slight loss of productive land. Below ground pipe has minimal impact.	As for pasture.	As for pasture.

Table B5 (continued)

RURAL INDUSTRY (e.g. Abattoir. Refineries)	INTENSIVE ANIMAL HUSBANDRY (Piggeries)	SPECIAL RURAL (Hobby farms)	URBAN
Imposes costs of careful management. Industry producing toxic wastes should be excluded from catchment.	Imposes costs of careful management and possible relocation if near stream.	As for pasture and urban. Control on location of septic tanks.	Possibly extra costs for sewage and rubbish disposal. Need to keep urban development away from streams.
As for pasture.	As for pasture.	As for pasture.	As for pasture.
As for pasture. If industries have used stream for water supply, special arrangements for continued use may be required.	As for pasture.	As for pasture.	As for pasture.
As for storage dams except that impact on downstream flows is less.	As for pasture.	As for pasture.	As for pasture.
Pipe route would probably avoid industrial site.	As for special rural.	As for pasture. except pipe route would probably avoid private land.	If pipeline must pass through urban land, there may be difficulty fitting in with other services.

Table B6 Shallow Groundwater

IMPACT OF LAND USE ON WATER RESOURCE

	NATURAL VEGETATION	WETLANDS	PINE FOREST
VOLUME AVAILABLE ANNUALLY	No impact.	May be limited by requirement to maintain wetlands.	For approx. 10 years after clearing to plant pines, there is increased recharge. As trees grow older there is less recharge than with natural vegetation.
POLLUTION	No impact.	No impact unless wetlands receive drainage from urban, industrial or market garden areas.	No impact.

Table B7 Shallow Groundwater

IMPACTS OF WATER RESOURCE DEVELOPMENT ON LAND USE

	NATURAL VEGETATION	WETLANDS	PINE FOREST
UNDERGROUND WATER POLLUTION CONTROL AREAS, GROUNDWATER AREAS, PUBLIC WATER SUPPLY AREAS	No impact.	Conservation value is maintained through management plans implemented by Water Authority.	Plantation management may be modified to give priority to water production.
WELLS	In drought periods, the number of plant deaths may be greater near wells due to groundwater levels being drawn down deeper close to wells. 200 sq. m of land required for works at well site.	Locations of wells are chosen and wells operated to minimise effects on wetlands.	Viability of pines not affected by groundwater level. 200 sq. m of land required for works at well site.
COLLECTOR MAINS	Mains are generally buried but access is required along route. Existing roads used wherever possible.	Mains are not located in wetlands.	As for natural vegetation.
GROUNDWATER TREATMENT PLANTS	Approx. 6 ha site required for treatment works and disposal of sludges.	N/A	As for natural vegetation.

Table B6 (continued)

MARKET GARDEN HORTICULTURE SPECIAL RURAL	URBAN	RURAL INDUSTRY (e.g. Abattoirs, Refineries)	INTENSIVE ANIMAL HUSBANDRY
Water available for public supply is reduced by most of the amount drawn for irrigation. (Remainder soaks back to water table.)	Increased run-off from roads and roofs increases recharge, but stormwater drainage may divert some flow away from recharging groundwater.	Water available for public supply reduced by amount drawn from groundwater by industry.	As for market gardens.
Groundwater pollution by: Pesticides. Fertilisers. Effluent from septic tanks.	Groundwater pollution by: Pesticides, Fertilisers, Waste and leaked petroleum products, Drainage from rubbish disposal sites, Effluent from septic tanks.	Groundwater pollution specific to the industry may occur through waste disposal.	Groundwater pollution by effluent from treatment of wastes.

Table B7 (continued)

MARKET GARDEN HORTICULTURE SPECIAL RURAL	URBAN	RURAL INDUSTRY (e.g. Abattoirs, Refineries)	INTENSIVE ANIMAL HUSBANDRY
Licensing of private wells raises the awareness of the limited availability of the water resource and encourages efficient use. Management is required to prevent pollution of groundwater.	Private wells are licensed and care is taken by public authorities in siting of waste disposal and industry. Management is required to prevent pollution of groundwater.	Water Authority generally objects to industry with potential for groundwater pollution being sited in these areas. Other industries as for market gardens.	As for rural industry.
Operation of wells lowers the water table in their immediate vicinity. Where wells are situated very close together, they may need to be deeper than if farther apart. Allocation policy and management are required.	Sites for wells are usually found on public land where their impact is similar to other service installations.	Wells would not be sited in the vicinity of an industry with potential for pollution. Other industries as for market gardens.	As for rural industry.
An easement is required if mains must be located on private land. Impact of main on land use is minimal.	Routes for collector mains must be found in road reserves as for other services.	Routes for collector mains would avoid conflict with requirements of industry.	As for rural industry.
N/A	Works may be slightly obtrusive visually, and may be the source of some odour and noise for adjacent houses. Buffer zone required.	N/A	N/A

Appendix C

ASSUMPTIONS USED IN
LONG-TERM PROJECTIONS OF WATER DEMAND

Appendix C

ASSUMPTIONS USED IN LONG-TERM PROJECTIONS OF WATER DEMAND

POPULATION

Population projections for the Perth Statistical Division were prepared by Treasury (WA Treasury, 1986) and used by SPC (SPC, 1987). Immigration rates were uncertain and values of 8000, 11000 and 15000 per year were suggested, with 11000 stated as 'most likely'. The other values have been used for the 'minimum' and 'maximum' projections respectively. Population served by the MWS is assumed to be 94.4% of the Perth Statistical Division.

OCCUPANCY RATIO

The projection of overall occupancy ratio (the average number of people living in a residence) as used by SPC (SPC, 1987) was adopted. The ratio decreases from 2.73 in 1986 to 2.33 in 2011.

RATIO OF FLATS TO HOUSES

The 'maximum' projection assumed that the ratio of flats to houses would remain constant at the 1986 value of 0.166. Gradual increases of the ratio to 0.18 and 0.20 were assumed for the 'most likely' and 'minimum' projections respectively. The occupancy ratio of flats is assumed constant at 2.0, and the occupancy ratio of houses is assumed to reduce to the degree necessary to give the overall occupancy ratio as per projection.

INCREASE IN RESIDENTIAL DEMAND PER SERVICE

Rates of increase in per service demand were assumed for the volumes of water used 'within flats', 'within houses' and 'outside houses'. The assumptions correspond to the Water Conservation Strategy having immediate effect, delayed effect, and no effect, for the 'minimum', 'most likely' and 'maximum' projections respectively. 'Immediate effect' allowed no further increase in any of the types of use. 'Delayed effect' allowed some increase in all types of use for 2 years, followed by a reduction in rates to achieve the 1986 use per service again in 1991, and thereafter no increase. The rates of increase assumed for 'no effect' correspond to the rates observed in recent years, which are 1 kl/service per year for 'within house', and 2 kl/service per year for 'outside house' and 'within flats'.

EFFECT OF PRICE OF WATER

Water used 'outside houses' was assumed to be reduced when the price of water increased more than the rate of inflation, the price increase being needed to cover the cost of more expensive sources as they are added to the system. The amount of reduction was derived from the Domestic Water Use Study (MWA, 1985) and is -0.31% per 1% price increase. No reduction was applied in the 'maximum' projection.

INDUSTRIAL AND COMMERCIAL DEMANDS

Industrial and commercial demand was assumed to grow in proportion to population. For the 'minimum' and 'most likely' projections, a reduction totalling 5% was also applied over the first 5 years, being the expected effect of the Water Conservation Strategy. Future proposals for new industries with large demands for water which cannot be accommodated within the bounds of this assumption, will require special consideration for their source of water.

PRIVATE WELLS

The 'most likely' projection assumed that the percentage of services using private wells would remain constant at 28% until the maximum number of private wells that could be sustained in the Perth area (estimated as 124000), was reached in 2003. The 'minimum' projection assumed an increase of 0.5% per year until the maximum number of wells was reached in 1998. The 'maximum' projection assumed a decrease of 0.5% per year for 11 years, followed by a decrease of 0.25% per year. In this case the maximum number of wells was not reached in the projection period of 25 years. Demand corresponding to the number of wells in excess of (or less than) 28% of services, was subtracted (or added) to the demand projection at the rate of 200 kl/well per year.

UNACCOUNTED-FOR WATER

Unaccounted-for water has been 16.4% of the total water produced by the MWS on average over the last 5 years, but the annual amount varies considerably. For projection, the average value was allowed in all years. In the 'maximum' and 'minimum' projections, the average value was assumed higher and lower, at 17.4% and 15.4% respectively, which is the maximum variation in the mean expected to be possible over 25 years, based on the variability of the recorded data.

COUNTRY SUPPLIES

Projections of demand for the G & AWS and for Mandurah were based on advice from the operators of their respective schemes, and were not varied between 'minimum', 'most likely' or 'maximum' projections.

OTHER ALLOWANCES

Allowances for riparian releases, service reservoir cleaning and firefighting were all held constant at 2.5 mill. cu. m. per year throughout all projections.

Appendix D

WATER QUALITY OBJECTIVES

Appendix D

WATER QUALITY OBJECTIVES

CHARACTERISTIC	NH&MRC/AWRC DESIRABLE CURRENT CRITERIA	NH&MRC/AWRC LONG TERM OBJECTIVES	MWS OBJECTIVES
M A X I M U M L E V E L S			
<u>PHYSICAL</u>			
Colour units	50	5	5
Turbidity units	25	5	5
Odour	Unobjectionable	Unobjectionable	Unobjectionable
Taste	Unobjectionable	Unobjectionable	Unobjectionable
pH range	6.5 to 9.2	7.0 to 8.5	7.0 to 8.5
<u>CHEMICAL</u>			
	mg/L	mg/L	mg/L
Total solids	1500	500	500
Calcium	200	75	75
Chloride	600	200	200
Sulphate	400	200	200
Total iron	1.0	0.1	0.15
Nitrate (as N)	10	10	10
Total hardness (as CaCO ₃)	600	100	150
Manganese	0.5	0.05	0.05
<u>MICROBIOLOGICAL</u>			
i. Coliforms	Throughout any year, 90% of all samples should not contain levels in excess of 20 per 100 mL.	1. Throughout any year, 95% of samples should not contain any coliform organisms in 100 mL. 2. No samples should contain more than 10 coliform organisms per 100 mL 3. Coliform organisms should not be detectable in 100 mL of any two consecutive samples.	
ii. E. coli	Throughout any year, 90% of all samples should not contain levels in excess of 2 per 100 mL.	No sample should contain E. coli in 100 mL.	

NH&MRC - National Health and Medical Research Council

AWRC - Australian Water Resources Council

Desirable current criteria set out maximum levels which may be used as current criteria appropriate to present Australian conditions to give a drinking water of satisfactory quality.

Long term objectives set out more stringent levels which could be aspired to as long term objectives, and which, if achieved, result in drinking water of excellent quality. These levels are based on World Health Organisation International Standards for Drinking Water, 1971.

The NH&MRC/AWRC guidelines are currently under review.

Appendix E

CONSTRAINTS ON TIMING OF SCHEMES IN THE
SOURCE DEVELOPMENT TIMETABLE

Appendix E

CONSTRAINTS ON TIMING OF SCHEMES IN THE
SOURCE DEVELOPMENT TIMETABLE

- #1. In the 1987 version of this report (Mauger, 1987) it was explained that groundwater schemes on the Gngangara Mound were to be built in time to provide capacity to meet peak rates of demand in local areas, when that time was sooner than the economically ideal time to build the schemes for the purpose of increasing the system yield. In this revision of the report, the projection of total demand is significantly lower than it was in the 1987 version. One consequence is that it is economically preferable to augment the capacity of trunk mains to enable peak demands to be met by other sources, rather than to build new groundwater schemes just to meet the peaks. Thus the times for developing Gngangara Mound groundwater schemes are now only based on the cost of the schemes compared to other available sources.
- #2. As stated in Chapter 8, the redevelopment of Victoria Dam must occur within 10 years. The time selected for construction of the new dam and the Bickley Pumpback is the earliest at which the additional yield generated by the scheme would be required to meet the 'forecast unrestricted demand' (see Tables 6, 7, 8). Note that Conjurunup Pipehead would still be required in 1994/95 to meet demand in the 'most likely' timetable, if Victoria was built then, whereas Conjurunup by itself is sufficient. Therefore Victoria has been deferred to the next year.
3. Three projects are listed in Table 4 which involve increasing pipe capacity in the trunk main network. Their timing in the Source Development Timetable is controlled by a variety of factors, namely:
- . Wungong Stage 2 outlet amplification is introduced when its extra flow capacity is required to meet summer peak demands. The works also result in an increase in the System Yield through improved capability for more flexible operation of the system, which is why the project is shown in the Source Development Timetable.
 - . Mundaring Integration Stage 2 involves constructing connecting pipes to allow the MWS to maintain security of supply to the G&AWS. It is required at a time when growing demands in both the MWS and G&AWS make the capacity of the existing connection inadequate.

- . North Dandalup main amplification involves amplification of a section of trunk main from North Dandalup to Serpentine river. The main adds to the System Yield by improving the flexibility of operating sources south of Serpentine. It is introduced at a time when the cost of the works is justified by the associated System Yield Benefit.
4. Pipehead and pumpback schemes effectively increase the total streamflow supplying the system without increasing the hills reservoir storage capacity. The percentage of this additional streamflow which can be used is smaller for smaller total storage capacities. Consequently the System Yield Benefit of a pipehead or pumpback may appear smaller if it is introduced before the development of a major storage dam than if it is introduced afterwards. 'Lost' yield from prior development is made up when the dam is built, but lower yields must be taken into account when scheduling pipeheads and pumpbacks in this situation.